



ADVICE LETTER SUMMARY

ENERGY UTILITY



MUST BE COMPLETED BY UTILITY (Attach additional pages as needed)

Company name/CPUC Utility No.: Bear Valley Electric Service, Inc (913-E)

Utility type:

- ELC GAS WATER
 PLC HEAT

Contact Person: Jeff Linam

Phone #: (909) 394-3600 x664

E-mail: RegulatoryAffairs@bvesinc.com

E-mail Disposition Notice to: RegulatoryAffairs@bvesinc.com

EXPLANATION OF UTILITY TYPE

ELC = Electric GAS = Gas WATER = Water
 PLC = Pipeline HEAT = Heat

(Date Submitted / Received Stamp by CPUC)

Advice Letter (AL) #: 492-E

Tier Designation: 2

Subject of AL: Supplemental Information for 2022 Integrated Resource Plan

Keywords (choose from CPUC listing): Compliance, Tariffs

AL Type: Monthly Quarterly Annual One-Time Other:

If AL submitted in compliance with a Commission order, indicate relevant Decision/Resolution #: Decision No. 24-02-047

Does AL replace a withdrawn or rejected AL? If so, identify the prior AL: No

Summarize differences between the AL and the prior withdrawn or rejected AL:

Confidential treatment requested? Yes No

If yes, specification of confidential information:

Confidential information will be made available to appropriate parties who execute a nondisclosure agreement. Name and contact information to request nondisclosure agreement/ access to confidential information:

Resolution required? Yes No

Requested effective date: 6/1/24

No. of tariff sheets: None

Estimated system annual revenue effect (%):

Estimated system average rate effect (%):

When rates are affected by AL, include attachment in AL showing average rate effects on customer classes (residential, small commercial, large C/I, agricultural, lighting).

Tariff schedules affected:

Service affected and changes proposed¹: See Advice Letter

Pending advice letters that revise the same tariff sheets:

¹Discuss in AL if more space is needed.

Protests and all other correspondence regarding this AL are due no later than 20 days after the date of this submittal, unless otherwise authorized by the Commission, and shall be sent to:

CPUC, Energy Division
Attention: Tariff Unit
505 Van Ness Avenue
San Francisco, CA 94102
Email: EDTariffUnit@cpuc.ca.gov

Name: Jeff Linam
Title: Regulatory Affairs Manager
Utility Name: Bear Valley Electric Service, Inc
Address: 630 E. Foothill Blvd
City: San Dimas State: California
Telephone (xxx) xxx-xxxx: (909) 394-3600 x664
Facsimile (xxx) xxx-xxxx:
Email: RegulatoryAffairs@bvesinc.com; nquan@gswater.com

Name: Alicia Menchaca
Title: Rate Analyst, Regulatory Affairs
Utility Name: Bear Valley Electric Service, Inc
Address: 630 E. Foothill Blvd
City: San Dimas State: California
Telephone (xxx) xxx-xxxx: (909) 394-3600 x497
Facsimile (xxx) xxx-xxxx:
Email: RegulatoryAffairs@bvesinc.com; alicia.menchaca@bvesinc.co



Bear Valley Electric Service, Inc.
P.O. Box 9028
San Dimas, CA 91773-9028
A Subsidiary of American States Water Company

May 1, 2024

Advice Letter No. 492-E

(U 913 E)

California Public Utilities Commission

Bear Valley Electric Service, Inc. (“BVES”) hereby transmits for filing the following:

SUBJECT: Supplemental Information for 2022 Integrated Resource Plan

PURPOSE

Pursuant to Decision No. (“D.”) 24-02-047¹, Ordering Paragraph No. (“OP”) 4, BVES is supplementing its 2022 Integrated Resource Planning (“IRP”) filing. Specifically, OP 4 states,

4. *The individual integrated resource plans filed in 2022 and supplemented or revised in 2023 are not approved for the following investor-owned utilities and they shall file supplemental information as detailed in Section 2 of this decision via a Tier 2 Advice Letter no later than May 1, 2024: Bear Valley Electric Service and Liberty Utilities (CalPeco Electric), LLC.*

BACKGROUND

On November 1, 2022, BVES filed its 2022 IRP with the Commission. It remained subject to review and approval by the California Public Utilities Commission (“Commission”). On February 20, 2024, the Commission issued D.24-02-047, which evaluated the individual 2022 IRP filings for all load serving entities (“LSEs”). D.24-02-047 found that twelve (12) LSEs did not provide all of the required information in their IRPs and provided an opportunity for those LSEs to update their individual IRPs with the identified deficient information.²

In order to remedy the deficiencies, D.24-02-047 orders that the LSEs file Tier 2 advice letters, no later than May 1, 2024, providing, at a minimum, an appendix or supplement to its 2022 IRP with the “missing or inadequate information” addressed.³ New resource data templates or other attachments are not required.

¹ Decision (D.) 24-02-047, Decision Adopting 2023 Preferred System Plan and Related Matters, and Addressing Two Petitions for Modification

² *Id.* at 2

³ *Id.* at 18

D.24-02-047 states that BVES’s 2022 IRP filing was “not yet approved”.⁴ The table below identifies the deficiencies in BVES’s report.

Table 1.

Bear Valley Electric Service

Area	Specific Requirement	Assessment
3. Study Results	b. Preferred Conforming Portfolios	Adequate
	d.i) Local Air Pollutants	Adequate
	d.ii) Focus on Disadvantaged Communities	Deficient
	e.i) Cost and Rate Analysis (IOUs)	Adequate
4. Action Plan	a. Proposed Procurement Activities and Potential Barriers	Exemplary
	b. Disadvantaged Communities	Deficient

Resubmission requirements to address deficient items:

- **Focus on Disadvantaged Communities:** LSE should describe and provide specific details of outreach to DACs undertaken prior to finalizing and submitting its IRP, summarize the feedback received from DACs and their representatives, and describe how such feedback influenced development of the LSE’s Preferred Conforming Portfolios.
- **Disadvantaged Communities:** LSE should describe and provide specific details on any current and planned LSE activities/programs to address DACs, including those located within the geographic area served by the LSE and beyond, and describe how the LSE’s actions and engagement have changed over time. LSE also needs to provide specific details on current and planned activities to conduct outreach and seek input from any DACs, including those located within the geographic area served by the LSE and beyond, that could be impacted by procurement resulting from the implementation of the LSE’s Plan procurement. If the LSE is not conducting targeted outreach directed toward DACs, it must explain why and discuss its plans for conducting such outreach in the future.⁵

The following attachments are included as part of this AL:

Attachment A: BVES 2022 Integrated Resource Plan, Revised

⁴ *Id.* at 17

⁵ D.24-02-047, pp. 19-20

Attachment B: BVES 2022 Integrated Resource Plan, Revised [REDLINE]

COMPLIANCE

This advice letter complies with the directives in D.24-02-047, as it pertains to BVES.

TIER DESIGNATION

This advice letter is submitted with a Tier 2 designation.

EFFECTIVE DATE

BVES respectfully requests this advice letter become effective June 1, 2024.

NOTICE AND PROTESTS

A protest is a document objecting to the granting in whole or in part of the authority sought in this advice letter. A response is a document that does not object to the authority sought, but nevertheless presents information that the party tendering the response believes would be useful to the Commission in acting on the request.

A protest must be mailed within 20 days of the date the Commission accepts the advice letter for submission. The Calendar is available on the Commission's website at www.cpuc.ca.gov.

A protest must state the facts constituting the grounds for the protest, the effect that approval of the advice letter might have on the protestant, and the reasons the protestant believes the advice letter, or a part of it, is not justified. If the protest requests an evidentiary hearing, the protest must state the facts the protestant would present at an evidentiary hearing to support its request for whole or partial denial of the advice letter.

The utility must respond to a protest within five days.

All protests and responses should be sent to:

California Public Utilities Commission, Energy Division
505 Van Ness Avenue
San Francisco, California 94102
E-mail: EDTariffUnit@cpuc.ca.gov

The protest or correspondence should also be sent via U.S. mail and/or electronically, if possible, to BVES at the addresses shown below on the same date it is delivered to the Commission.

Bear Valley Electric Service, Inc.
Regulatory Affairs
E-mail: RegulatoryAffairs@bvesinc.com

If you have not received a reply to your protest within 10 business days, please contact Jeff Linam at (909) 630-5555.

Correspondence:

Any correspondence regarding this compliance filing should be sent by regular mail or e-mail to the attention of:

Jeff Linam
Manager, Regulatory Affairs
Bear Valley Electric Service, Inc.
630 East Foothill Blvd.
San Dimas, California 91773
Email: RegulatoryAffairs@bvesinc.com

The protest shall set forth the grounds upon which it is based and shall be submitted expeditiously. There is no restriction on who may file a protest.

Sincerely,

/s/Alicia Menchaca
Alicia Menchaca
Rate Analyst, Regulatory Affairs
Bear Valley Electric Service, Inc.

cc: Jenny Au, Energy Division
R. Mark Pocta, California Public Advocates Office
BVES General Order 96-B Service List
Parties on R.20-05-003

ATTACHMENT A

2022 Integrated Resource Plan Version 2


Standard LSE Plan

Bear Valley Electric Service, Inc.

2022 INTEGRATED RESOURCE PLAN

Version 2

May 1, 2024



Bear Valley
Electric Service, Inc.
A Subsidiary of American States Water Company

I.	Executive Summary	6
II.	Study Design.....	13
	a. Objectives.....	16
	b. Methodology	17
	i. Modeling Tool(s)	17
	ii. Modeling Approach	17
III.	Study Results	20
	a. Conforming and Alternative Portfolios.....	20
	b. Preferred Conforming Portfolios.....	30
	c. GHG Emissions Results	31
	d. Local Air Pollutant Minimization and Disadvantaged Communities	34
	i. Local Air Pollutants.....	34
	ii. Focus on Disadvantaged Communities.....	36
	e. Cost and Rate Analysis.....	39
	f. System Reliability Analysis	46
	g. High Electrification Planning	50
	h. Existing Resource Planning	51
	i. Hydro Generation Risk Management.....	51
	j. Long-Duration Storage Planning	52
	k. Clean Firm Power Planning.....	52
	l. Out-of-State Wind Planning	53
	m. Offshore Wind Planning.....	53
	n. Transmission Planning	53
IV.	Action Plan	53
	a. Proposed Procurement Activities and Potential Barriers.....	55
	i. Resources to meet D.19-11-016 procurement requirements.....	55
	ii. Resources to meet D.21-06-035 procurement requirements, including: 55	
	a. 1,000 MW of firm zero-emitting resource requirements.....	55

b.	1,000 MW of long-duration storage resource requirements.....	56
c.	2,500 MW of zero-emissions generation, generation paired with storage, or demand response resource requirements	56
d.	All other procurement requirements.....	56
e.	Offshore wind	56
i.	Other renewable energy not described above.....	56
ii.	Other energy storage not described above	56
iii.	Other demand response not described above	56
iv.	Other energy efficiency not described above.....	56
v.	Other distributed generation not described above	56
vi.	Transportation electrification, including any investments above and beyond what is included in Integrated Energy Policy Report (IEPR)	56
vii.	Building electrification, including any investments above and beyond what is included in Integrated Energy Policy Report	57
b.	Disadvantaged Communities.....	62
c.	Commission Direction of Actions.....	63
V.	Lessons Learned.....	63
	<i>Glossary of Terms</i>	65

List of Figures and Tables

Figure 1: Resource Planning under 25 MMT Portfolio.....	15
Figure 2: Resource Planning Under 30 MMT Portfolio.....	15
Figure 3: Comparison of Monthly Load with Default C&I Assumption and BVES Customized C&I Assumption	19
Figure 4: Forecast Supply Mix in 2035 - 25 MMT Scenario.....	25
Figure 5: Forecast Supply Mix in 2035 - 30 MMT Scenario.....	25
Figure 6: BVES Conforming Portfolio GHG Local Emissions Results: 25 MMT Benchmark.....	35
Figure 7: BVES Conforming Portfolio GHG Local Emissions Results: 30 MMT Benchmark.....	36
Figure 8: DACs Outside of BVES Service Territory	38
Figure 8: 25 MMT LSE Capacity by Contract Status.....	47
Figure 9: 30 MMT LSE Capacity by Contract Status.....	47
Table 1: 2022 IRP Cycle GHG Assigned Benchmarks.....	7
Table 2: Conforming and Preferred Portfolio Results	11
Table 3: BVES Assigned Load Forecast 2023 – 2035 (GWh).....	13
Table 4: BVES CSP Calculator Demand Inputs: 25 MMT and 30 MMT Scenarios.....	14
Table 5: BVES Sales Forecast and GHG Emissions Benchmark Compared to Other LSEs	16
Table 6: RPS Resource Custom Profile - 3 Firm RE PPAs.....	21
Table 7: Conforming Portfolio with Contract and Supply Details in 2035	22
Table 8: BVES Portfolio Scenarios 2023-2035	26
Table 9: Energy Balance Results - 25 MMT Conforming Portfolio	28
Table 10: Energy Balance Results - 30 MMT Conforming Portfolio.....	29
Table 11: BVES 25 MMT Conforming Scenario Carbon Dioxide Emissions Forecast	29
Table 12: BVES 30 MMT Conforming Scenario Carbon Dioxide Emissions Forecast	30
Table 13: BVES 25 MMT GHG Results Based on Clean System Power Calculator	32
Table 14: BVES 30 MMT GHG Results Based on Clean System Power Calculator	32
Table 15: Census Tracts and Demographics within BVES's Service Territory	39
Table 16: Revenue Requirements and Bundled System Average Rates for Baseline Scenario (2021 \$).....	42
Table 17: Revenue Requirements and Bundled System Average Rates for 25 MMT Preferred Conforming Portfolio (2021 \$).....	43
Table 18: Revenue Requirements and Bundled System Average Rates for 30 MMT Preferred Conforming Portfolio (2021 \$).....	44
Table 19: 25 MMT Load and Resource Table by Contract Status.....	47
Table 20: 30 MMT Load and Resource Table by Contract Status.....	47
Table 21: BVES Resource Mix in 2035 Compared to RSP	49
Table 22: Additional Contract Procurements Under High Electrification Scenario.....	50
Table 23: BVES Power Procurement Summary	57
Table 24: BVES Procurement Implementation Summary.....	59

Bear Valley Electric Service, Inc. (BVES) updated its 2022 Integrated Resource Plan (IRP) as a result of California Public Utilities Commission (CPUC) Rulemaking 20-05-003 proposed decision on January 19, 2024 and final decision (Decision 24-02-047) issued on February 20, 2024, which among other directives, required revisions to load-serving entity (LSE) IRPs with identified deficiencies and resubmission on May 1, 2024.¹

In response to the directives, BVES has addressed the deficiencies noted from its initial 2022 IRP submission. BVES has prepared a comprehensive revision, which includes section updates and supplementary detail focusing on the identified gaps such as incorporation of disadvantaged communities in IRP preparation and emission reduction strategies. This updated IRP has been structured to meet the CPUC's requirements and is set to be resubmitted through a Tier 2 advice letter by the deadline of May 1, 2024, as directed.

BVES prepared this update with intention to revise and update the IRP to show its consistent focus and dedication to its ratepayers and the state at large. This revision is undertaken with a firm commitment to rectifying the gaps identified in our previous filing, specifically focusing on enhancing our strategies around disadvantaged communities, even if they are not directly within our service area.

Recognizing the cross-regional impacts of air pollutants, this updated 2022 IRP details BVES's strategic path towards reducing emissions and improving communication and outreach. It details our transition to zero-emitting energy sources through the procurement of 7x24 block renewable power, alongside a detailed plan to improve our outreach and educational efforts. Additionally, this update incorporates comprehensive measures to better engage with and support medical baseline and access and functional needs groups, reflecting a deeper commitment to inclusive and sustainable energy planning.

¹ CPUC. R. 20-05-003. D. 24-02-024, "Decision adopting 2023 Preferred System, Plan and Related Matters, and Addressing Two Petitions for Modification," <https://docs.cpuc.ca.gov/PublishedDocs/Published/G000/M525/K918/525918033.PDF>, pg. 19-20.

I. Executive Summary

The 2023-2035 Integrated Resource Plan (IRP) for Bear Valley Electric Service, Inc. (BVES)² is the primary document used in planning, evaluating, and acquiring energy resources to meet the forecasted energy requirements of BVES's retail customers, consistent with goals set by the state legislature and requirements enforced by the Energy Division of the California Public Utilities Commission (hereafter, CPUC or Commission). This IRP also serves as a contributing factor to the overall electric sector profile for state regulators to prepare a pathway for load-serving entities (LSEs) to achieve 100 percent of retail energy sales coming from eligible renewable and zero-carbon resources by 2045 in accordance with Senate Bill (SB) 100 (DeLeon, Chapter 312, Statutes of 2018).³

The objective of BVES's 2023-2035 IRP is to identify reliable, best-fit, least-cost, low-carbon energy resources to serve the needs of BVES's electric customers and to provide resource portfolio scenarios that consider evaluation of supply and demand-side resources to the Commission. The amount and types of resources in the IRP must also be consistent with Commission regulations and California State laws governing, among other issues, resource adequacy (RA), renewable energy (RE), and greenhouse gas (GHG) emissions limits, and reduction targets.

IRP Proceeding History

As a result of Senate Bill (SB) 350, the Commission was directed to develop an IRP process for its regulated electric utilities and service providers for long-term resource planning needs, assuring that the collective electric sector is on track to meet GHG reduction goals with secured reliable and least-cost resources. The IRP proceeding is designed on a two-year cycle, with LSE contribution to the Commission's Reference System Plan (RSP) provided in the form of conforming portfolios and planned procurement activities within their IRPs.

The first year of the CPUC IRP cycle consists of a self-initiated process undertaken by the Commission to develop a RSP of optimal planning resources integrated to meet the state's GHG reduction targets. The Commission considers LSE IRPs in the second year of the cycle and aggregates LSE portfolios into a single system-wide portfolio, the Preferred System Portfolio (PSP). The RSP and PSP jointly provide inputs for the California Independent System Operator (CAISO) Transmission Planning Process (TPP). On February 10, 2022, the Commission adopted an optimal planning portfolio for the 2021 PSP and evaluated the 2020 individual IRP filings through Decision (D.) 22-02-004 under Rulemaking (R.) 20-05-003. The adopted PSP meets a statewide 38 million metric ton (MMT) of carbon dioxide (CO₂) GHG target for the electric sector in 2030 with 35 MMT for 2032. Commission staff adjusted the timeframe beyond 2030 to

² Bear Valley Electric Service became incorporated as a subsidiary of American States Water Company as of July 1, 2020. Hereafter, the IRP references the LSE as Bear Valley Electric Service Incorporated (BVES) and BEAR through modeling designations.

³SB 1020 (The Clean Energy, Jobs, and Affordability Act of 2022) added Interim targets to the existing policy framework established by SB 100 by requiring renewable energy and zero-carbon resources to supply 90 percent of all electric retail sales by 2035 and 95 percent by 2040.

2035 in order to add resource required under D. 21-06-035⁴ in response to the mid-term reliability assessment. The 2021 PSP decision also recommended to the CAISO that the 38 MMT PSP portfolio be utilized for both reliability and policy-driven base case for the 2022-2023 TPP. From this determination, the results urged both the Commission, CEC, and CAISO to establish a more aggressive GHG reduction case for the 2022 IRP cycle.⁵

Table 1: 2022 IRP Cycle GHG Assigned Benchmarks

Portfolio Scenario Common Title	BVES's Proportion of Total Emissions	2030 Load (GWh)	2035 Load (GWh)	2030 GHG Emissions Benchmark (MMT)	2035 Emissions Benchmark
25 MMT Benchmarks	0.000587773	138.8195496	142.4237088	0.014446927 ^A	0.011684697 ^B
30 MMT Benchmarks				0.019149114 ^C	0.014623564 ^D

^A Meeting the 30 MMT electric sector GHG reduction targets

^B Meeting the 25 MMT electric sector GHG reduction targets

^C Meeting the 38 MMT electric sector GHG reduction targets

^D Meeting the 30 MMT electric sector GHG reduction targets

Covering the years 2023-2035 in this IRP procedural process, the Commission established baseline assumptions and inputs that were utilized in framing the RSP. On June 15, 2022, Administrative Law Judge (ALJ) Ruling finalizing load forecasts and GHG benchmarks via R. 20-50-003. On June 28, 2022, the Commission issued the updated load forecasts and GHG benchmarks assigned to respondent LSEs through the IRP materials webpage. The Commission further updated and issued the narrative template for the IRP on June 15, 2022, the final CSP calculator on July 15, 2022, and the RDT on October 11, 2022. BVES did not elect or find the need to present an alternative portfolio for this IRP cycle. Additionally, BVES is not subject to additional procurement obligations required via D. 19-11-016⁶ or D. 21-06-035, which supported additional capacity ordering outside of the RSP and PSP adoption processes for obligated LSEs to meet urgent procurement needs.

BVES Service Area Characteristics

BVES, a subsidiary of American States Water Company, is an investor-owned utility (IOU) regulated by the CPUC. BVES provides electric service in a mountainous resort community to approximately 24,500 customers, of which approximately 22,500 are residential customers with a mix of roughly 40 percent

⁴ CPUC. Rulemaking 20-05-003, D.21-06-035 Decision Requiring Procurement to address Mid-Term Reliability (2023-2026)," <https://docs.cpuc.ca.gov/PublishedDocs/Published/G000/M389/K603/389603637.PDF>.

⁵ LSEs are required to provide portfolios for the CPUC planning target (30 MMT of GHG emissions) as well as the target of 25 MMT, which are driven by SB 350 and modified by SB 100 state objectives in achieving 100 percent of electricity sales coming from eligible renewable and zero-carbon resources by 2045. The prior 2020 IRP cycle denoted acceptable GHG benchmark levels of 46 MMT for the reliability base case and 38 MMT for the policy-driven base case.

⁶ CPUC. Rulemaking 16-02-007, D.19-11-016 "Decision Requiring Electric System Reliability Procurement for 2021-2023," <http://docs.cpuc.ca.gov/PublishedDocs/Published/G000/M319/K825/319825388.PDF>.

full-time and 60 percent part-time residents.⁷ Approximately 1,500 of the total number of customers are commercial, industrial, and public-authority customers, including two ski resorts. Additionally, approximately 500 accounts within the commercial and residential customer base are considered net energy metering (NEM) customers.

BVES's historical peak load is approximately 45 megawatts (MWs); winter monthly peaks occur when snowmaking machines at the ski resorts are operating and recreational visitors are present (generally between 5:00 pm and 11:00 pm on weekends). In the summer months, the load in BVES's service area ranges from an average minimum of about 10-12 MW (early summer mornings) to a maximum of approximately 24 MW (late evenings on holiday weekends). BVES purchases wholesale power to meet the majority of its energy requirements. To aid in meeting peak demand for electric energy, BVES installed and operates the Bear Valley Power Plant (BVPP), a natural gas-fired, 8.4 MW generation plant, with a tested heat rate of 12,000 British thermal units (Btu)/kilowatt-hour (kWh), in its service area. The BVPP became commercially operational on January 1, 2005. BVES's 45 MW peak load represents approximately 0.1 percent of the CAISO peak load.

BVES has two receipt points of power from Southern California Edison Company (SCE), which include the Goldhill transfer station and Radford Feeder. The majority of BVES's power is transmitted over SCE's 33 kilovolt (kV) subtransmission line from the Cottonwood substation to the Goldhill transfer station. The remainder of BVES's energy is transmitted over SCE's 33 kV distribution facilities from the Zanja substation near Redlands over the Radford Feeder to BVES's Village substation.⁸

BVES's distribution system is located and operates under the balancing authority (BA) of the CAISO. However, BVES does not own any transmission facilities and is not a Participating Transmission Owner (PTO) under the CAISO Tariff. BVES facilities are indirectly interconnected with the CAISO-controlled grid via wholesale distribution access facilities that are owned, controlled, and operated by SCE. These facilities are then directly interconnected with SCE transmission facilities that are part of the CAISO-controlled grid. Lastly, the BVPP does not operate under a Participating Generator Agreement (PGA) and thereby is not considered a CAISO-controlled unit under the CAISO Tariff. It should be noted that because BVES is a holder of Congestion Revenue Rights (CRRs), BVES falls under direct tariff regulation by the CAISO. BVES must indirectly adhere to the CAISO Tariff due to power scheduling and RA requirements. The requirements are imposed on BVES by its third-party schedule coordinator (SC), who must abide by the CAISO Tariff to schedule BVES's power and RA resources.⁹

IRP Process Overview & Study Findings

In this IRP, BVES includes two conforming and two preferred conforming portfolios as directed by the Commission for its proportional share of the two established benchmark targets. Consistent with BVES' inaugural Standard Plan format filing for the 2020 IRP, this 2022 IRP also follows the Standard Plan pursuant to R. 20-05-003. BVES also provides in this IRP its resource action plan through 2035, system-level planning discussions, a response addressing identification of disadvantaged communities and

⁷ Based on number of active billed accounts as of October 2022.

⁸ BVES refers to voltages on these SCE lines as 34.5 kV.

⁹ Currently APX is under contract with BVES to act as its SC and provide schedule coordination services.

supply procurement impacts, and details surrounding the modeling design and GHG emissions benchmark results using established Commission assumptions and inputs.

Carbon accounting practices at BVES had previously assumed emissions intensity alignment with the power resource mix attributed to SCE's service territory. This is supported by the condition that supply from the CAISO-controlled grid is indirectly fed onto BVES's distribution system by way of SCE infrastructure and service area.¹⁰ However, the methodology described in this IRP represents emissions factors that are assigned to LSEs with contracted system power supply and calculations supported by CPUC-driven models and assigned assumptions that address the CAISO system level proportional share to each LSE. As a result of this IRP, BVES found that additional procurement activities may be warranted in order to meet its forecasted GHG benchmark targets by 2035. These activities include securing power resources that are eligible renewable and making direct contracting agreements or market purchases for unit-specific generation. BVES plans to issue solicitations and requests for information that enable internal objectives to transition away from dependency on unspecified power generation contracts over time.

BVES is also in a hedged position in meeting the goals of the California Renewable Portfolio Standard (RPS) through its strategy in securing Renewable Energy Credits (RECs) contracts. In late 2011, D.11-12-052 defined and implemented portfolio content categories (PCCs). Most retail sellers subject to the RPS must procure certain quantities from each of the PCCs. The PCCs, in brief summary, consist of:

1. Generation facilities that have their first point of interconnection to the Western Electricity Coordinating Council transmission grid within the metered boundaries of a California BA area (PCC 1);¹¹
2. Generation from a facility that is firmed and shaped with substitute electricity scheduled into a California BA within the same calendar year as the generation from the facility eligible for the RPS, and that the substitute electricity provides incremental electricity (PCC 2); and
3. Other products like unbundled RECs that do not apply to the first two categories (PCC 3).

Of importance, D.11-12-052 confirmed that BVES may satisfy its RPS obligations without regard to the PCC limitations to which most other retail sellers must adhere. Since BVES is exempt from following the product content categories distribution, it has complied with the majority of its RPS requirements with unbundled RECs (e.g., PCC 3) to the greatest extent allowed because it is the least expensive option of the RPS-eligible products. In meeting IRP requirements, BVES understands that PCC 2 and PCC 3 RECs are ineligible for the purposes of GHG emissions benchmark targets. As such, and in aligning with clean power adoption targets, BVES has adapted its previous 2020 IRP preferred portfolio to account for bundled, firm RE PPAs, for which it expects to meet future RPS compliance periods as well as meeting applicable standards for the IRP CSP model under varying GHG benchmark thresholds.

BVES faces constraints in substantially expanding its utility-owned renewable generation buildout due to factors such as limited large parcels being available in its remote service territory and the utility is not

¹⁰ SCE, "2021 Power Content Label", <https://www.sce.com/sites/default/files/custom-files/Web%20files/2021%20Power%20Content%20Label.pdf>.

¹¹ Procurement claims from contract/ownership agreements executed before June 1, 2010, or January 13, 2011, for ESPs, are not subject to the PCC classifications established in D.11-12-052. For the purposes of RPS compliance, any eligible RPS RECs that are not subject to PCC 1, 2, or 3 will be placed in their own classification, referred to as PCC 0.

directly connected to the CAISO controlled grid. BVES will investigate the viability to procure unit-specific eligible resources that are wheeled in by the CAISO market as well as plans to secure contracts for firm renewable resources. BVES is in the process of revising its plans and resubmitting an Advice Letter for a solar photovoltaic (PV) plant coming online, (at this time planned for the fourth quarter (Q4) of 2024), which will help to support the ability to meet GHG reduction obligations, reduce reliance on wholesale power, and generate RECs for future compliance periods of the RPS. Additionally, BVES has recently worked with a third-party to develop a cost-benefit study to determine the feasibility in procuring a utility-scale battery energy storage solution (BESS) in its service territory. The current planned implementation target is also in late 2024 or early 2025 at the latest. For the purpose of the IRP modeling exercises, BVES has indicated a Q4 2024 operating date. These systems, however, are not currently planned to be hybridized.

Currently supplied primarily by shaped and firm unspecified system power contracts, BVES will continue to seek cost-appropriate renewable energy contracts and eligible renewable projects to assist in moving away from system power supply contracts over time to meet the 2035 benchmark and state energy sector GHG reduction targets.

Additional results from this IRP include the determination of net qualifying capacity (NQC) targets through 2035. BVES's latest contract for RA capacity expired in 2021. Efforts to procure additional RA capacity contracts to meet RA obligations are continuing through frequent, additional bid requests.

Preferred Portfolio & Action Plan

BVES is not seeking additional procurement actions from the Commission under its Preferred Conforming scenario through this IRP filing. BVES has historically accounted for its cost-effective, firm system power PPAs, owned BVPP, energy efficiency activities, demand response (DR) programs, and behind-the-meter (BTM) distributed energy resources (DER). BVES continues to plan for an owned solar facility supplying the BVES system, standalone BESS configuration, as well as migrating to a nearly 100 percent clean power delivery strategy through contracted firm renewable energy PPAs by 2035. Through these power supply planning characteristics, along with assigned load modifiers and the forecasted demand increase through 2035 by the most recent CEC Integrated Energy Policy Report (IEPR), BVES modeled future supply needs aligning with calculations and assumptions prescribed by the CPUC.

This analysis has resulted in an action plan that meets assigned GHG benchmarks and can be achieved over the planning horizon. Activities proposed to rapidly decrease BVES forecasted GHG emissions through energy supply management include: deploying the solar PV and battery storage projects over the next two-to-three years, obtaining cost-competitive firm RE contracts, and securing short-term system power contracts through 2035 to meet supply shortfalls aligning with state goals. Additionally, BVES will maintain awareness of local community impacts and maintain prudent utility responsibility to provide reliable, least-cost energy to all customers.

When using the CEC IEPR 2021 load modifiers and the assigned load forecast, BVES modeled its supply needs for future renewable contracts based on its ability to meet benchmarks for GHG emissions under the CPUC assumptions for carbon intensity of system power. BVES presents in this IRP Conforming Portfolio Scenarios for its proportional share among LSEs. At this time, BVES's greatest energy supply

coming from firm energy seasonal and annual contracts is characterized as unspecified “brown” energy representing available, reliable, cost-effective delivery capabilities. BVES recognizes that the modeling scenarios incorporate carbon intensity measurements for system power mapped to that of dispatchable natural gas resources as it assumes no generating units in specific hours in addition to natural gas generation.

Table 2 presents BVES’s Conforming and Preferred Portfolio results for both GHG benchmarks for 2035. BVES generated two supply portfolios that conform to the IRP requirements. Both are considered for the preferred portfolio selection. While BVES illustrates both the 25 MMT and 30 MMT scenarios, the primary preferred portfolio aligns with the 30 MMT scenario. After completing the IRP analysis, BVES modeled portfolios where emissions targets reach just below the assigned threshold benchmarks.

Table 2: Conforming and Preferred Portfolio Results

Assumptions	Supply Side Resources	BVES 2030 Assigned Load Forecast (GWh)	BVES 2035 Assigned Load Forecast (GWh)	Assigned 2030 Emissions Benchmark (MMT)	Assigned 2035 Emissions Benchmark (MMT)	IRP GHG Emissions Results 2030 (MMT)	IRP GHG Emissions Results 2035 (MMT)
Conforming Portfolio Scenario (a)							
<ul style="list-style-type: none"> Benchmarked against 25 MMT GHG threshold CEC IEPR load modifiers CEC IEPR demand side modifiers Resource generation output using CPUC assumptions and capacity factors Adjusted percent to 40 for C&I load through 2035 	See Error! Reference source not found.	138.82	142.42	0.01446927	0.011684697	0.01154	0.01068
Conforming Portfolio Scenario (b)							
<ul style="list-style-type: none"> Benchmarked against 30 MMT GHG threshold CEC IEPR load modifiers CEC IEPR demand side modifiers Resource generation output using CPUC assumptions and capacity factors Adjusted percent to 40 for C&I load through 2035 	See Figure 2	138.82	142.42	0.019149114	0.014623564	0.01819	0.01402

Assumptions	Supply Side Resources	BVES 2030 Assigned Load Forecast (GWh)	BVES 2035 Assigned Load Forecast (GWh)	Assigned 2030 Emissions Benchmark (MMT)	Assigned 2035 Emissions Benchmark (MMT)	IRP GHG Emissions Results 2030 (MMT)	IRP GHG Emissions Results 2035 (MMT)
Secondary Preferred Conforming Portfolio Scenario							
• Equal to Conforming Scenario (a) assumptions	See Error! Reference source not found.	138.82	142.42	0.0144446927	0.011684697	0.01154	0.01068
Primary Preferred Conforming Portfolio Scenario							
• Equal to Conforming Scenario (b) assumptions	See Figure 2	138.82	142.42	0.019149114	0.014623564	0.01819	0.01402

This IRP narrative discusses the objectives for the planning horizon, which aims to secure competitive bundled RE power purchase agreements (PPAs) that will replace phased out system power contracts, deploy both a battery storage device and solar generating facility within the BVES territory, and leverage BVES’s existing load characteristics and peaker plant to account for any supply shortfalls in addition to spot market purchases. This IRP presents the study results of the conforming and preferred scenarios under both the 25 MMT and 30 MMT GHG reduction scenarios, the action plan in achieving the supply plan, and ongoing lessons over the last IRP cycles.

The study design in Section II will cover the methodology utilized to develop the analyses and modeling tools and approach. The study results, as discussed in Section III, address the conforming and any viewed alternative portfolios as well as indicate the final preferred conforming portfolios selected out of the completed analysis. This section will also address the final GHG emissions results and any local air pollutants with particular focus on disadvantaged communities. This section similarly describes the cost and rate analysis for the baseline case and both portfolio cases, system reliability analysis, and several power supply planning opportunities and challenges regarding areas such as high electrification planning, existing versus new build planning, hydro, long-duration storage, wind, and transmission planning, as well as addressing how BVES will work towards achieving clean firm power contracts.

The section covering the action plan presents the proposed procurement activities and potential barriers for success, as well as additional procurement obligations for required capacity planning. While BVES is not subject to either release of the procurement obligations, it addresses the subsections accordingly. The final subsections will respond to prompts addressing disadvantaged communities, any Commission direction requests, and a summary of BVES’s lessons learned.

II. Study Design

The following describes the study design for the 2022 IRP.

Load Assignments for Each LSE

For the 2023-2035 IRP, BVES performed a study designed on key factors that impact supply and demand side needs through the forecast period. As directed by the Commission, the 2021 CEC IEPR forecast for BVES was used as a baseline in the conforming portfolio scenario development. Load modifiers such as increased penetration of BTM distributed energy resources (DERs), energy efficiency (EE), electric vehicle (EV) adoption, and expected load growth are described in detail using CEC IEPR demand modifier inputs for modeling results. These values are also determined using forecasts from the RESOLVE and SERVM modeling results and subsequent instruction from the Commission. BVES did not modify any optional input entries or deviate from the assigned assumptions apart from the C&I demand modifier percentages as explained below. As discussed, BVES does not own any transmission assets, does not have any sourced energy projects that are CAISO-controlled, and receives supplied electricity fed in at the distribution level from SCE.

Table 3: BVES Assigned Load Forecast 2023 – 2035 (GWh)

2023	2024	2025	2026	2027	2028	2029	2030	2031	2032	2033	2034	2035
132	132	133	134	136	137	138	139	140	140	141	142	142

Table 3 reports the assigned sales forecast for BVES through 2035 resulting from the 2021 IEPR Forecast and approved in R.20-05-003 on June 15, 2022. BVES relies solely on this sales forecast for this IRP effort, as directed by the Commission. BVES represents the second smallest LSE of all those reported in the CSP calculator, and has a sales forecast nearly four-times smaller than the next larger small multi-jurisdictional utility (SMJU).

In addition to the sales forecast shown above, BVES relied on load modifier assumptions as presented in the CSP calculator to remain consistent with the 2021 IEPR forecast. BVES did not supply unique load modifier shapes in the CSP calculator for either the 25 MMT or 30 MMT scenario. However, BVES did include a customized assumption regarding the annual percent of commercial and industrial (C&I) load. While the default assumption included in the CSP model is 49-50 percent, BVES's system is anticipated to be 40 percent C&I by 2024 and onwards. This is supported by recorded percentage of sales attributed to the C&I customer accounts and plans for oncoming load growth in that customer category.

Table 4 reports the calculated demand inputs for BVES assigned sales forecast as calculated by the CSP calculator.

Table 4: BVES CSP Calculator Demand Inputs: 25 MMT and 30 MMT Scenarios

Active Demand Inputs	Units	2024	2026	2030	2035
Baseline net energy for load	GWh	152	155	162	167
Non-commercial/industrial portion of baseline (included in baseline total)	GWh	91	93	97	101
Commercial/industrial portion of baseline (included in baseline total)	GWh	61	62	65	67
Electric Vehicle Load	GWh	5	8	12	18
Building Electrification	GWh	1	1	2	4
Energy Efficiency	GWh	-2	-4	-6	-9
Behind-The-Meter Photovoltaics (BTM PV)	GWh	-13	-15	-20	-26
Behind-The-Meter Storage Losses (BTM Storage)	GWh	0	0	0	0
Calculated demand at utility-scale generator bus-bar	GWh	143	145	150	154

Required and Optional Portfolios

The CPUC developed the assumptions utilized in this IRP as a result of calibrated models executed through the RESOLVE and SERVM models. Additional inputs for load modifiers are derived from the CEC 2021 IEPR. In order to address the electric sector’s proportion of GHG emissions abatement by 2035, the CPUC assigned LSEs proportional GHG emissions (in carbon dioxide CO₂ MMT) benchmarks. BVES developed its Conforming Portfolios/Preferred Portfolios using these assumptions for consistency and did not opt to select optional demand side entries. To produce a compliant IRP, BVES provides this IRP narrative and associated Resource Data Templates (RDTs) and CSP calculator models as part of its complete filing. BVES does not have any candidate resources subject to the baseline information utilized in the development of the CPUC RSP and responds to this prompt as “not applicable.” Both the storage and solar facilities are considered incremental for RSP planning purposes. BVES also assumes all future RE firm PPA generating units are online and are regional to the CAISO system.

Additionally, BVES did not produce an optional Alternative Portfolio study for this IRP cycle and does not have any resources subject to the Cost Allocation Mechanism or Power Charge Indifference Adjustment relating to departing load. BVES references internal energy supply costs in forecasting capital cost and financing information that better reflect the position and unique conditions in long-term energy resource planning. While an incremental analysis on RA capacity is not warranted for this 2021-2022 IRP cycle, BVES presents a discussion on current efforts to address this concern in the short and long-term. BVES leveraged financial information both from the RESOLVE results as well as the characterization presented in its 2023 Test Year General Rate Case (GRC) for consistency. All other cost and rate analysis values are designed from publicly available inputs. This is discussed in detail in Subsection e of Section III.

The figures below illustrate the two supply-side portfolios generated under this analysis through 2035.

Figure 1: Resource Planning under 25 MMT Portfolio


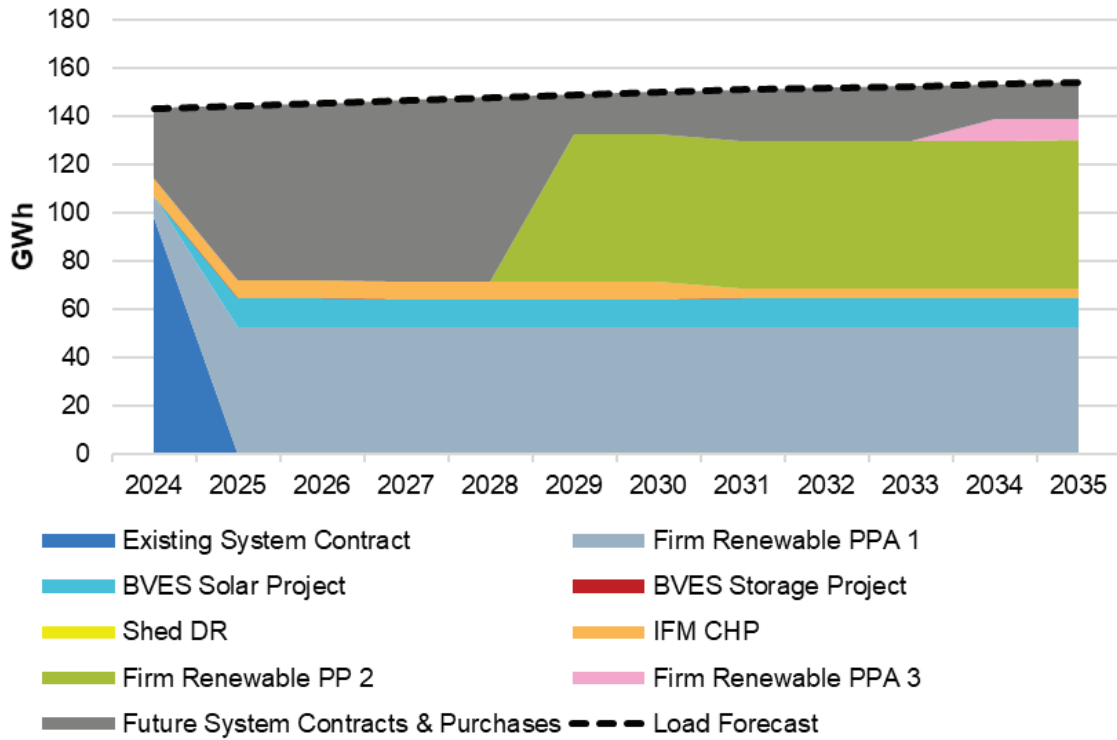


Figure 2: Resource Planning Under 30 MMT Portfolio

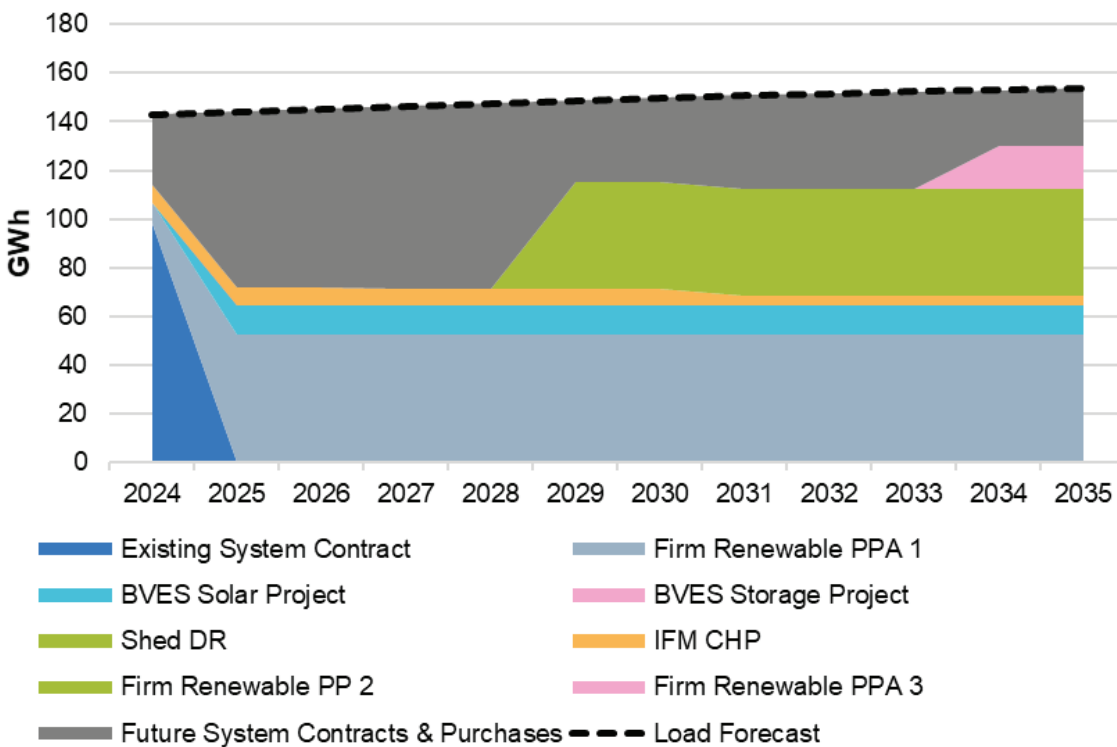

GHG Emissions Benchmark

BVES utilized benchmarks of GHG MMT CO₂ for 2030 and 2035 for both the 25 MMT and 30 MMT scenarios. BVES aligned its IRP approach to these established benchmarks as shortfall supply will be met by day-ahead energy purchases and short-term power contracts throughout BVES’s energy management planning transition to achieving supply carbon reduction goals.¹²

Table 5 compares forecast sales and GHG emissions benchmarks between BVES and the other SMJU as well as the large investor-owned utilities (IOUs). The table shows that BVES, the smallest utility in the aggregated service territory area, proportion of emissions is 0.1 percent while Pacific Gas and Electric Company, the largest utility, is 33.8 percent of total emissions (338 percent greater than BVES). Further, BVES proportion of emissions represents 10 percent of the emissions associated with the two additional SMJUs, exemplifying the small size of BVES as an electric provider. In terms of load, BVES represents only 8.7 percent of combined SMJU load in 2035 and 0.07 percent of total load for the combined small and large IOUs in 2035.

Table 5: BVES Sales Forecast and GHG Emissions Benchmark Compared to Other LSEs

Aggregated Service Territory Area	Proportion of Emissions	2030 Load (GWh)	2035 Load (GWh)	2035 GHG Emissions Benchmark (25 MMT Scenario)	2035 GHG Emissions Benchmark (30 MMT Scenario)
BVES	0.1%	139	142	0.01	0.01
Other Small Multi-Jurisdictional Utilities (Liberty Utilities & PacifiCorp)	1.0%	1,466	1,496	0.27	0.22
Pacific Gas & Electric Area	33.8%	77,800	81,536	8.43	6.74
Southern California Edison Area	33.2%	86,946	88,816	8.07	6.42
San Diego Gas & Electric Area	8.8%	17,556	17,975	2.27	1.83

a. Objectives

BVES developed this IRP analytical work with the following objectives:

1. Inform the Commission of its studied 2023-2035 IRP through use of the CSP calculator and RDT models to contribute to the CPUC’s RSP, PSP, and overall Reference System Plan;
2. Understand whether BVES is on target to meet its 2035 GHG benchmark under the Reference System Plan with its assigned load forecast and demand modifiers issued by the Commission;
3. Plan for firming renewable power contracts and model where reduction of system power reliance can commence over time;
4. Present avenues to meet current and future policy goals given its unique service area, wholesale market energy supply, and overall customer profile, noting BVES does not have disadvantaged communities in its service territory;
5. Provide discussion results that address system-wide concerns and anticipated constraints; and

¹² The IRP Standard Plan narrative prompt states, " When calculating emissions in the CSP calculator, LSEs should achieve GHG emissions results that are slightly below their GHG benchmarks to leave room in the system for BTM CHP emissions that will be added during the portfolio aggregation process."

6. Utilizing the model results, provide an actionable plan for least-cost, reliable resource planning while identifying potential constraints.

In addition, BVES submits in its 2023-2035 IRP descriptions of: i) BVES future procurement investigations to achieve the GHG targets; and ii) BVES Preferred Conforming Portfolios that are comparable with the RSP. Supporting documents to this IRP include the two Conforming Portfolio Scenarios for the RDT model and CSP calculator (for both 25MMT and 30MMT scenarios).

b. Methodology

The following discusses the 2022 IRP methodology.

i. Modeling Tool(s)

Under direction of the Commission, BVES conducted a resource and GHG emissions planning analysis through the RDT and CSP calculator Excel models issued on July 15, 2022 and October 11, 2022, respectively. BVES assumed inputs and results from the RESOLVE model to understand capacity expansion needs and price forecasting as well as the resource planning assumptions within the RDT. BVES developed, with a consultant, an internal Excel power resource planning workbook to analyze the impacts of different portfolio scenarios on the supply-demand balance and portfolio emissions. The workbook was built to reflect the key inputs, assumptions, and logic assumed by both the RDT and CSP models to ensure consistency when analyzing different portfolio options. An additional Excel workbook was developed to project incremental costs (market purchases, renewable contracts, and investment costs) to determine the functionalized revenue requirement under the presented portfolio options.

ii. Modeling Approach

The presented Conforming Scenarios were developed under policy-driven modeling objectives as a base case approach for reliability while ultimately ensuring the emissions benchmarks assigned to BVES were met. BVES approached its analysis with the goal of evaluating a diverse range of supply portfolios that considered BVES's planned generation projects, additional firm and non-firm renewable generation PPA, and, simultaneously, a decrease in unspecified system power purchases as owned assets and PPAs begin delivering renewable energy and REC products.

The 2023-2035 energy resource planning strategy aims to secure achievable, cost appropriate PPAs (preferably with a REC product) while mitigating rate impacts with increasing renewables within the supply mix contingent with reduced system power contracting. BVES-owned projects (i.e., BVES Solar Project and the BESS) are discussed in the narrative and modeled in both the RDTs and CSP calculators along with the planned BVES contract for 7x24 block renewable power. All existing contracts are captured, including the current existing contract for system power that will expire November 1, 2024. Future system RA obligation contracts are modeled out through 2035 with the assumption that resource capacity is currently available and online (i.e., not incremental to the RSP nor anticipating new resources in the CAISO interconnection queue).

In building a given portfolio scenario, BVES varied the number of planned PPAs as well as the following characteristics of the PPAs: technology type, nameplate capacity, and contract start date. BVES considered new solar PPAs, new wind PPAs, and additional contracts mimicking the 7x24 block renewable product that BVES is planning to contract for in 2024. Mechanically, these supply options were modeled using the hourly renewable profiles provided in the CSP model for Solar Baseline

California and Wind Baseline California¹³. BVES developed a custom generation profile to reflect the aggregate attributes of the 7x24 renewable block products assumed within a given portfolio scenario.

The range of supply portfolios analyzed can be summarized as a “Wind Heavy” range of portfolios (majority of future contracts were associated with wind PPAs), “Solar Heavy” (majority of future contracts were associated with solar PPAs), “Equal Technology” (both wind and solar PPAs made up the portfolio), and “Firm Renewable” (future contracts were assumed to mimic the 7x24 renewable block product). By developing scenarios with different combinations of these renewable contracts BVES was able to estimate the amount of additional system power that would be required to serve load and the associated portfolio emissions¹⁴.

BVES chose this range of scenarios to investigate as they represent the most achievable types of PPA contracts, for which BVES can hope to contract. Understanding existing procurement risks, transmission constraints, and current resources in the CAISO queue, BVES arrived at selecting a balancing portfolio of competitive RE resource types that can be assumed as online, having already received commercial operation dates, and will be available at the time of future PPA contracting.

By investigating a range of wind heavy and solar heavy supply portfolios BVES was able to analyze the impact of technology-specific renewable power on resulting supply-demand balance, portfolio emissions, and ultimately portfolio cost. As may be expected, where a greater amount of contracted solar power was assumed BVES saw an increased need for system purchases in the early-morning and late evening hours. Commensurate with those purchases, BVES saw an excess of contracted generation in the middle of the day that would need to either be sold or curtailed. These outcomes drive resulting portfolio emissions owing to the need for greater system purchases compared to a portfolio scenario that had a greater amount of contract wind generation of block 7x24 power. BVES included the analysis of portfolios centered on additional 7x24 block renewable power owing to its current early-stage success contracting for this type of product that would begin delivering in 2024.

BVES not only considered reliability and adherence to the emissions benchmark when scoring potential supply portfolios, but also analyzed the supply cost build-up for each portfolio. When investigating the range of scenarios, portfolio costs were estimated in a twostep process first to account for the contract expense associated with future renewable contracts and second to account for system purchases or sales. BVES modeled PPA costs using the levelized cost estimates (LCOE) from the RESOLVE model for wind and solar resources. Future 7x24 block product contracts were assumed to follow same escalation of other firm renewable sources like geothermal power but were indexed to BVES’s current estimate for the upcoming contract in 2024. Where contract or owned generation fell short of demand on an hourly basis, day-ahead purchases or sales were valued using power market forwards as of September 2022 for CAISO SP-15. Hourly purchases or sales were determined using an hourly supply-demand balance calculation that mimicked the logic provided in the CSP calculator and accounted for curtailment of system sales should the maximum export limit be reached. To compare costs across portfolio scenarios BVES looked both at total portfolio cost as well as average energy price (total portfolio cost divided by owned and contract generation).


¹³ In modeling all portfolio scenarios, BVES modeled generation for the upcoming BVES Solar Project using the Solar Baseline California renewable profile from the CSP model and the BVES Storage Project using the Battery Storage resource profile also from the CSP model.

¹⁴ Actual scenarios for net system power procurement will depend on the availability of solar and wind PPAs being offered at the time of awarding contracts.

As a part of this portfolio analysis BVES analyzed the CEC IEPR provided load forecast against internal, utility derived load forecasts that include updated information on future large customer loads and DG adoption. Importantly, in early fall 2022 BVES came to an agreement with its largest non-residential customer to serve an additional 7.1 gigawatt-hours (GWh) annually beginning in late 2024¹⁵. BVES had not confirmed this expansion project when the 2021 IEPR forecast proceeding was ongoing and thus this adjustment is not reflected in the IEPR forecast for BVES. With this service expansion confirmed, additional drivers of load uncertainty primarily stem from EV adoption and distributed generation uptake. BVES will continue to monitor the adoption of BTM distributed energy resources (DERs) and consult CPUC RSP and CEC IEPR study results to forecast accordingly.

Within the available customizations in the CSP calculator, BVES did ensure to include a customized assumption for the split between residential and non-residential load. Using the most recently available load data provided in Application (A.) 22-08-010, BVES estimated that non-residential sales account for only 40 percent of total retail sales, a 9 percent difference compared to the 49 percent assumption included in the CSP calculator. Figure 3 compares the monthly load between BVES’s customized non-residential load assumption and the CSP calculator default assumption. Decreasing the percent of non-residential sales has the impact of shifting load out of the shoulder months (March, April, October) and into the summer months as well as shifting the daily load profile to slightly more evening peaking. This adjustment ultimately makes it harder for BVES to reach or be below its assigned emissions benchmarks owing to the need for additional system purchases in the early evening hours when solar generation is reduced or unavailable, however, BVES included this adjustment to best reflect its load makeup.

Figure 3: Comparison of Monthly Load with Default C&I Assumption and BVES Customized C&I Assumption

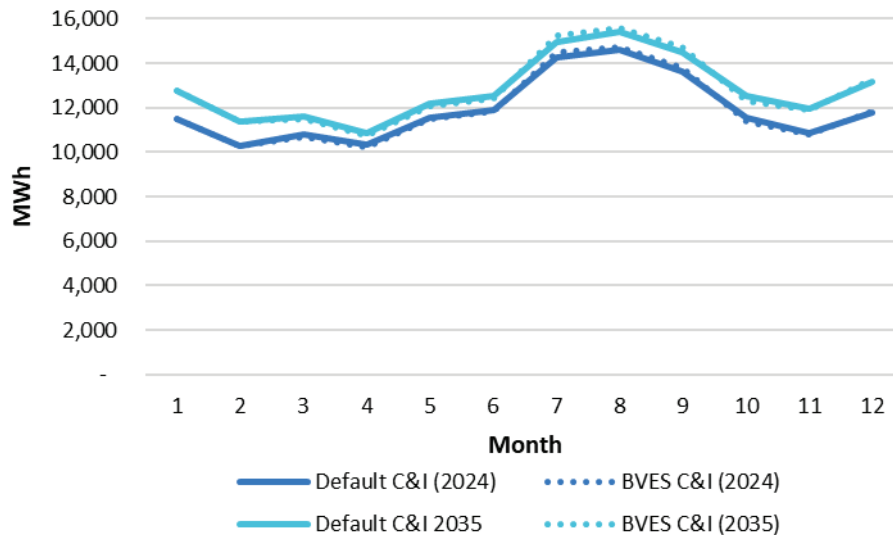

The one demand response (DR) program currently offered by BVES targets its four largest customers through a time-of-use (TOU) interruptible tariff, first approved in its 2009 GRC.¹⁶ This tariff provides a

¹⁵ BVES discussed the possibility of this load expansion in its 2020 IRP and additional details on this expansion can be found in A.22-08-010.

¹⁶ Rate Schedule A-5 TOU.

lower rate in exchange for the customer's agreement to interrupt or reduce load when called upon by BVES to do so, even to a zero load. This DR program currently provides approximately 8.98 MW of interruptible load during winter months and 0.19 MW of interruptible load during the summer months. The 12 MW of coincident winter demand reduction can be called upon during BVES's highest peak demands. These measures can shift load usage by a few hours and even minutes to achieve the resource balance needed during peak hours. BVES expects the additional oncoming load in late 2024 to double this interruptible load to approximately 18 MW in the winter and 0.4 MW in the summer. Additional load balancing can be achieved by way of the planned BESS and solar PV facility to meet peak load requirements, which also provides additional customer benefits. Solar production in the daytime with energy storage solution can provide some capacity constraint relief to the service area, as well.

With respect to RA capacity obligations, the calculation of this obligation begins with BVES providing its previous year's historical annual load shape, year-ahead annual forecast, and BVPP output to the CEC who, in turn, issues to BVES its coincident peak demand level. BVES provided its updated NQC annual requirement issued by the CAISO within the RDT models. Because BVES is a winter-peaking utility and has its summer peaks on holiday weekends, BVES's contribution to the CAISO system monthly coincident peak loads is insignificant because of the BVES system load timing diversity with CAISO. For planning purposes, BVES assumes that its RA procurement obligations are as defined by the CAISO Tariff default provisions, which parallel the CPUC's program for jurisdictional LSEs; therefore, BVES plans for RA requirements equal to the CEC determined monthly coincident forecasted load, including reserves.

III. Study Results

The following describes the modeling results of BVES's planned resource mix and GHG emissions benchmarks.

a. Conforming and Alternative Portfolios

The information below presents the modeled outputs in developing a Conforming Portfolio under the two GHG benchmark scenarios. BVES applied CEC IEPR assumptions that mapped to calculating factors and weights that projects the ability to meet benchmarks by 2035. Planned owned projects will be located in BVES' service territory and, therefore, will not be directly tied to the CAISO electric grid. There are no direct comparisons to the planned buildout within the RSP that can be made from these IRP generating facility initiatives. Under the 25 MMT conforming portfolio scenario, BVES presents a case for rapid, higher capacity, procurement of renewable power supplies. This supply mix portfolio enables the utility to immediately plan for a greater portion of demand to be served by carbon-free resources.

BVES presents a change in the firm RE PPA contracting plans under the 30 MMT portfolio scenario. A reduction of delivery across all three planned RE PPA contracts covering all years represents the consideration of the updated CPUC's reliability-driven case under the 30 MMT portfolio scenario, which will allow LSEs additional time to transform their supply mix to achieve 100 percent of electricity sales from clean resources by 2045. For the purposes of modeling planned capacity and resource mix needs, BVES plans to deploy its solar PV facility at 5 MW as well as storage facility in 2024 providing local benefits at 5 MWs / 20 MWhs four-hour discharge. Estimates for contract life are based on life-of-facility

assessments.¹⁷ Exact contracting details for these projects are still being considered or negotiated. RDTs are based on BVES’s current estimated timeline deployment and are subject to delays due to the current pandemic crisis and other constraints or barriers in executing the contract approvals.

The two projects similarly represented under both portfolio scenarios planned for implementation are identified as:

- BVES-owned approximately 5 MW solar PV facility directly connected to the BVES system; and
- BVES-owned 5 MW four-hour battery facility.

Planned renewable energy procurement will also take shape under firm competitive RE solicitations for contracts that target existing and online CAISO resources that are cost-appropriate consisting of a mix of 24x7 flat delivery. Current plans address three batches of RE firm PPA contracts. BVES plans to reach 100 percent clean energy by 2045 in alignment with state goals, however, anticipates spot market purchases for peak periods upwards of 5 percent through 2035 to mitigate risk exposure in the market. Discussion captured in the IRP narrative for identified initiatives are viewed and agreed to by BVES management and are subject to BVES Board and CPUC approval. The portfolios presented favorably position BVES in achieving its GHG emissions targets under both the 25 MMT and 30 MMT portfolio scenarios. Due to uncertainties with current implementation activities, BVES is not requesting any direct action by the Commission at this time through this 2023 -2035 IRP filing.

Table 6: RPS Resource Custom Profile - 3 Firm RE PPAs

GHG Portfolio Scenario	Annual GWhs in 2024	Annual GWhs in 2026	Annual GWhs in 2030	Annual GWhs in 2035
25 MMT	9	53	114	123
30 MMT	9	53	96	114

The following table and figures present the RDT contract information as well as the forecasted energy supply mix in 2035 as a result of this IRP modeling.

¹⁷ National Renewable Energy Laboratory. "Life Prediction Model for Grid-Connected Li-Ion Battery Energy Storage System," May 26, 2017. <https://www.nrel.gov/docs/fy17osti/67102.pdf>.

Table 7: Conforming Portfolio with Contract and Supply Details in 2035

Conforming Portfolio of Resources and Contracts						25 MMT Portfolio Scenario	30 MMT Portfolio Scenario
Resource Type (RDT) ¹⁸	Project / Resource Name	Existing Contract or Owned Asset	Existing Resource for Planned Future Contract	BVES New Resource Investment	Modeled Annual Total in 2035 (GWGs)	Modeled Annual Total in 2035 (GWGs)	
_New_generic_solar_1_axis	Bear Valley Solar Plant, solar, 5 MW	Planned utility asset	New resource that is indirectly tied to the CAISO-controlled electric grid and thus is characterized as a load modifier directly supplying the distribution system and adding BVES customer benefits	BVES will own and operate the asset	13.24		
_new_generic_battery_storage	BVES Battery Storage Project, Li-Ion or Flow storage, 5 MW / 20 MWh	Planned utility asset	New resource that is indirectly tied to the CAISO-controlled electric grid and thus is characterized as a load modifier directly charging from and dispatching to the BVES distribution system and adding BVES customer benefits	BVES will own and operate the asset	(1.55)		
_existing_generic_unknown	Competitive RE Firm PPA	Not an existing contract, i.e., to be procured	Assumes the resource is already available within the CAISO-controlled electric grid	Energy delivery only (preference given to contracts with a REC product)	52.6	52.6	
_existing_generic_unknown	Competitive RE Firm PPA	Not an existing contract, i.e., to be procured	Assumes the resource is already available within the CAISO-controlled electric grid	Energy delivery only (preference given to contracts with a REC product)	61	43.8	
_existing_generic_unknown	Competitive RE Firm PPA	Not an existing contract, i.e., to be procured	Assumes the resource is already available within the CAISO-controlled electric grid	Energy delivery only (preference given to contracts with a REC product)	9	17.5	
Existing_generic_peaker	BVPP	Existing owned asset	Existing resource not under CAISO control	BVES owns and operates this asset	0.27		
_Unspecified_non_import	Annual Shaped System Energy Contract	Existing contract	Existing unspecified annual shaped system power	Energy delivery only	N/A; Contract expires on October 31, 2024		
_Unspecified_non_import	Shaped base delivery contract of unspecified, unknown mix at a reduction of existing annual contract capacity reservations	To be procured	Assumes the resource will already be available within the CAISO-controlled electric grid	Energy delivery only	N/A; Contract expires on October 31, 2027		

¹⁸ Resource list in this table includes existing contracts but does not profile expired contracts.

Conforming Portfolio of Resources and Contracts

					25 MMT Portfolio Scenario	30 MMT Portfolio Scenario
Resource Type (RDT) ¹⁸	Project / Resource Name	Existing Contract or Owned Asset	Existing Resource for Planned Future Contract	BVES New Resource Investment	Modeled Annual Total in 2035 (GWGs)	Modeled Annual Total in 2035 (GWGs)
Unspecified non-import	Shaped base delivery contract of unspecified, unknown mix at a reduction of existing annual contract capacity reservations	To be procured	Assumes the resource will already be available within the CAISO-controlled electric grid	Energy delivery only	49	
Unspecified non-import	Seasonal firm energy delivery contract of unspecified, unknown mix at a reduction of existing annual contract capacity reservations	To be procured	Assumes the resource will already be available within the CAISO-controlled electric grid	Energy delivery only	23	
Sellers choice	2023 RA Capacity Contract for remaining system RA obligations	To be procured	Assumes resource will already be available for future capacity contracting with no locational preference	Generic System RA capacity contract	No energy delivered	
Sellers choice	2024 System RA Capacity Contract	To be procured	Assumes resource will already be available for future capacity contracting with no locational preference	Generic System RA capacity contract	No energy delivered	
Sellers choice	2025 System RA Capacity Contract	To be procured	Assumes resource will already be available for future capacity contracting with no locational preference	Generic System RA capacity contract	No energy delivered	
Sellers choice	2026 System RA Capacity Contract	To be procured	Assumes resource will already be available for future capacity contracting with no locational preference	Generic System RA capacity contract	No energy delivered	
Sellers choice	2027 System RA Capacity Contract	To be procured	Assumes resource will already be available for future capacity contracting with no locational preference	Generic System RA capacity contract	No energy delivered	
Sellers choice	2028 System RA Capacity Contract	To be procured	Assumes resource will already be available for future capacity contracting with no locational preference	Generic System RA capacity contract	No energy delivered	
Sellers choice	2029 System RA Capacity Contract	To be procured	Assumes resource will already be available for future capacity contracting with no locational preference	Generic System RA capacity contract	No energy delivered	
Sellers choice	2030 System RA Capacity Contract	To be procured	Assumes resource will already be available for future capacity contracting with no locational preference	Generic System RA capacity contract	No energy delivered	
Sellers choice	2031 System RA Capacity Contract	To be procured	Assumes resource will already be available for future capacity contracting with no locational preference	Generic System RA capacity contract	No energy delivered	

Conforming Portfolio of Resources and Contracts

					25 MMT Portfolio Scenario	30 MMT Portfolio Scenario
Resource Type (RDT) ¹⁸	Project / Resource Name	Existing Contract or Owned Asset	Existing Resource for Planned Future Contract	BVES New Resource Investment	Modeled Annual Total in 2035 (GWhs)	Modeled Annual Total in 2035 (GWhs)
Sellers _choice	2032 System RA Capacity Contract	To be procured	Assumes resource will already be available for future capacity contracting with no locational preference	Generic System RA capacity contract	No energy delivered	
Sellers _choice	2033 System RA Capacity Contract	To be procured	Assumes resource will already be available for future capacity contracting with no locational preference	Generic System RA capacity contract	No energy delivered	
Sellers _choice	2034 System RA Capacity Contract	To be procured	Assumes resource will already be available for future capacity contracting with no locational preference	Generic System RA capacity contract	No energy delivered	
Sellers _choice	2035 System RA Capacity Contract	To be procured	Assumes resource will already be available for future capacity contracting with no locational preference	Generic System RA capacity contract	No energy delivered	
Existing_ge neric_dr	Local demand response program to curtail commercial load	Existing	Bear Valley Electric Service, Inc., local demand response program to curtail commercial load, Tariff agreement structure	Energy delivery only	26	

Figure 4: Forecast Supply Mix in 2035 - 25 MMT Scenario

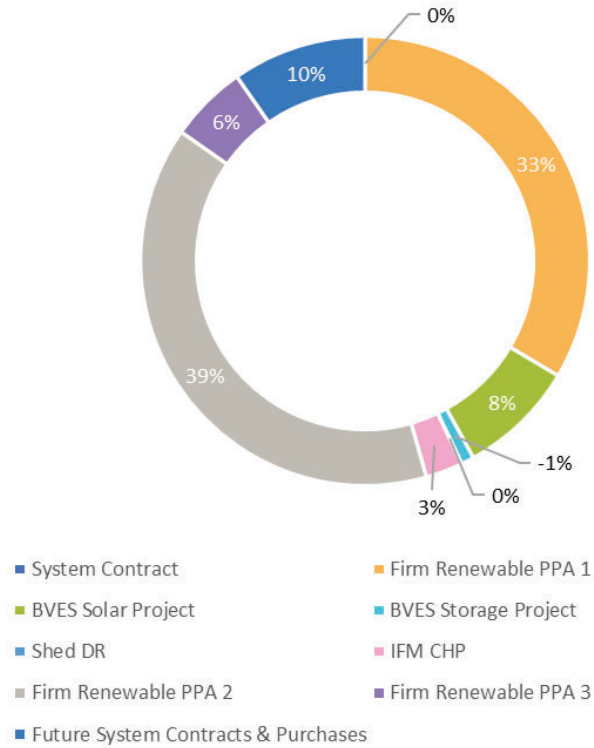


Figure 5: Forecast Supply Mix in 2035 - 30 MMT Scenario

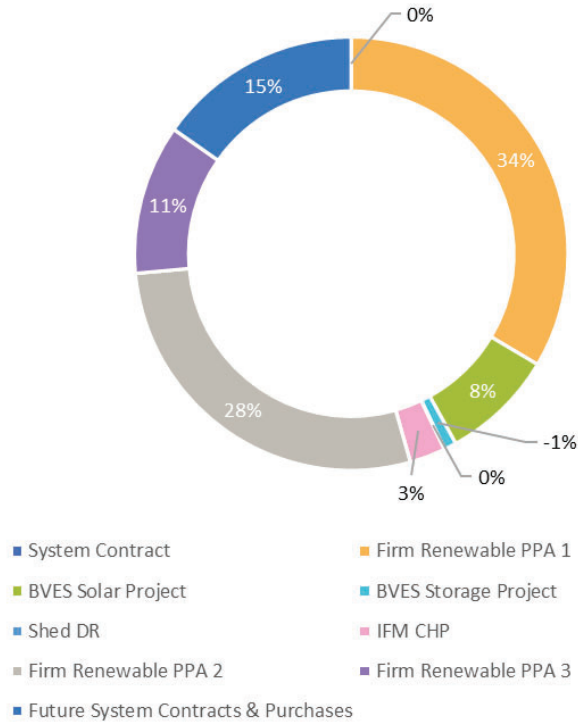


Table 8: BVES Portfolio Scenarios 2023-2035

Portfolio Scenario for 2023 - 2035	Assumptions	BVES 2030 Load Forecast (GWh)	BVES 2035 Load Forecast (GWh)	Assigned 2030 Emissions Benchmark (MMT)	Assigned 2035 Emissions Benchmark (MMT)	IRP GHG Emissions Results 2030 (CO ₂ MMT)	IRP GHG Emissions Results 2035 (CO ₂ MMT)
Conforming Scenario (a)	<ul style="list-style-type: none"> Benchmarked against 25 MMT GHG threshold CEC IEPR load modifiers CEC IEPR demand side modifiers Resource generation output using CPUC capacity factors Modified 40 percent commercial and industrial (C&I) load through 2035 	138.82	142.42	0.01447	0.01168	0.01154	0.01068
Conforming Scenario (b)	<ul style="list-style-type: none"> Benchmarked against 30 MMT GHG threshold CEC IEPR load modifiers CEC IEPR demand side modifiers Resource generation output using CPUC capacity factors Modified 40 percent commercial and industrial (C&I) load through 2035 	138.82	142.42	0.01915	0.01462	0.01819	0.01402

BVES calculated the results of both the 25 MMT and 30 MMT scenario models using the assigned load forecast and load modifiers derived from the 2021 CEC IEPR. Selected options include the modifications made to the C&I growth profile under the demand inputs and RPS-eligible custom hourly profile for the three planned RE firm PPA contracts for the submitted Conforming Portfolios. The CSP calculator’s modeled carbon emissions intensity measurements align CAISO system power (as represented by BVES unspecified firm energy contracts and day ahead market purchases) to the carbon intensity of natural gas dispatch. Additionally, BVES understands that the Commission ruled to restrict incorporation of PCC 2 and PCC 3 REC contracts into the CSP calculator for GHG emissions benchmark comparisons as stipulated in the model’s instructions and guidance documents. BVES does not own any CAISO controlled generating facilities or contracts. As a result of the modeling exercise, BVES’s power resource

forecast positions the utility along an appropriate pathway to achieve its GHG emissions benchmark thresholds for both Conforming Portfolio Scenarios.

In June 2012, BVES issued an RFP for RECs that sought pre-2011 volumes in addition to its then-current and future compliance period needs. After identifying a successful bidder, BVES began negotiations for a long-term contract for unbundled RECs. In February 2013, the filed Advice Letter 277-E proposed a ten-year RPS agreement for the purchase of RECs from Iberdrola Renewables, LLC (now called Avangrid Renewables, LLC, or Avangrid). CPUC Resolution E-4604, issued in July 2013, approved the ten-year contract. The volumes in the ten-year REC contract were originally forecasted to fulfill all of BVES's RPS obligations through 2022. The updated retail sales forecast now projects full RPS compliance through 2021-2022 with the use of PCC 3s. Understanding the movement away from contracting with long-term PCC 3 contracts, BVES will update its RPS program annual submission in 2023 to account for the targeted PPA bundled products as well as generation output from its future solar PV plant. BVES is still on target to meet its Compliance Period 4 goals of 44 percent in 2024 with the use of these additional bundled PCC 1 RECs planned with the firm PPAs.

Such that the solar PV facility moves forward in finalizing authorization to operate in 2024, BVES will be able to meet REC obligations starting late 2024 and early 2025 with option RECs to meet the difference if the awarded competitive firm RE PPA does not materialize in time for REC retirements. BVES has not secured agreements to fulfill compliance obligations for the 2024-2030 timeframe, however, this IRP strategy will influence future RPS planning to connect requirements and enable BVES to achieve both GHG reduction targets and meet RPS compliance period goals. BVES demonstrates assurance in meeting California RPS goals in each future compliance period through its former strategy in securing unbundled PCC 3 REC contracts and will shift to secure bundled generation and REC product contracts starting in 2024.

The energy balance results from the CSP calculator present a downward trend in reliance on system power by 2035 as shown in both figures below. With the inclusion of the battery facility, increased shed demand response, and the installation of the solar facility (only projected in 2035 per modeling limits), BVES can meet additional gaps by procuring firm renewable PPA contracts and shortfall market purchases in addition to reducing the need for long-term unspecified generation mix power contracts.

Table 9: Energy Balance Results - 25 MMT Conforming Portfolio

Supply Summary	Unit	2024	2026	2030	2035
Large Hydro	GWh	-	-	-	-
Imported Hydro	GWh	-	-	-	-
Asset Controlling Supplier	GWh	-	-	-	-
Nuclear	GWh	-	-	-	-
Biogas	GWh	-	-	-	-
Biomass	GWh	-	-	-	-
Geothermal	GWh	-	-	-	-
Small Hydro	GWh	-	-	-	-
Wind CAISO	GWh	-	-	-	-
Wind Out Of State	GWh	-	-	-	-
Wind Offshore	GWh	-	-	-	-
Solar Utility Scale	GWh	-	13	13	13
Solar Distributed	GWh	-	-	-	-
Hybrid or Paired Solar and Battery	GWh	-	-	-	-
Shed DR	GWh	0.0	0.0	0.0	0.0
Pumped Storage	GWh	-	-	-	-
Battery Storage	GWh	-	(1)	(2)	(1)
Storage Resource Custom Profile	GWh	-	-	-	-
RPS Resource Custom Profile	GWh	9	53	114	123
GHG-free non-RPS Resource Custom Profile	GWh	-	-	-	-
Coal	GWh	-	-	-	-
IFM CHP	GWh	7	7	7	4

Supply Demand Balance Summary	Unit	2024	2026	2030	2035
<i>LSE Supply, before curtailment and exports</i>	GWh	16	72	133	139
<i>Net Purchases, before curtailment and exports</i>	GWh	127	73	17	15
Curtailment	GWh	-	-	(1)	(2)
Exports	GWh	-	(0)	(2)	(3)
Zero Emissions Power From System	GWh	5	2	1	1
Net System Power (incurs emissions)	GWh	122	72	19	20

Table 10: Energy Balance Results - 30 MMT Conforming Portfolio

Supply Summary	Unit	2024	2026	2030	2035
Large Hydro	GWh	-	-	-	-
Imported Hydro	GWh	-	-	-	-
Asset Controlling Supplier	GWh	-	-	-	-
Nuclear	GWh	-	-	-	-
Biogas	GWh	-	-	-	-
Biomass	GWh	-	-	-	-
Geothermal	GWh	-	-	-	-
Small Hydro	GWh	-	-	-	-
Wind CAISO	GWh	-	-	-	-
Wind Out Of State	GWh	-	-	-	-
Wind Offshore	GWh	-	-	-	-
Solar Utility Scale	GWh	-	13	13	13
Solar Distributed	GWh	-	-	-	-
Hybrid or Paired Solar and Battery	GWh	-	-	-	-
Shed DR	GWh	0.0	0.0	0.0	0.0
Pumped Storage	GWh	-	-	-	-
Battery Storage	GWh	-	(1)	(1)	(1)
Storage Resource Custom Profile	GWh	-	-	-	-
RPS Resource Custom Profile	GWh	9	53	96	114
GHG-free non-RPS Resource Custom Profile	GWh	-	-	-	-
Coal	GWh	-	-	-	-
IFM CHP	GWh	7	7	7	4

Supply Demand Balance Summary	Unit	2024	2026	2030	2035
LSE Supply, before curtailment and exports	GWh	16	72	116	130
Net Purchases, before curtailment and exports	GWh	127	73	34	24
Curtailment	GWh	-	-	(1)	(2)
Exports	GWh	-	(0)	(1)	(3)
Zero Emissions Power From System	GWh	5	1	1	0
Net System Power (incurs emissions)	GWh	121	72	35	28

BVES presents its Conforming Portfolio results in benchmarking future supply GHG emissions to the proportional share attributed to electricity delivery to its service area for both the 25 MMT and 30 MMT benchmark threshold scenarios. BVES did not develop an Alternative Portfolio or apply any optional deviations from the Conforming Portfolio. Additionally, the models utilize all 2021 IEPR, RESOLVE, and CPUC-assigned assumptions and calibrations for resource attributes such as carbon intensity measurements, capacity and generating factors, and seasonal impacts to intermittent resources.

Table 11 and Table 12 present the CO₂ MMT/year results under the 25 MMT and 30 MMT Conforming Portfolios.

Table 11: BVES 25 MMT Conforming Scenario Carbon Dioxide Emissions Forecast

CO₂	Unit	2024	2026	2030	2035	Notes
Coal	MMt/yr	-	-	-	-	Included in GHG emissions total
CHP	MMt/yr	0.0032	0.0032	0.0031	0.0019	
Biogas	MMt/yr	-	-	-	-	
Biomass	MMt/yr	-	-	-	-	

CO ₂	Unit	2024	2026	2030	2035	Notes
System Power	MMt/yr	0.0519	0.0303	0.0085	0.0088	Includes emissions from in-CAISO dispatchable gas and unspecified imports
Asset Controlling Supplier	MMt/yr	-	-	-	-	
Total	MMt/yr	0.0551	0.0335	0.0115	0.0107	Includes both in-CAISO and import emissions
Average emissions intensity	tCO ₂ /MWh	0.4160	0.2491	0.0831	0.0750	Emissions per MWh of sales
Oversupply Emissions Credits	MMt/yr	-	-	0.0003	0.0004	When hourly supply exceeds hourly load and system power is on the margin, LSE receives credit at the system power emissions rate. Impact included in Total.

Table 12: BVES 30 MMT Conforming Scenario Carbon Dioxide Emissions Forecast

CO ₂	Unit	2024	2026	2030	2035	Notes
Coal	MMt/yr	-	-	-	-	Included in GHG emissions total
CHP	MMt/yr	0.0033	0.0033	0.0032	0.0019	
Biogas	MMt/yr	-	-	-	-	
Biomass	MMt/yr	-	-	-	-	
System Power	MMt/yr	0.0516	0.0301	0.0150	0.0121	Includes emissions from in-CAISO dispatchable gas and unspecified imports
Asset Controlling Supplier	MMt/yr	-	-	-	-	
Total	MMt/yr	0.0548	0.0334	0.0182	0.0140	Includes both in-CAISO and import emissions
Average emissions intensity	tCO ₂ /MWh	0.4140	0.2483	0.1310	0.0984	Emissions per MWh of sales
Oversupply Emissions Credits	MMt/yr	-	-	0.0000	0.0003	When hourly supply exceeds hourly load and system power is on the margin, LSE receives credit at the system power emissions rate. Impact included in Total.

b. Preferred Conforming Portfolios

In this 2023-2035 planning horizon IRP, BVES selected both Conforming Portfolios discussed above as the Preferred Conforming Portfolios for the 25 MMT and 30 MMT benchmark threshold scenarios. Please see Table 7 above for the listing.

The CPUC has demonstrated through its modeling methodology that LSEs are to move away from reliance on unspecified system power and replace with renewable LSE-owned or contracted power resources. BVES applied a thoughtful approach in capturing the distinct objectives presented under both

Conforming Portfolio scenarios. In both cases, the utility illustrates the ability to move toward achieving state objectives in GHG emissions reduction and established, by way of this IRP, a framework and roadmap for meeting 2035 targets.

BVES initially prefers the portfolio scenario under the 30 MMT reliability case as the utility faces unique constraints in deploying clean energy facilities within its service area. Compounded by the fact that BVES's system ties into SCE's distribution system, BVES understands that cost impact may be high for its customers when replacing system power contracts with renewable firm PPAs at the rate presented in the 25 MMT portfolio scenario. For this, cost estimates align with the GRC methodology with an inflation adder to account for planned revenue requirement (RR) by 2035. BVES modeled its cost analysis using its current GRC application for the 2023 Test Year. BVES will make every effort to seek cost-competitive renewable energy PPAs that maintain a parallel cost impact estimate with the RR forecast displayed in this IRP as possible. Modeling inputs assume that the applicable units to be solicited for available capacity are: (1) currently online; (2) able to provide delivery at the identified hours of demand for offloading system power supply; and (3) are located within the CAISO-controlled grid. Out-of-state contracts or a need for a new resource build are not directly modeled but are considered a risk factor in the roadmap to transition to 100 percent electric retail sales coming from clean energy resources. This IRP describes the Preferred Conforming Portfolios consistent with the relevant statutory and administrative requirements (Public Utilities Code (PUC) Section 454.52(a)(1)).

To meet the statutory requirements, this IRP demonstrates that the portfolios meet the GHG reduction targets established by the California Air Resources Board in coordination with the CEC and highlights BVES's supply-side planning indicating that BVES is poised to procure at least 60 percent RE resources by December 31, 2030. Additionally, BVES understands it must fulfill its obligation to its customers to present just and reasonable rates and minimize rate impacts. This discussion is presented later within this section. BVES also accounts for system and local reliability both in the near-term and long-term, wherever possible, and selected a supply model that does not weaken the resilience of the transmission grid while maintaining its remote location to the CAISO. BVES plans to build two utility-scale projects that will enhance its distribution system reliability and demand-side energy management while minimizing localizing air pollutants and other GHGs. Under this rationale, BVES meets the requirements set forth in PUB Section 454.52(a)(1).

As presented above, BVES's 25 MMT benchmark is slightly lower than the threshold assignment primarily due to the limitations of the CSP modeling ability, which requires whole number inputs for planned capacity. The arranged PPAs will also be structured in rounded MW units rather than proportion of energy supply, which will also account for any spot market purchase that BVES may have to leverage. The 7x24 block design will have a minimal impact on transmission capability largely due to the size of the contracts and BVES size. Lastly, BVES does not model any resources within its preferred conforming portfolios that include new natural gas units.

c. GHG Emissions Results

The result of BVES GHG emissions benchmark for two Conforming Portfolios are shown in the tables below. Based on the results from CSP calculator, the CO₂ GHG emission results are 0.01154 MMT for 2030 and 0.01068 MMT in 2035 based on the 25 MMT portfolio scenario. The benchmarks assigned to BVES for 2030 and 2035 are 0.0145 MMT and 0.0117 MMT, respectively. In the 30 MMT CO₂ GHG reduction scenario, BVES achieved GHG emissions results of 0.01819 MMT in 2030 and 0.01402 MMT in

2035. The benchmarks assigned to BVES under this scenario for these years are 0.1915 MMT and 0.0146 MMT, respectively.

BVES included a custom hourly load shape in the CSP calculator for both scenarios assuming 100 percent guaranteed delivery despite the capacity factors of solar and wind mixed resources. Contingent on the analysis of the current contract(s) in negotiation, BVES finds it achievable to shape profiles with firm RE PPAs for its particular size based on current market availability.

Table 13: BVES 25 MMT GHG Results Based on Clean System Power Calculator

<i>Emissions Total</i>	<i>Unit</i>	2024	2026	2030	2035	<i>Notes</i>
CO2	MMt/yr	0.0551	0.0335	0.0115	0.0107	Includes both in-CAISO and import emissions
PM2.5	tonnes/yr	2.0372	1.2912	0.4919	0.4246	Only In-CAISO emissions
SO2	tonnes/yr	0.1932	0.1233	0.0483	0.0411	Only In-CAISO emissions
NOx	tonnes/yr	2.9629	2.1061	1.1965	0.8338	Only In-CAISO emissions

Table 14: BVES 30 MMT GHG Results Based on Clean System Power Calculator

<i>Emissions Total</i>	<i>Unit</i>	2024	2026	2030	2035	<i>Notes</i>
CO2	MMt/yr	0.0548	0.0334	0.0182	0.0140	Includes both in-CAISO and import emissions
PM2.5	tonnes/yr	2.0219	1.3872	0.7947	0.6542	Only In-CAISO emissions
SO2	tonnes/yr	0.1920	0.1324	0.0766	0.0626	Only In-CAISO emissions
NOx	tonnes/yr	2.9683	2.2055	1.5594	1.0911	Only In-CAISO emissions

The CSP calculator models for both 25 MMT GHG and 30 MMT GHG opt not to present seasonality mixtures or time-of-day dispatch units. BVES did include a shaped hourly profile for RPS-eligible PPAs for its plan RE firm contracts beginning in 2024. This determination is based on 100 percent of delivery of the blended resource of predominately solar and wind. This due diligence in available units has been part of BVES’s investigation into contracting for this first PPA in the next year. The contract is still under negotiations.

The results of GHG emissions in both portfolios are favorable in meeting the Commission’s benchmark limits, BVES anticipates meeting this benchmark (for both 25MMT and 30MMT portfolios) that the 2030 and 2035 emissions target years will remain at or below the target values as strategic planning efforts enable more deployment of DER resources and procurement of renewable firm PPA contracts when existing system power contracts are poised to expire. BVES understands that the CSP modeling inputs present a conservative, GHG policy-driven calibration of carbon emissions related to system power.

As system power mix varies during different periods of the day, seasons, and peak scenarios, internal GHG forecasts for BVES consider the unspecified system power contracts aligning with more appropriate dispatch schedules based on the contract details. For example, when renewable intermittent resources are typically generating, the CAISO system supply dashboard can display from 25 - 50 percent of system power, including CAISO mix resources and imports, is from renewable resources including wind and

solar.¹⁹ Additionally, CAISO and imported power carbon emissions per MWh of production is anticipated to continue declining from 2020 to 2030 due to tax incentives policy, reduced cost of solar panels, and California RPS goals. This will lead to even more penetration of renewable resources including solar and wind generation at the CAISO system level and the continued growth in customer-based DG adoption. Other states in the Western Electricity Coordinating Council regions will share in this trend. These changes lead to a reduction in the annual carbon emissions for imported power serving BVES's service area.

In aligning with the Commission's approach, and to comply with the requirements from the IRP process to depict these conservative emissions intensity calculations, BVES conducted an evaluation of a new procurement strategy to rapidly contract with existing CAISO generators for eligible renewable power and move away from the previous approach. Aside from the BVES-owned generation assets being considered, any increase in GHG-related costs will be passed onto BVES via its wholesale energy purchases as demonstrated by the results of the CSP calculator models for both 25 MMT and 30 MMT benchmark thresholds. BVES understands the critical need to reduce its reliance on system power by procuring renewable PPAs and investing in eligible renewable generators. The costs of GHG and state emissions reduction requirements will be compared via the competitive bidding process that BVES undergoes when acquiring resources and entering into future agreements with energy providers. BVES anticipates this situation will continue in future RFP processes.

BVES's resource supply portfolio in the RDT supports the movement toward meeting goals for reduced GHG emissions. In future planning cycles, BVES intends to use a larger share of solar and wind supply within the CAISO balancing area in the resource portfolio over the next ten years by pursuing cost favorable, RE firm PPAs and battery technologies. BVES will be using more transmitted supply to hedge contracts, which will have less carbon emissions per MWh due to more solar penetration in the CAISO market, though it is not modeled in the emissions calculations provided for this IRP study. Further, BVES expects to have a significant amount of load displaced by EE and customer solar generation.

With a ten-year contract for RECs expiring, BVES anticipates satisfying its obligations under California's RPS program through bundled firm RE PPAs along with generation from its solar facility. The current PCC3 REC contract, approved by the Commission in July 2013, provides the flexibility needed to manage the current RPS requirements that ramp up to 60 percent by 2030.²⁰ BVES understands that the nature of the RPS program and IRP misalign with the restrictions of PCC2 and PCC3 RECs within the GHG reduction model. BVES has worked to change its prior power supply strategy to account for these restrictions and now aims to procure bundled PCC1 REC products with generation. The rest of the RPS requirement will materialize upon deployment of the BVES solar facility, which is expected to generate approximately 13.24 GWhs annually and a new REC contract either by way of planned renewable energy PPAs or as a separate solicitation if unavailable at the time of bid awarding. This project is expected to have a 25-year life, and the MWh of generation is expected to qualify as local renewable energy meeting the RPS. BVES will evaluate the additional RECs required after the solar project is approved and will base the decision for modification to the plan contracting capacity for renewable PPAs in a subsequent IRP.

¹⁹ <http://www.caiso.com/TodaysOutlook/Pages/supply.aspx>

²⁰ SB 100 was signed by Governor Brown in 2018 and, among other changes, accelerates eligible-renewable electricity sales targets to achieve 60 percent by 2030 and 100 percent by 2045.

d. Local Air Pollutant Minimization and Disadvantaged Communities

i. Local Air Pollutants

BVES presents the results of local air pollutants that may directly impact those in and surrounding its service area. Because BVES plans for PPAs, firm and shaped energy contracts, and wholesale market purchases, system power emissions reflect the majority of GHG accountability for the utility. Within the Action Plan of this IRP, BVES outlines its strategy for securing affordable, reliable energy contracts, which are informed by ongoing investigations into locally sited and utility-owned DERs.

BVES has updated this IRP to reinforce its commitment to minimizing local air pollutants that extend beyond the immediate service territory. For example, BVES has incorporated timeline planning to better reflect the implementation of applicable California Environmental Quality Act (CEQA) requirements within its resource planning strategy to achieve 100 percent retail sales from low-carbon or carbon-free resources as it continues to plan anticipated solar and storage plants. BVES also reviewed internally to better understand the larger regional impact of emitting sulfur dioxide (SO₂), nitrogen oxide (NO_x), and particulate matter (PM_{2.5} and PM₁₀), noting their potential to cause both immediate and prolonged respiratory and health issues.²¹

As part of concurrent community engagement efforts, BVES plans to enhance its awareness and education initiatives by integrating health-focused information in outreach activities to disseminate actionable tips on minimizing exposure to air pollutants, which are of significant concern during the fire season. Recognizing the limited influence BVES can exert beyond its service territory, the utility is committed to empowering local communities with knowledge and strategies to protect their health against air pollution.

BVES views its IRP framework as a structured approach with achievable targets, serving as a roadmap for meeting carbon reduction goals. The shift in carbon accounting practices at BVES moved strategies from previous emissions intensity, which were based on the carbon emissions intensity across SCE's service territory, to a methodology that accounts for emissions factors assigned to the load serving entities with contracted system power supply, as supported by CPUC-driven models and assumptions. As a result, the 2020 IRP development led to a new procurement strategy identifying the preferred portfolio aimed at providing a reliable, best-fit, low-carbon resource mix that is well-diversified and consistent with CPUC regulations and state laws governing resource planning, resource adequacy, renewable portfolio standards, and GHG emissions benchmarks. This strategic approach highlights BVES's dedication to reducing GHG emissions.

BVES recognizes that emissions from its operations are not bound by geography and can impact broader regions, including disadvantaged communities. This acknowledgment is integrated into the planning efforts, with BVES committed to ensuring its Preferred Conforming Portfolios adhere to stringent emissions benchmarks, thus minimizing future emissions. This approach embodies BVES's commitment to minimize the environmental and community impacts of its energy procurement processes. By broadening the scope of its communication to include health information related to air quality, BVES

²¹ World Health Organization. "Air quality, Energy and Health," <https://www.who.int/teams/environment-climate-change-and-health/air-quality-and-health/health-impacts/types-of-pollutants>.

aims to ensure that residents are better informed to take preventive actions, for disadvantaged populations where the risks may be more pronounced.

Under the Preferred Conforming Scenario using 25 MMT GHG benchmark thresholds, the figure below presents the particulate matter (PM2.5), SO₂, and NO_x results from the CSP calculator.

Figure 6: BVES Conforming Portfolio GHG Local Emissions Results: 25 MMT Benchmark

CO ₂	Unit	2024	2026	2030	2035	Notes
Coal	MMt/yr	-	-	-	-	Included in GHG emissions total
CHP	MMt/yr	0.0032	0.0032	0.0031	0.0019	
Biogas	MMt/yr	-	-	-	-	
Biomass	MMt/yr	-	-	-	-	
System Power	MMt/yr	0.0519	0.0303	0.0085	0.0088	Includes emissions from in-CAISO dispatchable gas and unspecified imports
Asset Controlling Supplier	MMt/yr	-	-	-	-	
Total	MMt/yr	0.0551	0.0335	0.0115	0.0107	Includes both in-CAISO and import emissions
Average emissions intensity	tCO ₂ /MWh	0.4160	0.2491	0.0831	0.0750	Emissions per MWh of sales
Oversupply Emissions Credits	MMt/yr	-	-	0.0003	0.0004	When hourly supply exceeds hourly load and system power is on the margin, LSE receives credit at the system power emissions rate. Impact included in Total.

PM2.5	Unit	2024	2026	2030	2035	Notes
Coal	tonnes/yr	-	-	-	-	Information only, not included in total
CHP	tonnes/yr	0.1801	0.1775	0.1730	0.1038	
Biogas	tonnes/yr	-	-	-	-	
Biomass	tonnes/yr	-	-	-	-	
System Power	tonnes/yr	1.8571	1.1138	0.3189	0.3208	In-CAISO emissions only - unspecified import emissions excluded
Total	tonnes/yr	2.0372	1.2912	0.4919	0.4246	
Average emissions intensity	kg/MWh	0.0154	0.0096	0.0035	0.0030	Emissions per MWh of sales

SO ₂	Unit	2024	2026	2030	2035	Notes
Coal	tonnes/yr	-	-	-	-	Information only, not included in total
CHP	tonnes/yr	0.0192	0.0189	0.0184	0.0110	
Biogas	tonnes/yr	-	-	-	-	
Biomass	tonnes/yr	-	-	-	-	
System Power	tonnes/yr	0.1740	0.1044	0.0299	0.0300	In-CAISO emissions only - unspecified import emissions excluded
Total	tonnes/yr	0.1932	0.1233	0.0483	0.0411	
Average emissions intensity	kg/MWh	0.0015	0.0009	0.0003	0.0003	Emissions per MWh of sales

NO _x	Unit	2024	2026	2030	2035	Notes
Coal	tonnes/yr	-	-	-	-	Information only, not included in total
CHP	tonnes/yr	0.8389	0.8205	0.7870	0.4099	
Biogas	tonnes/yr	-	-	-	-	
Biomass	tonnes/yr	-	-	-	-	
System Power	tonnes/yr	2.1240	1.2856	0.4096	0.4238	In-CAISO emissions only - unspecified import emissions excluded
Total	tonnes/yr	2.9629	2.1061	1.1965	0.8338	
Average emissions intensity	kg/MWh	0.0224	0.0157	0.0086	0.0059	Emissions per MWh of sales

Under the Preferred Conforming Scenario using 30 MMT GHG benchmark thresholds, the figure below presents the PM2.5, SO₂, and NO_x results from the CSP calculator.

Figure 7: BVES Conforming Portfolio GHG Local Emissions Results: 30 MMT Benchmark

CO ₂	Unit	2024	2026	2030	2035	Notes
Coal	MMt/yr	-	-	-	-	Included in GHG emissions total
CHP	MMt/yr	0.0033	0.0033	0.0032	0.0019	
Biogas	MMt/yr	-	-	-	-	
Biomass	MMt/yr	-	-	-	-	
System Power	MMt/yr	0.0516	0.0301	0.0150	0.0121	Includes emissions from in-CAISO
Asset Controlling Supplier	MMt/yr	-	-	-	-	
Total	MMt/yr	0.0548	0.0334	0.0182	0.0140	Includes both in-CAISO and import
Average emissions intensity	tCO ₂ /MWh	0.4140	0.2483	0.1310	0.0984	Emissions per MWh of sales
Oversupply Emissions Credits	MMt/yr	-	-	0.0000	0.0003	When hourly supply exceeds hourly load

PM2.5	Unit	2024	2026	2030	2035	Notes
Coal	tonnes/yr	-	-	-	-	Information only, not included in total
CHP	tonnes/yr	0.1803	0.1789	0.1768	0.1060	
Biogas	tonnes/yr	-	-	-	-	
Biomass	tonnes/yr	-	-	-	-	
System Power	tonnes/yr	1.8417	1.2083	0.6179	0.5482	In-CAISO emissions only - unspecified
Total	tonnes/yr	2.0219	1.3872	0.7947	0.6542	Only In-CAISO emissions
Average emissions intensity	kg/MWh	0.0153	0.0103	0.0057	0.0046	Emissions per MWh of sales

SO ₂	Unit	2024	2026	2030	2035	Notes
Coal	tonnes/yr	-	-	-	-	Information only, not included in total
CHP	tonnes/yr	0.0192	0.0190	0.0188	0.0113	
Biogas	tonnes/yr	-	-	-	-	
Biomass	tonnes/yr	-	-	-	-	
System Power	tonnes/yr	0.1728	0.1134	0.0578	0.0513	In-CAISO emissions only - unspecified
Total	tonnes/yr	0.1920	0.1324	0.0766	0.0626	Only In-CAISO emissions
Average emissions intensity	kg/MWh	0.0014	0.0010	0.0006	0.0004	Emissions per MWh of sales

NO _x	Unit	2024	2026	2030	2035	Notes
Coal	tonnes/yr	-	-	-	-	Information only, not included in total
CHP	tonnes/yr	0.8411	0.8309	0.8125	0.4220	
Biogas	tonnes/yr	-	-	-	-	
Biomass	tonnes/yr	-	-	-	-	
System Power	tonnes/yr	2.1272	1.3746	0.7469	0.6691	In-CAISO emissions only - unspecified
Total	tonnes/yr	2.9683	2.2055	1.5594	1.0911	Only In-CAISO emissions
Average emissions intensity	kg/MWh	0.0224	0.0164	0.0112	0.0077	Emissions per MWh of sales

ii. Focus on Disadvantaged Communities

BVES utilized the most recent California Communities Environmental CalEnviroScreen tool Health Screening Tool (CalEnviroScreen 4.0) to determine whether any disadvantaged communities fall within the utility service territory for the November 2022 filing. The modified 2022 IRP²² presents an updated discussion reviewing the determination of the state of disadvantaged communities as defined by

²² Refined to R. 20-05-003 as a Tier 2 Advice Letter on May 1, 2024.

CalEPA's CalEnviroScreen tool as well as an additional visual representation.²³ These communities include any community scoring in the top 25 percent statewide, any community in one of the 22 census tracts within the top five percent of communities with the highest pollution burden that do not have an overall score, any lands under control of federally recognized Tribes, or any of the 307 census identified in the 2017 Disadvantaged Communities designation by CalEPA²⁴. Table 15 reports the status CalEnviroScreen4.0 scores for those census tracts within BVES's service territory which consists of Big Bear Lake, Big Bear City, and Fawnskin.²⁵

BVES has prior awareness into the identification of disadvantaged populations, access and functional needs groups, medical baseline customers, and predominate languages spoken within the service area as exemplified with the development and updates of its annual Wildfire Mitigation Plans. Pursuant to R. 18-10-007 D. 20-03-004 issued on March 18, 2020, BVES surveyed its territory and customer base to understand differing populations in an effort to promote community awareness, public outreach, and support before, during, and after a wildfire.²⁶ BVES continues with quarterly engagement meetings, files a quarterly access and functional needs report, and routinely reviews any new self-identifications across its customer base.

The utility annually reviews its customer base for any new self-identifications under these major customer classification designations. Similarly, these efforts consistently reinforce that no communities within the service territory meet the designation of indigenous or tribal communities, as well.

As discussed, BVES reaffirms that no identified disadvantaged communities exist within its service territory under the CalEPA's designation. BVES did not incorporate direct feedback from DACs or vested stakeholder groups in developing its 2022 IRP update, however, has provided updates on changes and plans for its solar and storage projects for public comment. BVES plans to carry out targeted stakeholder workshops for the next IRP update.

The map below represents the CalEPA census track at the time of this update.


²³ California EPA. "Final Designation of Disadvantaged Communities Pursuant to Senate Bill 535." May 2022. https://calepa.ca.gov/wp-content/uploads/sites/6/2022/05/Updated-Disadvantaged-Communities-Designation-DAC-May-2022-Eng.a.hp_-1.pdf#:~:text=In%20this%20designation%2C%20CalEPA%20generally%20defines%20communities%20in,areas%20under%20the%20control%20of%20federally%20recognized%20Tribes.2

²⁴ See https://calepa.ca.gov/wp-content/uploads/sites/6/2021/10/2021_CalEPA_Prelim_DAC_1018_English_a.pdf?emrc=2970f7#:~:text=In%20the%20most%20recent%20designation%2C%20in%202017%2C%20CalEPA,but%20did%20not%20have%20an%20overall%20CalEnviroScreen%20score.

²⁵ Fawnskin is located in census track 6071011300.

²⁶ BVES. "Wildfire Mitigation Plan 2020 Revision Refile." pg. 212. https://www.bvesinc.com/assets/migrated/managed/bveswmp/BVES_2020_WMP_REVISION_20200226_Clean.pdf.

Figure 8: DACs Outside of BVES Service Territory

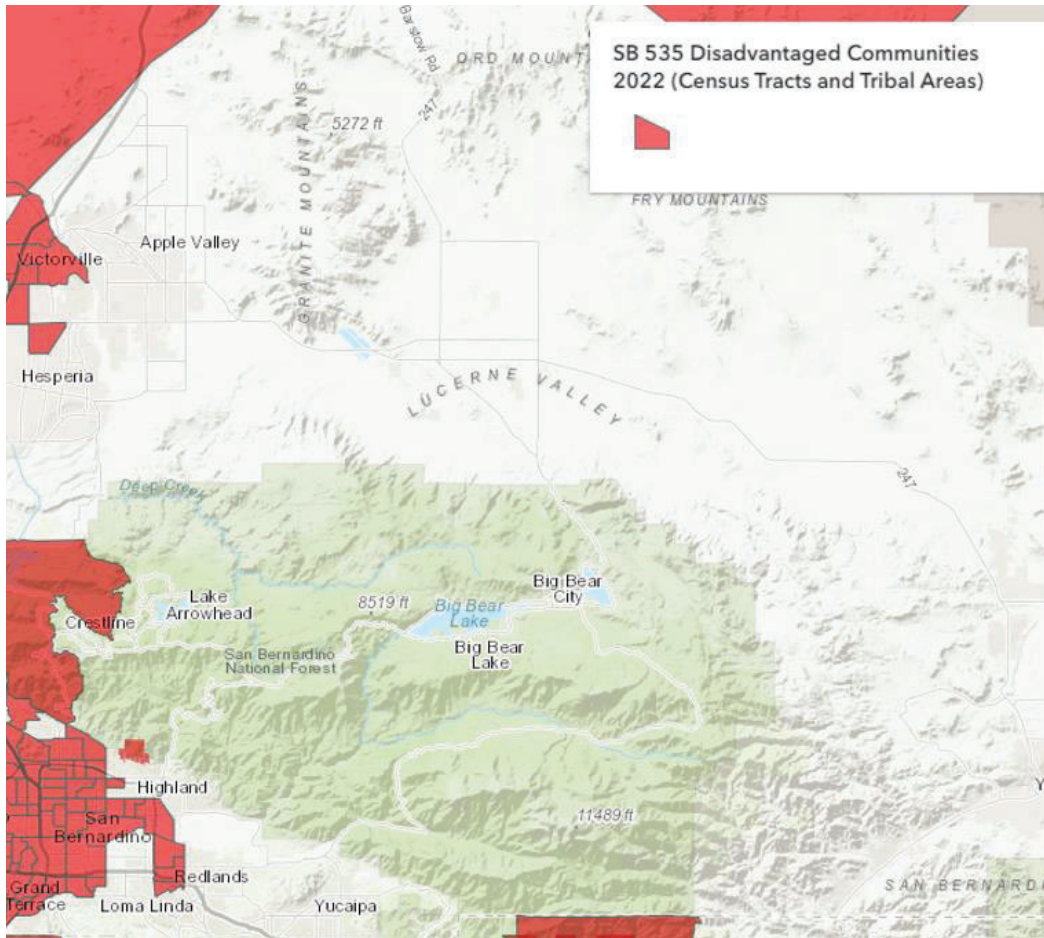

While the utility does not immediately border any tribal lands, BVES consults with the Morongo and San Manuel Tribes with regards to projects jointly enacted with the United States Forest Service (USFS) as BVES's territory is surrounded by USFS land. Additionally, capital projects such as the Radford circuit covered conductor replacement initiative require coordination and awareness with any neighboring tribal agencies.²⁷

While BVES recognizes the emphasis on engaging with and DACs in the development of the IRP Conforming Portfolios, it is important to note that there are no DACs directly within BVES's service territory as defined by current regulatory frameworks. However, BVES understands that air pollution and environmental impacts do not recognize geographic boundaries. Consequently, our commitment extends beyond our immediate service area to encompass potential impacts on nearby regions that might experience indirect effects from our operations.

BVES will continue to track applicable disadvantaged community metric reports to ensure proper representation of its customer base that may be impacted by the local emissions profile while ensuring

²⁷ The project consists of replacing a bare wire sub-transmission line that operates at 34.5 kV with a capacity of 8 MW and 95 wood poles with high performance covered conductor and fire resistant (ductile iron) poles.

safe and reliable delivery of electricity. BVES will also incorporate community engagement workshops to review progress of the next IRP development, which will benefit the community at large.

In lieu of direct DAC engagement within its service territory, BVES continues to actively explore ways to contribute positively to broader regional initiatives that benefit DACs.

Table 15: Census Tracts and Demographics within BVES's Service Territory

Census Tract Number	Total Population	County	CES 4.0 Percentile	CES 4.0 Percentile Range	SB 535 Disadvantaged Community
6071011102	1,760	San Bernardino	34	30-40	No
6071011203	1,404	San Bernardino	53	50-60	No
6071011204	1,685	San Bernardino	23	20-30	No
6071011300	1,398	San Bernardino	51	50-60	No
6071011401	4,507	San Bernardino	54	50-60	No
6071011403	3,451	San Bernardino	17	10-20	No
6071011404	4,585	San Bernardino	19	10-20	No
6071011500	2,125	San Bernardino	24	20-30	No

BVES understands that emissions associated with its system contracts and market purchases do not abide by geographic boundaries but instead are felt across the broader region. As a part of this planning effort BVES ensured that the Preferred Conforming Portfolios met the emissions benchmarks and as such limit BVES’s future emission significantly, especially compared to a portfolio scenario completely reliant on system power. By planning for a low emissions future, BVES aims to limit the impact of emissions associated with its generation on disadvantaged communities across the state.

e. Cost and Rate Analysis

Cost and Rate Analysis Background and Methodology

BVES’s power supply costs come from two categories: purchase power costs and owned asset costs (including the BVPP). Because BVES has historically relied predominantly on system power contracts and PCC3 contracts, purchase power costs have accounted for more than 93 percent of BVES’s total supply cost. Other costs beyond purchase power and owned assets include transmission on SCE-owned and operated facilities (including the 33 kV lines from Cottonwood Substation to Goldhill transfer station and Zanja Substation to BVES’s Village Substation), transmission over the CAISO grid, ancillary services charges, reserve requirements, schedule-dispatch charges and CAISO grid-management charges, including CRRs.

When modeling portfolio costs and associated rate payer impacts, BVES relied on the inputs and modeling approach used in GRC application A.22-08-010 to ensure consistency between proceedings. Notably the costs shown in **Table 16: Revenue Requirements and Bundled System Average Rates for Baseline Scenario (2021 \$)** Table 16 for the “Baseline Scenario” directly reflects those costs

presented in A.22-08-010 though adjusted to reflect the IEPR load forecast.²⁸ Key inputs that were held constant from A.22-08-010 in this modeling exercise included: system contract prices and REC price assumptions, forward power prices for day-ahead purchases, and the requested change to return on equity and associated weighted cost of capital.

Purchase power costs were modeled following the methodology BVES utilized in A.22-08-010 whereby costs related to capacity and energy purchases are built up from volumes purchased and the associated purchase price. Fixed costs related to BVES's market purchases and use of SCE's transmission system are also included and discussed later in this section. Where the makeup of purchase power contracts deviated from the Baseline Scenario presented in Table 16 (e.g., both Preferred Conforming Portfolios include 7x24 block renewable contracts), day-ahead and system contract purchases were reduced to accommodate the additional contract generation in-line with results shown in the RDT and CSP calculators. Future contract costs for planned 7x24 block renewable contracts were estimated by indexing LCOE estimates for similar sources of firm renewable power (e.g., geothermal generation) to BVES's most recent estimate for the upcoming 7x24 block renewable contract set to deliver in 2024.

Because both the Baseline Scenario and the Preferred Conforming Portfolios all depend in some part on contracts for system power as well as day-ahead purchases for monthly short positions, a key driver in these costs estimates are the forecast of CAISO market prices. Since the inception of the CAISO market, BVES has been able to meet its monthly short positions with Day-Ahead purchases and Inter-SC Trades. The price BVES pays for short positions is the Locational Marginal Price (LMP) at the default SCE load aggregation point and is calculated and published by approximately 1:00 PM the day before power flows. To align this cost exercise with results presented in A.22-08-010, BVES used power market forward curves from November 2021 published by IHS Markit.

Recently, wholesale power markets have seen significant price volatility stemming from a myriad of factors including the COVID-19 pandemic, an overall slowdown in US natural gas production, and persistent issues and required maintenance for natural gas storage and delivery in Southern California. At the same time hydro production, a key source for low-cost baseload generation, has plunged below 50 percent of normal production in Northern California boosting the demand for natural gas. Looking forward commodity prices are expected to decline from their current high-point as storage and delivery maintenance is completed and as natural gas demand on the whole declines in response to policy initiatives and clean energy goals. Intermittency of renewables production will continue to challenge the CAISO markets as gas fired generation assets with fast ramp-up capabilities are required to follow renewable production declines. Careful planning will pay off significantly in mitigating the supply cost exposure due to market price volatility during these uncertain times.

BVES will continue to manage energy requirement prices with firm power agreements after the existing and proposed contracts expire through this IRP forecast horizon. Electricity and capacity prices are anticipated to increase, potentially creating price spikes in the energy and RA capacity market. The result would be significant increases in energy and non-energy price components, which would affect

28 In determining costs for the "Baseline Scenario" BVES utilized the supply portfolio assumptions from A.22-08-010 with those variable costs (system contracts, energy purchases, and similar) adjusted downwards to reflect lower load forecast utilized in this IRP compared to the load forecast utilized in A.22-08-010. Fixed costs like CAISO charges were assumed fixed and not adjusted downwards.

supply costs for BVES. BVES will pursue energy and capacity products to mitigate this potentially significant price increase from 2023 to 2035.

Transmission costs represent the next largest cost component within BVES purchase power costs. BVES pays SCE for transmission service on SCE's 33 kV lines that deliver power up the mountain to BVES, and for SCE wholesale distribution access tariff (WDAT) service (for service from SCE's Victor Substation near Victorville to SCE's Cottonwood Substation in Lucerne Valley and from SCE's Vista Substation to SCE's Zanja Substation near Redlands). BVES also pays the CAISO for transmission of energy imported into and through California. Together these transmission charges are approximately \$3,700,000 annually.²⁹

Currently, BVES is charged on a monthly basis for four different uses of SCE's non-CAISO grid. The four different categories of monthly charges for transmission and wholesale distribution services from SCE total approximately \$890,000 annually. The CAISO charges BVES, through its Scheduling Coordinator (SC) Automated Power Exchange (APX), for ancillary services, grid management charges, imbalance energy, and CAISO uplifts.³⁰ Ancillary services are the services necessary to follow the moment-to-moment changes in load, such as regulation, load following, voltage support and operating reserve capacity. Grid management charges are the cost of operating the California transmission grid and include costs associated with running the CAISO markets. Imbalance energy charges apply to deviations between scheduled and metered energy and typically represent a very small portion of BVES's energy requirements. BVES will continue to strive to minimize imbalance costs through accurate day ahead power forecasts.

Congestion Costs are one of the two components of the cost to deliver energy from one point to another within the CAISO (transmission losses being the other). The cost of congestion is the difference in the Marginal Congestion Cost (MCC) component of the LMP between the price nodes specified for energy delivery and takeout.³¹ For BVES supply contracts, the source from the CAISO settlements perspective is the aggregated generation hub price for SP15 (TH_SP15_Gen-APND) area.³² The sink, or takeout, point is the SCE Default Load Aggregation Price (DLAP_SCE). This price is the load weighted aggregation of all load nodes within the SCE TAC area. The Congestion Cost is calculated using the Day Ahead Market Prices as follows:

$$\text{Congestion Costs} = \text{Source Marginal Congestion Cost} - \text{Sink Marginal Congestion Costs}$$

²⁹ Including Schedule Coordinator fees.

³⁰ CAISO uplift charges are collected from all customers to ensure market participants, including suppliers, are made whole. They reflect costs incurred to run the market for which there is no direct assignment to specific LSEs. They are collected from all customers to ensure the CAISO market is ultimately revenue neutral.

³¹ The CAISO's market design creates marginal nodal or locational prices in its Day Ahead market process. The Locational Marginal Price or LMP is the algebraic sum of the 1) Marginal Energy Cost (MCE), 2) MCC, and 3) Marginal Loss Cost (MLC).

³² The CAISO derives the aggregated generation hub price by calculating a weighted average for all generators within the SP15 area. Weights are pre-determined by the CAISO on an annual basis based on previous year output. Generator hub prices are calculated for NP15, ZP26 and SP15 areas. Generation scheduled to the aggregate generation hub is paid/charged the weighted hub price as calculated in the Day Ahead market.

Congestion costs can be mitigated through the use of CRRs. BVES’s power contracts are for delivery to the SP15 area, so BVES must bear the cost for any congestion between SP15 and the DLAP. As the economic conditions within California improve and system load increases, the cost of congestion may increase corresponding to heavier system loading.

While purchase power costs are anticipated to represent the majority of supply costs for BVES through the forecast period under Preferred Conforming Portfolios, owned asset costs will grow as new facilities come online. As discussed previously in this IRP, BVES plans to build a 5 MW solar facility and a 5 MW storage facility with both facilities planned to come online by Q4 of 2024 or early 2025. BVES is still in the pre-planning phase for these projects and as such anticipates asset costs and resulting impact on rate payers may change as additional details of the projects are finalized. For the cost estimate presented here BVES modeled costs associated with the key revenue requirement line items of Net Income, Operations and Maintenance Expense, Administrative and General Expense, Property and Local Taxes, and State and Federal Income Tax, which result in a final all-in annual expense. BVES leveraged estimates of variable operations and maintenance expense by technology type from the RESOLVE model.

To maintain consistency with BVES’s recent GRC proceeding, the IRP cost and rate analysis and calculations leveraged the same return on equity and associated weighted cost of capital as submitted in the 2023 Test Year GRC. BVES also included an adjustment to account for an assumed 26 percent ITC tax credit for the solar facility and a 20 percent ITC tax credit for the storage facility³³. Because these future owned assets were not included as a part of BVES’s GRC these costs are not included in Table 16.

Table 16: Revenue Requirements and Bundled System Average Rates for Baseline Scenario (2021 \$)

Line No.	Cost Category	2023	2024	2025	2026	2027	2028
1	Distribution	\$ 7,329,038	\$ 7,449,956	\$ 7,572,869	\$ 7,697,810	\$ 7,824,813	\$ 7,953,910
2	Transmission	\$ 210,826	\$ 216,962	\$ 223,277	\$ 229,775	\$ 236,463	\$ 243,345
3	Generation (Less Purchase Power)	\$ 728,224	\$ 750,827	\$ 774,131	\$ 798,159	\$ 822,932	\$ 848,475
4	Demand Side Programs	\$ -	\$ -	\$ -	\$ -	\$ -	\$ -
5	Other (Purchase Power Expense)	\$10,688,810	\$10,181,350	\$ 9,521,969	\$ 9,837,405	\$10,258,877	\$10,284,901
6 (sum lines 1-5)	Preferred Conforming Portfolio Revenue Requirement	\$18,956,898	\$18,599,095	\$18,092,246	\$18,563,150	\$19,143,085	\$19,330,631
7	System Sales (GWh)	143.0	143.0	144.1	145.1	146.5	147.6
8	Bundled Sales (GWh)	143.0	143.0	144.1	145.1	146.5	147.6
9	System Average Delivery Rate (¢/kWh)	5.27	5.36	5.41	5.46	5.50	5.55

³³ BVES is aware that the recently passed Inflation Reduction Act modifies these tax incentives as well as provides additional areas of financial incentive for renewable facilities. BVES will update these assumptions as well as the estimated installed asset price in future proceedings as appropriate while the projects continue to develop in the pre-construction phase.

Line No.	Cost Category	2023	2024	2025	2026	2027	2028
10	Bundled Generation Rate (¢/kWh)	0.51	0.52	0.54	0.55	0.56	0.57
11	Bundled System Average Rate (¢/kWh)	13.26	13.00	12.55	12.79	13.07	13.09

Table 16 Continued

Line No.	Cost Category	2029	2030	2031	2032	2033	2034	2035
1	Distribution	\$ 8,085,138	\$ 8,218,531	\$ 8,354,124	\$ 8,491,955	\$ 8,632,059	\$ 8,774,475	\$ 8,919,241
2	Transmission	\$ 250,428	\$ 257,716	\$ 265,217	\$ 272,936	\$ 280,880	\$ 289,055	\$ 297,468
3	Generation (Less Purchase Power)	\$ 874,810	\$ 901,963	\$ 929,958	\$ 958,823	\$ 988,583	\$ 1,019,267	\$ 1,050,903
4	Demand Side Programs	\$ -	\$ -	\$ -	\$ -	\$ -	\$ -	\$ -
5	Other (Purchase Power Expense)	\$ 10,469,468	\$ 11,314,199	\$ 11,711,811	\$ 11,968,934	\$ 12,296,427	\$ 12,695,906	\$ 13,150,024
6 (sum lines 1-5)	Preferred Conforming Portfolio Revenue Requirement	\$ 19,679,844	\$ 20,692,409	\$ 21,261,110	\$ 21,692,647	\$ 22,197,949	\$ 22,778,703	\$ 23,417,636
7	System Sales (GWh)	148.8	149.9	150.9	151.6	152.4	153.0	153.8
8	Bundled Sales (GWh)	148.8	149.9	150.9	151.6	152.4	153.0	153.8
9	System Average Delivery Rate (¢/kWh)	5.60	5.65	5.71	5.78	5.85	5.92	5.99
10	Bundled Generation Rate (¢/kWh)	0.59	0.60	0.62	0.63	0.65	0.67	0.68
11	Bundled System Average Rate (¢/kWh)	13.22	13.80	14.09	14.31	14.57	14.88	15.22

Table 17: Revenue Requirements and Bundled System Average Rates for 25 MMT Preferred Conforming Portfolio (2021 \$)

Line No.	Cost Category	2023	2024	2025	2026	2027	2028
1	Distribution	\$ 7,329,038	\$ 7,449,956	\$ 7,572,869	\$ 7,697,810	\$ 7,824,813	\$ 7,953,910
2	Transmission	\$ 210,826	\$ 216,962	\$ 223,277	\$ 229,775	\$ 236,463	\$ 243,345
3	Generation (Less Purchase Power)	\$ 728,224	\$ 750,827	\$ 3,754,858	\$ 3,771,600	\$ 3,644,317	\$ 3,523,074
4	Demand Side Programs	\$ -	\$ -	\$ -	\$ -	\$ -	\$ -
5	Other (Purchase Power Expense)	\$10,661,906	\$10,372,884	\$10,892,193	\$11,025,737	\$11,207,596	\$11,185,101
6 (sum lines 1-5)	Preferred Conforming Portfolio Revenue Requirement	\$18,929,994	\$18,790,629	\$22,443,197	\$22,724,923	\$22,913,188	\$22,905,430
7	System Sales (GWh)	143.0	143.0	144.1	145.1	146.5	147.6
8	Bundled Sales (GWh)	143.0	143.0	144.1	145.1	146.5	147.6
9	System Average Delivery Rate (¢/kWh)	5.27	5.36	5.41	5.46	5.50	5.55

Line No.	Cost Category	2023	2024	2025	2026	2027	2028
10	Bundled Generation Rate (¢/kWh)	0.51	0.52	2.61	2.60	2.49	2.39
11	Bundled System Average Rate (¢/kWh)	13.24	13.14	15.57	15.66	15.64	15.51

Table 17 Continued

Line No.	Cost Category	2029	2030	2031	2032	2033	2034	2035
1	Distribution	\$ 8,085,138	\$ 8,218,531	\$ 8,354,124	\$ 8,491,955	\$ 8,632,059	\$ 8,774,475	\$ 8,919,241
2	Transmission	\$ 250,428	\$ 257,716	\$ 265,217	\$ 272,936	\$ 280,880	\$ 289,055	\$ 297,468
3	Generation (Less Purchase Power)	\$ 3,407,732	\$ 3,298,159	\$ 3,197,276	\$ 3,101,912	\$ 3,011,949	\$ 2,931,130	\$ 2,851,549
4	Demand Side Programs	\$ -	\$ -	\$ -	\$ -	\$ -	\$ -	\$ -
5	Other (Purchase Power Expense)	\$ 13,725,787	\$ 13,785,135	\$ 13,781,429	\$ 13,768,569	\$ 13,797,956	\$ 14,237,910	\$ 14,254,094
6 (sum lines 1-5)	Preferred Conforming Portfolio Revenue Requirement	\$ 25,469,085	\$ 25,559,541	\$ 25,598,046	\$ 25,635,372	\$ 25,722,844	\$ 26,232,570	\$ 26,322,352
7	System Sales (GWh)	148.8	149.9	150.9	151.6	152.4	153.0	153.8
8	Bundled Sales (GWh)	148.8	149.9	150.9	151.6	152.4	153.0	153.8
9	System Average Delivery Rate (¢/kWh)	5.60	5.65	5.71	5.78	5.85	5.92	5.99
10	Bundled Generation Rate (¢/kWh)	2.29	2.20	2.12	2.05	1.98	1.92	1.85
11	Bundled System Average Rate (¢/kWh)	17.11	17.05	16.96	16.91	16.88	17.14	17.11

Table 18: Revenue Requirements and Bundled System Average Rates for 30 MMT Preferred Conforming Portfolio (2021 \$)

Line No.	Cost Category	2023	2024	2025	2026	2027	2028
1	Distribution	\$ 7,329,038	\$ 7,449,956	\$ 7,572,869	\$ 7,697,810	\$ 7,824,813	\$ 7,953,910
2	Transmission	\$ 210,826	\$ 216,962	\$ 223,277	\$ 229,775	\$ 236,463	\$ 243,345
3	Generation (Less Purchase Power)	\$ 728,224	\$ 750,827	\$ 3,754,858	\$ 3,771,600	\$ 3,644,317	\$ 3,523,074
4	Demand Side Programs	\$ -	\$ -	\$ -	\$ -	\$ -	\$ -
5	Other (Purchase Power Expense)	\$ 10,661,906	\$ 10,372,884	\$ 10,892,193	\$ 11,025,737	\$ 11,207,596	\$ 11,185,101
6 (sum lines 1-5)	Preferred Conforming Portfolio Revenue Requirement	\$ 18,929,994	\$ 18,790,629	\$ 22,443,197	\$ 22,724,923	\$ 22,913,188	\$ 22,905,430
7	System Sales (GWh)	143.0	143.0	144.1	145.1	146.5	147.6
8	Bundled Sales (GWh)	143.0	143.0	144.1	145.1	146.5	147.6
9	System Average Delivery Rate (¢/kWh)	5.27	5.36	5.41	5.46	5.50	5.55

Line No.	Cost Category	2023	2024	2025	2026	2027	2028
10	Bundled Generation Rate (¢/kWh)	0.51	0.52	2.61	2.60	2.49	2.39
11	Bundled System Average Rate (¢/kWh)	13.24	13.14	15.57	15.66	15.64	15.51

Table 18 Continued

Line No.	Cost Category	2029	2030	2031	2032	2033	2034	2035
1	Distribution	\$ 8,085,138	\$ 8,218,531	\$ 8,354,124	\$ 8,491,955	\$ 8,632,059	\$ 8,774,475	\$ 8,919,241
2	Transmission	\$ 250,428	\$ 257,716	\$ 265,217	\$ 272,936	\$ 280,880	\$ 289,055	\$ 297,468
3	Generation (Less Purchase Power)	\$ 3,407,732	\$ 3,298,159	\$ 3,197,276	\$ 3,101,912	\$ 3,011,949	\$ 2,931,130	\$ 2,851,549
4	Demand Side Programs	\$ -	\$ -	\$ -	\$ -	\$ -	\$ -	\$ -
5	Other (Purchase Power Expense)	\$ 12,981,527	\$ 13,152,515	\$ 13,207,618	\$ 13,237,689	\$ 13,313,541	\$ 13,946,849	\$ 13,985,887
6 (sum lines 1-5)	Preferred Conforming Portfolio Revenue Requirement	\$ 24,724,824	\$ 24,926,921	\$ 25,024,235	\$ 25,104,492	\$ 25,238,429	\$ 25,941,509	\$ 26,054,146
7	System Sales (GWh)	148.8	149.9	150.9	151.6	152.4	153.0	153.8
8	Bundled Sales (GWh)	148.8	149.9	150.9	151.6	152.4	153.0	153.8
9	System Average Delivery Rate (¢/kWh)	5.60	5.65	5.71	5.78	5.85	5.92	5.99
10	Bundled Generation Rate (¢/kWh)	2.29	2.20	2.12	2.05	1.98	1.92	1.85
11	Bundled System Average Rate (¢/kWh)	16.61	16.63	16.58	16.56	16.56	16.95	16.94

Cost and Rate Impact

Table 16 through Table 18 report the results of BVES’s cost and rate impact analysis for the Baseline Scenario (reflecting those inputs and assumptions from A.22-08-010) and the two Preferred Conforming Portfolios. In terms of the Bundled System Average Rate (total costs divided by total load), the 25 MMT scenario is shown to be 12.4 percent higher by 2035 compared to the Baseline Scenario and the 30 MMT scenario is shown to be 11.3 percent higher than the Baseline Scenario by 2035. The largest cost disparities between these profiles occur in 2029 and decline throughout the remainder of the IRP forecast horizon. The drivers for this increased cost stem from both categories of supply costs – purchase power and owned assets. Purchase power costs increased under the Preferred Conforming Portfolios owing to the inclusion of higher priced 7x24 block renewable power contracts rather than system power contracts or market purchases. This impact is seen most in 2029 when the second 7x24 block renewable contract is assumed to begin delivering in both conforming portfolios.

While these contracts are higher priced than alternative options like system power contracts, they present several key strengths that outweigh their estimated price including but not limited to the bundled nature of the product (these products offer 1:1 RECs), the firm nature of the product (ensuring BVES does not have to over-size renewable contracts to make up for the shaped nature of wind or solar

only PPAs), the simplicity in contracting for and administering fewer contracts instead of numerous alternative renewable contracts and increased local reliability. BVES's portfolio modeling indicated that relying on wind or solar only PPAs would necessitate four or more renewable contracts over the IRP forecast horizon (the larger number necessitated by the shaped nature of the generation from these technologies), while the same emissions benchmarks could be achieved from only two additional 7x24 block renewable contracts.³⁴ As discussed elsewhere in this IRP filing, BVES has struggled to contract for renewable generation historically owing to low bid receivables and lack of cost-competitive offers and thus minimizing the number of required contracts is essential in ensuring supply portfolio achievability. Since the last IRP cycle, BVES has continuously issued RFPs for available RE contracts with preference given to bundled products including RECs. Only recently, BVES has identified a potential pathway to securing firm RE PPAs, for which an initial purchase agreement for roughly one-third of supply needs will be met by 2024, subject to negotiations and contracting requirements.

Owned asset costs as reflected on Line 3 of Tables 16 through 18 also increase under the Preferred Conforming Portfolios compared to the Baseline Scenario as they include the costs associated with BVES's solar project and the separate storage project. While these assets are higher priced than what commensurate system contracts or market purchases would require, the benefits these projects provide in terms of reliability for BVES's system and independence from the grid cannot be overstated.

Ultimately, BVES is keenly aware of the current financial pressures on rate payers in this time of high inflation and significant power market volatility. BVES considered portfolio costs in each step of this IRP planning process from the initial investigation of a broad range of supply portfolios through to the final comparison between the Baseline Scenario and Preferred Conforming Portfolios. While the portfolios presented here represent an increased cost compared to the Baseline Scenario, it is important to remember the Baseline Scenario does not meet the emissions benchmarks and thus does not provide a fulsome view of BVES's future supply costs under these emissions requirements. To meet the further encouraged GHG reduction policy initiatives and clean energy targets set by the state of California, significant changes will have to be made to BVES's supply portfolio and that evolution in generation will ultimately be felt by the utility and the rate payer.

f. System Reliability Analysis

The following tables depict the RDT modeling results for utility-controlled energy supply. Due to the lack of CAISO-controlled resources mapped to RSP-identified generators and the BVPP considered to reduce capacity needs for BVES's local load center, RA system capacity needs must be met through available contracts as no physical resources currently owned by or contracted with the utility provide this qualified capacity. To address CAISO system reliability needs, BVES's load can be reduced by continued CAISO BTM deployments and other load modifying efforts. BVES assumes enough RA to be available in future years to compensate for any supply shortfalls. BVES continues to seek RA capacity reservations

³⁴ BVES included the planned generation from the 7x24 block renewable contract it is currently negotiating to begin delivering in Q4 2024 in all portfolios analyzed.

for flexible and generic system needs. BVES will update the Commission through RDT biannual filings as contracts are secured over the 2023-2035 horizon.

Table 19: 25 MMT Load and Resource Table by Contract Status

Load and Resource Table by Contract Status												
	2024	2025	2026	2027	2028	2029	2030	2031	2032	2033	2034	2035
LSE reliability need (MW)	47	49	50	49	48	49	51	49	48	46	45	43
ELCC by contract status (effective MW)												
Online	-	-	-	-	-	-	-	-	-	-	-	-
Development	-	-	-	-	-	-	-	-	-	-	-	-
Review	-	-	-	-	-	-	-	-	-	-	-	-
PlannedExisting	-	-	-	-	-	-	-	-	-	-	-	-
PlannedNew	-	1	1	1	0	0	0	0	0	0	0	0
BTM PV	0	0	0	0	1	1	0	1	1	1	1	1
LSE total supply (effective MW)	0	1	1	1	1	1	1	1	1	1	1	1
Net capacity position (+ve = excess, -ve = shortfall) (effective MW)	(47)	(48)	(49)	(48)	(47)	(48)	(50)	(48)	(47)	(45)	(44)	(42)

Figure 9: 25 MMT LSE Capacity by Contract Status


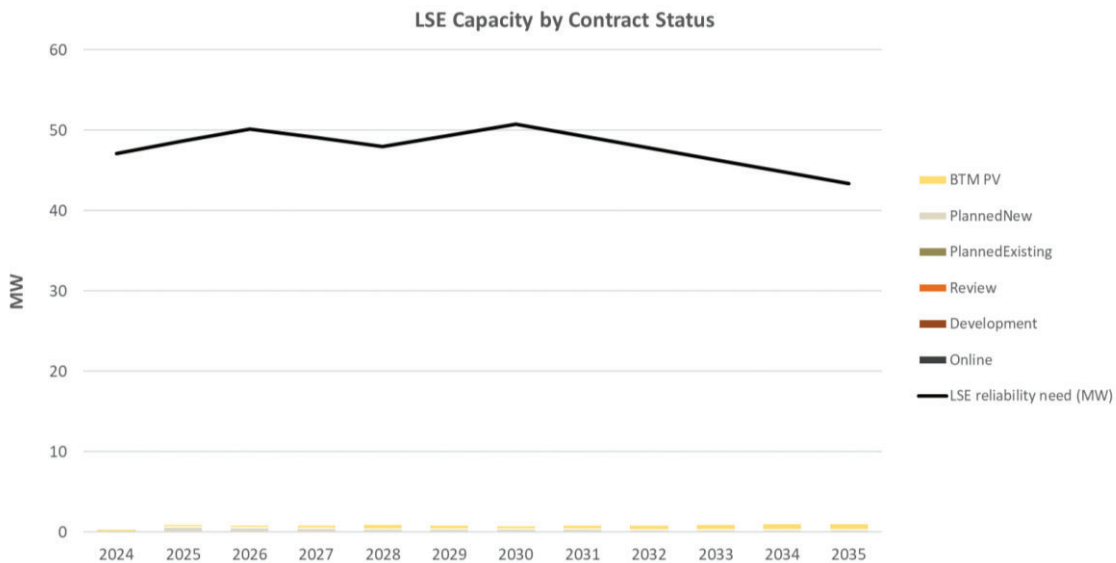


Table 20: 30 MMT Load and Resource Table by Contract Status

Load and Resource Table by Contract Status												
	2024	2025	2026	2027	2028	2029	2030	2031	2032	2033	2034	2035
LSE reliability need (MW)	49	51	52	50	48	48	47	46	46	45	45	44
ELCC by contract status (effective MW)												
Online	-	-	-	-	-	-	-	-	-	-	-	-
Development	-	-	-	-	-	-	-	-	-	-	-	-
Review	-	-	-	-	-	-	-	-	-	-	-	-
PlannedExisting	-	-	-	-	-	-	-	-	-	-	-	-
PlannedNew	-	1	1	1	0	0	0	0	0	0	0	0
BTM PV	1	1	1	1	1	1	0	1	1	1	1	1
LSE total supply (effective MW)	1	1	1	1	1	1	1	1	1	1	1	1
Net capacity position (+ve = excess, -ve = shortfall) (effective MW)	(48)	(49)	(51)	(49)	(47)	(47)	(46)	(46)	(45)	(44)	(44)	(43)

Figure 10: 30 MMT LSE Capacity by Contract Status

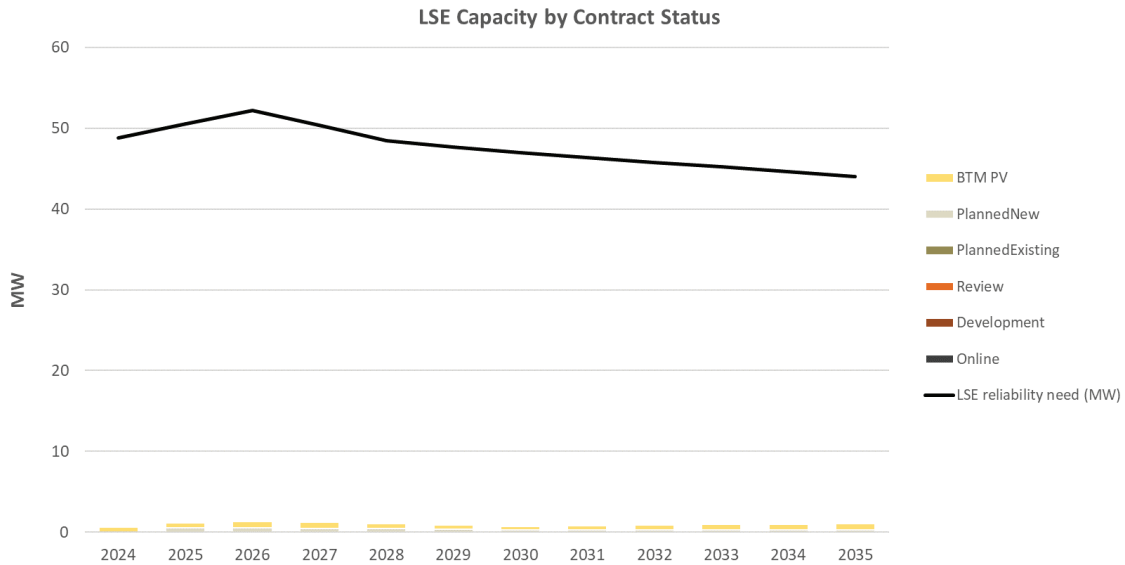

The potential significant increase in load due to forecasted expansion at Snow Summit and implementation of BVES-owned solar PV and storage projects will modify the hourly load profile and shift energy use towards a more fully utilized capacity. Facilitating this change in the load shape and capacity utilization will be the battery used for stored energy forecasted to come online in later years. Daytime load is increased as the battery charges over a four-hour period, and the evening load is reduced as the battery discharges. This will allow BVES to serve load above the capacity limit set by the SCE transmission contract serving BVES and the BVPP capacity combined. Planned solicitations to procure renewable firm contracts will also support load shape flattening as reliance on system power agreements is reduced over the ten-year planning cycle.

The annual and seasonal contracts combined will hedge approximately 90 percent of the load requirement through 2024 with anticipated wholesale market purchases to meet the shortfall in 2023 that is a result of delayed implementation of the solar generating facility. The BVPP provides a partial hedge for the remaining 10 percent as gas prices still drive the BVPP generation marginal power cost. The BVPP has an 8.4 MW capacity and can therefore provide hedge equal to the gas price plus transportation cost at the approximate 12,000 BTU/kWh heat rate of the BVPP. Although this provides some protection, the BVPP supply price is subject to potential gas price spikes.

In 2004, the CPUC adopted an RA policy framework (PUC Section 380) to ensure the reliability of electric service in California. In an effort to meet its RA requirements, BVES will continue to issue solicitations to contract RA resources including a 15 percent reserve margin and will use its BVPP as a BTM DG resource. BVES will also continue to comply with the CAISO Tariff applicable to LSEs and their RA obligations through its SC.

BVES complies with Federal Energy Regulatory Commission requirements and the CAISO Tariff by following these key provisions:

- BVES closely mirrors the State’s monthly coincident peak demand calculation and provides the data to the CEC.³⁵
- BVES treats the BVPP as a distributed generation resource because the BVPP is not under a PGA and is behind the CAISO metering point.

Other options for reducing the RA obligations and the associated cost will include development of the BVES-owned solar project and to facilitate further renewable DG growth in the residential and commercial sectors, as well as the development of the 5 MW / 20 MWh (four-hour) battery solution. These sources of solar production will decrease BVES’s overall load and therefore reduce the RA requirement for BVES. BVES is assessing the benefits of stored power as a means to manage its load profile and reduce peak load and therefore contribute to the reduction of its RA requirement. Results of the preliminary analysis indicate that the battery solution would provide a reduction in the RA requirement, a daily arbitrage, an increase in capacity served, and other load shaping and frequency benefits.

The planned solar project will also offer a long-term strategy on pricing, RA, RECS, a daytime capacity increase, and a means of reducing emissions for BVES. The Federal Investment Tax Credit available for the solar and battery solution makes this proposal even more cost effective for customers provided that this incentive is available in the implementation stage.

Due to its small size and as a distribution-only utility, BVES has virtually no impact on the CAISO system. BVES’s peak load of approximately 45 MW when compared to the CAISO peak load of over 45,000 MWs represents less than one percent of the total CAISO peak load. Compared to the CPUC 2021 RSP, BVES presents the following table.

Table 21: BVES Resource Mix in 2035 Compared to RSP

RSP Resource Mix (Cumulative MWs) Compared to 2019-2020 RSP Assessment								25 MMT Scenario Preferred	30 MMT Scenario Preferred	Comments
Resource Type	2020	2021	2022	2023	2024	2026	2030	Owned & Contracted Resources (rounded whole MWs) in 2035		
Nuclear	2,935	2,935	2,935	2,935	1,785	635	635	0	0	BVPP
CHP	2,296	2,296	2,296	2,296	2,296	2,296	2,296	0	0	
Natural Gas	27,562	25,113	25,113	25,113	25,113	25,113	25,084	8	8	
Coal	480	480	480	480	480	-	-	0	0	
Hydro (Large)	7,070	7,070	7,070	7,070	7,070	7,070	7,070	0	0	
Hydro (Scheduled Imports)	2,852	2,852	2,852	2,852	2,852	2,852	2,852	0	0	
Biomass	903	903	903	903	903	903	901	0	0	
Geothermal	1,851	1,851	1,851	1,851	1,851	1,851	1,851	0	0	

³⁵ The CEC reviews this data and provides to BVES a procurement obligation value consistent with the treatment provided to other CPUC-jurisdictional LSEs.

Hydro (Small)	974	974	974	974	974	974	974	0	0	
Wind	7,357	7,490	9,406	9,406	10,193	10,193	10,293	0	0	
Out-of-State Wind on New	-	-	-	-	-	-	606	0	0	
Transmission										
Solar	16,310	18,766	20,887	22,887	22,887	22,887	25,905	13	13	<i>BVES Solar Facility</i>
Customer Solar	9,827	11,137	12,284	13,303	14,288	16,156	20,066	26	26	<i>IEPR/CSP assumptions</i>
Battery Storage	1,846	4,614	4,717	4,887	6,073	9,065	12,138	5	5	<i>BVES BESS Facility</i>
Pumped (long-duration) Storage	1,599	1,599	1,599	1,599	1,599	2,573	2,573	0	0	
Shed Demand Response	2,195	2,418	2,418	2,418	2,418	2,418	2,418	10	10	<i>Interruptible customers</i>
Gas Capacity Not Retained	-	-	-	-	-	-	-30	0	0	

Source Data: 2019 - 2020 RSP R.16-02-007, Table 6

g. High Electrification Planning

To investigate the impact of a “High Electrification” scenario on BVES’s Preferred Conforming Portfolios, BVES modelled a high load scenario within its supply model. The high load scenario assumed additional load from electrification beginning in 2026 and growing an additional 10 percent of total load by 2035, a load increase of 14.2 GWh in 2035 (prior to application of demand modifiers). Under this scenario, BVES would need to increase the size of planned 7x24 block renewable contracts to serve a portion of this additional load while maintaining compliance with the emissions benchmarks and may require additional batteries or expanded capacity in the Big Bear Valley. Table 22 shows the result of this analysis.

Under the 25 MMT emissions benchmark and the High Electrification scenario BVES would need to procure an additional 2 MW of 7x24 block renewable generation. Under the 30 MMT emissions benchmark and the High Electrification scenario, BVES would need to procure an additional 1 MW of 7x24 block renewable power in 2029 and an additional 2 MW of 7x24 block renewable power in 2034 compared to the Preferred Conforming Portfolios. The 30 MMT Preferred Conforming Portfolio requires a greater increase in non-emitting generation when applied to the “High Electrification” scenario because the included firm renewable contracts are sized smaller than those under the 25 MMT Preferred Conforming Portfolio.

Table 22: Additional Contract Procurements Under High Electrification Scenario³⁶

Resource Type	MWs	Annual GWh	2035 GHG target	Transmission Zone	Substation/ Bus	Alternative location
7x24 Block Renewable Power	2	17,520	25 MMT	n/a	n/a	n/a
7x24 Block Renewable Power	3	26,280	30 MMT	n/a	n/a	n/a

³⁶ BVES does not presently have guidance on the transmission zone or substation/bus that would be associated with these additional contract capacities as they would be largely dependent on the counterparty's broader portfolio within CAISO.

h. Existing Resource Planning

In developing the preferred conforming portfolios, BVES considered both existing and new resources to fulfill its supply needs. Specifically, BVES plans to bring online two new generation facilities – the 5 MW BVES Solar Project and the 5 MW BVES Storage Project. Outside of these two new resources, BVES’s Preferred Conforming Portfolios rely on the contracts that deliver 7x24 block renewable power from existing resources. BVES is in the unique position currently of being actively engaged with a counterparty to contract for this type of firm renewable product that would begin delivery in Q4 2024. The counterparty for this contract operates a significant renewable generation portfolio that can promise delivery for the relatively small amount of contract power (53 GWh annually) BVES requires. While BVES engages in the competitive procurement process, in the time since the 2020 IRP BVES has been unable to contract for cost competitive renewable PPAs to replace existing system power contracts. Owing to these challenges as well as BVES’s recent early-stage success with its counterparty for firm renewable power, BVES believes it is reasonable to plan to contract for the same firm renewable product in 2029 and 2034 (as both Preferred Conforming Portfolios require). BVES’s small size is an unusual benefit when seeking 7x24 block renewable as some counterparties are able to leverage large, diverse renewable portfolios that are oversized compared to the generation BVES ultimately requires.

BVES determined the size of these future 7x24 block renewable contracts based on the supply-demand balancing analysis and the resulting emissions of the portfolio as a part of determining the Preferred Conforming Portfolios. Notably under both the 25 MMT and 30 MMT scenarios future contracts for firm renewable power are at most 1 MW larger in terms of contract capacity compared to the contract BVES is under negotiations for with its current counterparty. BVES thus believes the size of these contracts are achievable and also fall well within the size of the generation portfolio managed by the current counterparty as well as similar counterparties that offer these types of products.

Challenges to procuring generation from existing facilities will not be unique to BVES as the broader pool of LSEs are likely interested in the broad benefits provided by firm renewable power. While BVES’s small size is a benefit in terms of contract achievability, it also limits BVES’s risk appetite owing to its small customer base as well as limits the amount of financial collateral BVES is able to put up to support these long-term power contracts. BVES chose the final Preferred Conforming Portfolios as they broke up the required contracts into two tranches so as to limit the amount of financial collateral BVES would have to support at any one time. Additionally, BVES acknowledges the risk of depending on a single counterparty for both the upcoming contract in 2024 as well as the planned future contracts in 2029 and 2034. Accordingly, the financial size and strength of the single counterparty will be an important consideration for BVES in selecting the counterpart to these contracts.

i. Hydro Generation Risk Management

While BVES is not directly exposed to hydro generation risk, delivery from large hydro facilities carried through the CAISO power grid can lead to a market risk exposure that may impact the CPUC’s RSP as well as BVES’s power supply forecasts in shortfall day-ahead demand scheduling. During drought years, the availability of hydroelectric generation production can be severely limited. It is well known that the Big Creek/Ventura area is a local capacity requirement area that relies on Big Creek generation to meet North American Electricity Reliability Corporation planning standards. The recent trend shows that hydroelectricity generation declined between 2001 and 2015, largely due to drought conditions. The precipitation and hydro reservoir subsequently increased from 2015 to 2017, prior to declining again in

2018 through 2021. Additionally, more supply of run-of-river hydroelectric power generally reduces the need for baseload generation and imports. Hydro conditions also impact the amount of hydroelectric power and ancillary services available during peak hours from units with reservoir storage.

Year-to-year variation in hydroelectric power supply in California can have a significant impact on supply mix and the performance of the wholesale energy market. Hydro-electric generation in 2015 was the lowest since 1998 and followed many years of decreasing output.³⁷ During a drought year in 2015 the Big Creek area of the SCE system experienced a reduction of generation production 80 percent below average production. Natural gas-fired capacity and renewables were used to help offset lower levels of generation from hydropower facilities. Total hydro-electric production increased in both 2016 and 2017 before exhibiting a 39 percent decrease in 2018. While California hydro conditions for 2019 were above normal, hydro conditions in 2020 were down and hydro production in 2021 amounted to a 26 percent decrease compared to 2020.³⁸ The current forecast shows the potential changes in hydro conditions and availability within the state for future resource planning periods. Results indicate a likelihood of reduction of released hydroelectric generation and an increase in in-state supply from new solar generation.

j. Long-Duration Storage Planning

Both the remote nature as well as the small customer base associated with BVES make long duration storage financially infeasible for BVES at this time owing to increased TAC charges among other factors. BVES does however, plan to own and operate a 5 MW, 4-hour duration storage facility within its service territory that will come online in 2025 at the latest. As a part of future IRP proceedings BVES will continue to investigate the cost effectiveness and practicality of long-duration storage.

k. Clean Firm Power Planning

As discussed above, BVES is currently in the process of contracting for a 7x24 block renewable product that would deliver approximately 30 percent of BVES annual supply beginning in late 2024. This product will be delivered on a 7x24 basis for a block of 6 MW of renewable power indicating a 100 percent capacity factor. The counterparty indicates this type of product is achievable through a mix of multiple renewable resources that together can provide a firm product, made easier by the small contract capacity BVES requires. BVES understands from discussions with its potential counterparty that the resources that will provide this firm renewable product in 2024 are all located within the CAISO balancing authority. BVES sees significant benefits for contracting for this type of generation product both in the near future as well as for the planned procurements included in the Preferred Conforming Portfolios in 2029 and 2034.

These types of firm renewable contract generation are especially advantageous to BVES, which is limited in its ability to sell existing excess system power contract generation that would be inherent in procuring the amount of generation required from shaped, renewable resources. Additionally, contracting for this

³⁷ CAISO. "Annual Report on Market Issues and Performance." 2016. <http://www.caiso.com/Documents/2016AnnualReportonMarketIssuesandPerformance.pdf>.

³⁸ CAISO. "Annual Report on Market Issues and Performance." 2021. <http://www.caiso.com/Documents/2021-Annual-Report-on-Market-Issues-Performance.pdf>

type of firm renewable power can be readily aligned with BVES historic approach of procuring firm system power but does not require the additional step of having to purchase unbundled RECs via PCC3 contracts to retire towards the RPS program. Ultimately, procuring firm renewable contracts for BVES is its best path forward to ensure compliance with the emissions benchmarks.

l. Out-of-State Wind Planning

BVES understands that out-of-state (OOS) wind development is being proposed to supplement existing generation capacity due to land and resource constraints on further wind development within the state of California. However, BVES believes it would incur significant losses should it pursue out-of-state wind generation, likely making this initiative cost-prohibitive for investment. BVES does not currently see potential in pursuing contracts with OOS wind resources and does not project a need to procure power generated by any new OOS wind developments before the end of this IRP forecast horizon.

m. Offshore Wind Planning

Given the size of BVES's load (< 0.1 percent of total large and small IOU load in CA) and commensurately small customer base (<25,000 total customers), at this time BVES does not view offshore wind as a necessary option to achieve its clean energy goals and emissions benchmarks at this time. BVES will continue to monitor related offshore wind proceedings and investigate the need for such generation and affordability should such generation be required in future IRP proceedings.

n. Transmission Planning

Due to BVES's two supply interconnection points, transmission capacity expansion is not applicable nor a suitable, least-cost option to present in this IRP. BVES understands that as more renewable generation is added within the CAISO area, it is expected that transmission use will increase and ultimately add to the overall cost of congestion. To mitigate this direct risk, BVES will continue to participate in the CAISO CRR process to secure the appropriate financial hedge to mitigate potentially increasing congestion costs or secure PPAs that deliver energy to the DLAP_SCE on behalf of BVES.

Additionally, BVES evaluations do not require busbar mapping exercises for capacity planning with regard to its presented resource portfolio as it has no current projects under CAISO-control and no current projects in the interconnection queue.

IV. Action Plan

BVES's action plan to meet the targets proposed in this IRP is as follows:

1. Strive to meet forecasted GHG emissions benchmark from BVES energy supply:
 - a. Transition to obtaining "unit-specific renewable energy block contracts" (firm renewable energy contracts for both base and seasonal loads);
2. Reduce reliance on system power over this IRP planning period:
 - a. BVES has acquired an annual hourly variable shaped contract from December 1, 2019 to October 31, 2024;

- b. BVES has acquired the contract for seasonal hourly shaped delivery from November 1, 2019 – December 31, 2022;
 - c. Any daily imbalances are either purchased or sold through the CAISO market; and
 - d. BVES plans to meet GHG emissions benchmark by focusing on procuring competitive PPAs for renewable power supply. This includes filling the gap in its portfolio due to the delay of the solar project and, over time, changing term lengths for future system power seasonal and baseload contracts and procure unit specific renewable resources as available.
- 3. Develop a pathway to deploy approximately 5 MW total capacity solar PV project:
 - a. BVES has secured a new site location and conducted preliminary studies to assure viability of the projects;
 - b. BVES has begun the process of negotiating a purchase and sales agreement and plans to submit an application to the Commission in 2023; and
 - c. The RECs and energy generated from this project will hedge BVES for future RPS and IRP compliance terms.
 - d. BVES will continue to update the Commission as concrete implementation steps materialize.
- 4. Local, flex, and system RA capacity obligations:
 - a. BVES continues to seek new RA contracts, facing significantly higher costs for capacity since California reserve margins may drop below 15 percent unless additional resources are brought online, stimulating higher capacity prices and therefore, higher RA prices, in the power market;
 - b. Securing cost competitive or any RA contracts has been a challenging issue among most LSEs in California, including BVES;
 - c. BVES's BVPP is not an eligible RA program resource for local capacity requirements; and
 - d. BVES will continue to frequently solicit RFPs for RA capacity contracts in a commercially reasonable manner in an effort to procure additional RA capacity.
- 5. BESS facility:
 - a. BVES conducted a battery study with an outside consultant and is currently working with a vendor to install a battery solution; and
 - b. Plans to implement the initial approval steps for an approximate 5 MW BESS device after working with the outside consultant.
- 6. Secure firm future renewable energy only contracts
 - a. Focus on firm RE supply starting in 2024; and
 - b. Two additional blended firm RE PPAs over the course of the planning horizon
- 7. Expand capacity to provide supplemental service to BVES's largest customer:
 - a. BVES's largest customer, the Snow Summit ski resort, plans to retire its diesel fueled power generation; and
 - b. The Commission recently approved an Added Facilities Agreement between BVES and Snow Summit to construct and operate facilities to increase the capacity to provide supplemental service to the Snow Summit ski resort.
- 8. DACs and Community Engagement:
 - a. Within 2024, BVES will engage its community and the local geographic area to gain insights for its next IRP update, which will expand its existing quarterly meeting practice

- with access and functional needs and public safety partner groups to better represent external feedback and incorporate direct needs of its ratepayers and the local region.
- b. Starting in summer 2024, provide more awareness to GHG and particulate health impacts added to existing community awareness campaigns, especially where relevant to energy resource emissions and/or wildfire smoke during fire season.
9. Demand side management:
- a. BVES uses electric vehicle pilot program, time of use rate program, and energy efficiency in an effort to optimize load patterns to achieve higher load factor.
 - b. Transportation Electrification Pilot Program:
 - i. BVES began the process of implementing this program and will track adoption and success rates; and
 - ii. At the time of this filing at least 15 residential customers (and one commercial customer) are in the process of acquiring EV charging stations at their residence.
 - c. Lighting EE Program:
 - i. BVES has successfully implemented two EE programs and is considering new programs for BVES customers. BVES has one active EE program as part of its Energy Savings Assistance (ESA) program.³⁹
 - d. Investigation into TOU rate structure:
 - i. Pilot study program for a TOU incentive rate for EV and EV charger customers.

a. Proposed Procurement Activities and Potential Barriers

The LSE should provide responses for each of the following resource categories:

- i. Resources to meet D.19-11-016 procurement requirements

Not applicable. BVES was not assigned an additional procurement obligation in D. 19-11-016.

- ii. Resources to meet D.21-06-035 procurement requirements, including:

Not applicable. BVES was not assigned an additional procurement obligation in response the mid-term reliability analysis in D.21-06-035. This response addresses the following subcategories below relating to this Commission Decision.

- a. 1,000 MW of firm zero-emitting resource requirements

Not applicable. BVES was not assigned an additional procurement obligation in response the mid-term reliability analysis in D.21-06-035.

³⁹ The ESA program, funded through the Public Purpose Program Adjustment Mechanism, is available only for qualifying low-income residential customers. The ESA Program provides funding for energy efficient refrigerators, hard-wired compact fluorescent fixtures, compact fluorescent bulbs, LEDs, smart strip surge protectors, low-flow showerheads and weatherization measures. BVES also provides educational materials to all customers promoting the use of energy efficient appliances, weatherization materials, thermostatic controls, and lifestyle changes.

b. 1,000 MW of long-duration storage resource requirements

Not applicable. BVES was not assigned an additional procurement obligation in response the mid-term reliability analysis in D.21-06-035.

c. 2,500 MW of zero-emissions generation, generation paired with storage, or demand response resource requirements

Not applicable. BVES was not assigned an additional procurement obligation in response the mid-term reliability analysis in D.21-06-035.

d. All other procurement requirements

Not applicable. BVES was not assigned an additional procurement obligation in response the mid-term reliability analysis in D.21-06-035.

e. Offshore wind

Not applicable. BVES was not assigned an additional procurement obligation in response the mid-term reliability analysis in D.21-06-035.

Out-of-state wind

Not applicable. BVES was not assigned an additional procurement obligation in response the mid-term reliability analysis in D.21-06-035.

i. Other renewable energy not described above

Not applicable. BVES plans to attain 7x24 block RE PPAs, which are based on the counterparty's supply portfolio of existing generation or planned generation ahead of the contract operational date.

ii. Other energy storage not described above

Not applicable. BVES plans to attain 7x24 block RE PPAs, which are based on the counterparty's supply portfolio of existing generation or planned generation ahead of the contract operational date.

iii. Other demand response not described above

Not applicable. BVES already has a DR program in place with its largest C&I customer enabling the ability to curtail load if ever called upon. No other potential barriers are considered in this analysis.

iv. Other energy efficiency not described above

Not applicable. BVES maintains its energy efficiency program and does not find any potential barrier or proposed activity to report.

v. Other distributed generation not described above

Not applicable. BVES has no other additional DER potential barriers to address for this analysis.

vi. Transportation electrification, including any investments above and beyond what is included in Integrated Energy Policy Report (IEPR)

Not applicable. BVES did not find additional insight into transportation electrification beyond what is discussed in the IEPR.

- vii. Building electrification, including any investments above and beyond what is included in Integrated Energy Policy

Not applicable. BVES did not find additional insight into building electrification beyond what is discussed in the IEPR.

BVES does not have direct activities that necessitate approval from the Commission through this IRP filing. In order to implement the Preferred Conforming Portfolios and reduce forecasted GHG emissions attributed to BVES supply, BVES will investigate all available resource procurement options. BVES will consider other local supply options and storage solutions as a hedge for supply cost, an instrument for increasing capacity, and a means of reducing carbon emissions during the timeframe of this IRP. For the current IRP outlook, the PPAs for system power will continue to supply power through 2024 and any shortfalls will be addressed with wholesale power purchases until an anticipated RE 24x7 block PPA is successfully contracted. BVES will continue its efforts to develop a pathway forward to deploy a utility-scale and owned solar PV facility as well as the BESS.

Table 23: BVES Power Procurement Summary

RDT Resource Procurement Plan Summary				
Resource Type	Procurement Plan	Correspondence to Proposed Activities	Potential Barriers	Resource Viability
_New_generic_solar_1axis	Utility-owned solar generating plant directly supplying the BVES distribution system	Addresses #3 in the action plan	Contracting and construction timelines; potential delays due to uncontrolled factors and pricing	BVES does not require financing or interconnection process for this project.
_new_generic_battery_storage	Utility-owned, standalone storage facility Li-Ion or flow technology	Addresses #5 in the action plan	Contracting and construction timelines; siting constraints; potential delays due to uncontrolled factors	BVES does not require financing or interconnection process for this project.
_existing_generic_unknown	Currently negotiation with a counterparty for a ten-year contract to supply nearly one third of supply needs with bundled REC and capacity products	Addresses #2 and #6 in the action plan	In-state PPAs may not be available or cost competitive; counterparty risk concerns; competition for firm RE PPAs; cost prohibited investments; may have to procure out-of-state	BVES does not require financing for this PPA
_existing_generic_unknown	Seeking to replicate the initial firm RE PPA contract to provide up to two-thirds of RE firm 7x24 contracts to replace termed system power PPAs	Addresses #2 and #6 in the action plan	In-state PPAs may not be available or cost competitive; counterparty risk concerns; competition for firm RE PPAs; cost prohibited investments; may have to procure out-of-state	BVES does not require financing for this PPA

RDT Resource Procurement Plan Summary				
Resource Type	Procurement Plan	Correspondence to Proposed Activities	Potential Barriers	Resource Viability
_existing_generic_unknown	Seeking to replicate the initial and second firm RE PPA contracts to supply nearly all BVES's load with RE firm 7x24 contracts, replacing the system power PPAs once they expire	Addresses #2 and #6 in the action plan	In-state PPAs may not be available or cost competitive; counterparty risk concerns; competition for firm RE PPAs; cost prohibited investments; may have to procure out-of-state	BVES does not require financing for this PPA
_Unspecified_non_import	In effort to reduce system power reliance, seeking 75-85 percent initially of current base annual contract amounts after current contract expires	Addresses #2 in the action plan	Prioritizing renewable PPA procurement, BVES may have to rely on system power contracts and day ahead purchases in the interim but forecasts to require the conservative presentations of unspecific system power within its power mix by 2035	BVES does not require financing for this PPA
_Unspecified_non_import	BVES plans to support its peak periods with seasonal firm contracts for an additional term that aligns with renewable power contracting plans	Addresses #2 in the action plan	Prioritizing renewable PPA procurement, BVES may have to rely on system power contracts in the interim but forecasts to require the conservative presentations of unspecific system power within its power mix by 2035	BVES does not require financing for this PPA

BVES aims to minimize criteria air pollutants through the proposed initiatives in this IRP to provide air quality benefits to part-time and permanent residents within its service area through the planned utility-owned renewable generation projects. As discussed in this IRP, BVES does not have disadvantaged communities that would warrant additional outreach or input relative to these proposed activities. BVES will continue its efforts to implement steps for the solar facility and BES solution projects, secure renewable firm PPAs, issue RFPs for available local, flex, and system RA capacity, and exhaust its ten-year PCC 3 REC contract strategy and replace it with bundled energy and REC product contracts to hedge for its long-term supply needs as well as to meet the state objectives of GHG emissions reduction from retail electricity sales as available. Net baseline supply will otherwise be supported by short-term PPAs for system power or unit-specific renewable power purchases as the utility phases in new renewable energy contracts to its power content mix.

Table 24: BVES Procurement Implementation Summary

RDT Procurement Plan Execution					
Resource Type	RDT Resource Line #	Contract Anticipated Start ⁴⁰	Solicitation Type	Solicitation Plan	Notes
_New_generic_solar_axis	6	12/1/2024	System design elements and construction needs	Reengage contract negotiations for phased deployment; BVES withdrew prior applications and is working with an external party for the design phase	Bear Valley Solar Plant, solar, 5 MW
new_generic_battery_storage	7	12/1/2024	RFPs for system design elements and construction needs; siting needs	Issue solicitations as siting is secured	Bear Valley Electric Service Battery Storage Project, Li-ion or Flow storage, 5 MW with four-hour discharge
generic_unknown	23	11/1/2024	RFPs for available competitive RE 7x24 block PPAs; BVES is currently in negotiations with a counterparty	Negotiations with counterparty	No locational preference, full contract supply, assumes unit-specific solar and wind is currently available for power purchase agreement; bundled with RECs and capacity
generic_unknown	24	1/1/2029	RFPs for available competitive RE 7x24 block PPAs	Begin developing RFPs immediately after the operational date of the first RE PPA	No locational preference, full contract supply, assumes unit-specific solar and wind is currently available for power purchase agreement; bundled with RECs and capacity
generic_unknown	25	1/1/2034	RFPs for available competitive RE 7x24 block PPAs	Begin developing RFPs after the operational date of the second RE PPA	No locational preference, full contract supply, assumes unit-specific solar and wind is currently available for power purchase agreement; bundled with RECs and capacity
unspecified_non	21	11/1/2024	Solicitations will be issued for system	Harden netted system energy needs as firm RE	BVES plans to execute a shorter-term contract for

⁴⁰ Contract start dates are estimated based on this IRP cycle, the IEPD demand forecast, and the state of decision-making under the BVES' senior leadership approval process.

RDT Procurement Plan Execution					
Resource Type	RDT Resource Line #	Contract Anticipated Start ⁴⁰	Solicitation Type	Solicitation Plan	Notes
	22	1/1/2023	power as a net resource as renewable PPAs are acquired	7x24 PPA contracts come online	annual firm delivery and seasonal energy to support high load months as all firm RE PPAs come online
sellers_choice	8	1/1/2023			
	9	1/1/2024			
	10	1/1/2025			
	11	1/1/2026			
	12	1/1/2027	BVES will issue		
	13	1/1/2028	Request for offers (RFOs) in continued effort to hedge its capacity reservation requirements	BVES must purchase its capacity amounts to meet RA obligations through contracts	Anticipating the need to secure future system RA capacity contracts through 2035
	14	1/1/2029			
	15	1/1/2030			
	16	1/1/2031			
	17	1/1/2032			
	18	1/1/2033			
19	1/1/2034				
20	1/1/2035				

As a prudent utility, BVES assumes a low-risk posture. BVES seeks greater certainty in total power supply costs through long-term contracts rather than risk substantial upward price movements in the volatile spot market. For many years, BVES has been able to fix a large percentage of its total power supply costs through long-term PPAs. This has allowed BVES to reduce its exposure to market price uncertainty, but BVES still faces other sources of risk. BVES takes into account the Value at Risk (VAR) when determining how much of its future energy supplies to purchase through long-term PPAs. The VAR is a measure of how much total costs change when underlying variables, such as natural gas prices, change. Steps taken or under consideration to mitigate VAR include the following:

- use of assets such as gas fired generation, which indexes power prices to natural gas prices;
- use of solar project(s) to fix prices to the cost of capital of the solar facility;
- use of physical call options with fixed strike prices to cap power prices; and
- battery applications to condition the system load and facilitate asset and contract coverage are under review at this time.

Two major goals in risk management strategy of BVES resources are as follows. 1) Meet the capacity of the firm customers first and interruptible customers second, and 2) secure favorable prices through a competitive bid process for future energy requirement expenditures via fixed price contracts for both interruptible and non-interruptible customers, addition of utility owned solar capacity, and the conditioning of system load to fit assets and contracts through batteries. Additional risks BVES faces include forecast accuracy, market-price fluctuations, regulatory uncertainty, unplanned supply constraints, counterparty decision making, customer behavior, or any combination thereof. The growing portion of energy consumption from customer-owned distributed generation via the NEM program and its successor tariff is also a significant concern. BVES continues to closely monitor customer DG growth and will reassess resource requirements in future IRPs.

Forecast risk is the risk associated with over- or under-forecasting BVES's retail requirements and having either too much or too little energy under long-term PPAs, requiring that BVES either buy at higher than expected costs in the spot market or sell surplus energy from existing contracts at a loss.⁴¹ BVES mitigates this risk by improving on forecasting models, using multiple models (regression, statistically adjusted end-use, conditional demand analysis models for individual customers) for long-term and mid-term forecasting periods, and neural network models for next day forecasting.

Market-price risk is the risk associated with entering into long-term PPAs with wholesale prices subsequently falling, such that BVES could have purchased the energy less expensively in the short-term or spot market. Conversely, if BVES chooses not to enter into a long-term PPA at current prices and then prices rise, BVES's price of power could rise dramatically as compared to not locking in prices at current rates. To mitigate market-price risk, BVES's planning assumptions utilize the forecasting of IHS-Cambridge Energy Research Associates (CERA) experts in global and regional economic trends, all facets of energy markets, policy assessments, and industry practices. IHS-CERA fully integrates all of the forecast products into one harmonious determination of available power fuels markets, and economy. The firm is well connected with energy, policy, manufacturing, and service sector leaders. Scenario analysis is also incorporated in the IHS-CERA support of BVES's IRP planning process. BVES incorporates this external analysis into the internal analysis used to plan for its future resource needs.

Counterparty risk is the risk that a counterparty defaults on its obligations and BVES incurs additional costs to replace energy contracted from the counterparty. To attempt to mitigate this risk, BVES utilizes collateral requirements and parent company guarantees to the extent possible. BVES also attempts to deal primarily with companies that have good credit ratings.

BVES cannot avoid all risk. Risk that cannot be avoided is managed to the extent feasible. Although BVES cannot control the actions of the market or other entities, BVES seeks to design its resource acquisition strategy to minimize the potential financial impacts of forecast and market risk. For example, BVES has fixed the price of roughly 90 percent of its energy requirements until new renewable contracts come online through the acquisition of competitively priced long-term PPAs, which minimizes the impact of sudden price spikes in the spot market. BVES's planned new generation assets of solar and battery storage should secure supply and offer price hedges tied to another source. This is in addition to the planned competitive RE 7x24 block PPAs. Diversity of resources is a key element in the development of the capacity mix available to BVES.

BVES will seek to meet its RA obligation based on its contribution to monthly CAISO coincident peak load and will offset its peak with the use of the BVPP as a DER BTM resource and future batteries. Local RA and flexible capacity requirements will remain an area of focus for BVES. BVES will continue to seek use of RA contracts, solar production, and energy storage to meet all of the flexible, local, and system RA requirements in the future. BVES continues to promote the benefits of reduced consumption, in line with state goals and regulatory policies.

Regulatory risk is the risk of changes in regulations or new regulations that increase BVES's cost of doing business. For example, if BVES takes actions to meet current regulations and regulations are subsequently changed, BVES may incur increased and unforeseen costs to (1) undo earlier actions, and

⁴¹ BVES is refining its Load Research Project to improve forecasts; specifically, future plans are to include addition of more refined customer data via, among other methods, a pole top collection system.

(2) meet the new regulations. To mitigate regulatory risk, BVES utilizes a number of resources to assess current and future policy affecting California energy markets. BVES utilizes various legal and market consultants as well as internal subject matter experts to fully assess options that BVES should take in planning for the future. BVES will continue to monitor, assess, and reduce, where possible, its regulatory risk at both the federal and state levels. Different or new energy and environmental goals, at both the federal and state levels, could add new complexity and costs to BVES's operations. Any proposed changes, both at the federal and state level, will be taken into consideration by BVES in its integrated resource planning process.

b. Disadvantaged Communities

While BVES does not have disadvantaged communities within its direct service territory, the LSE recognizes that air pollution transcends geographic boundaries. In understanding this, BVES notes that GHG emissions can affect any population within the San Bernardino County, which includes nearby disadvantaged areas. Accordingly, BVES is committed to minimizing emissions and any potential cross-regional impacts, particularly on these communities. BVES is actively advancing its long-term strategy to decrease reliance on system power by enacting its Preferred Conforming Portfolios that include 7x24 block renewable power, which emits no greenhouse gases. This will significantly reduce the accounting of GHG emissions for BVES over time.

To ensure all community members can access updated energy resource information, BVES provides materials in the predominant languages spoken in the community. Apart from English, no other major languages are predominantly spoken within the service territory.⁴² General outreach was curtailed during the last IRP cycle due to the COVID-19 pandemic and adaptation from the approved 2020 IRP filed plan. Webpage updates provided IRP materials and notices to alert residents of changes to the 2020 and 2022 IRPs and updated procurement strategy.

BVES adhered to traditional outreach methods such as email notices, bill inserts, and media announcements related to planned procurement projects when communicating the IRP results. However, the LSE acknowledges the importance of direct stakeholder feedback in shaping the Preferred Conforming Portfolio, particularly from disadvantaged groups. Recognizing the absence of formal stakeholder engagement workshops in the 2020 and 2022 IRP cycles, BVES is dedicated to incorporating structured feedback sessions and direct engagement in future IRP processes.

Future IRP submissions will feature an overview of the mechanisms performed in capturing insights of underrepresented community members, particularly those in medical baseline or access and functional needs groups, ensuring their perspectives significantly shape strategic planning. BVES notes that forthcoming efforts will focus on enhanced communication and stakeholder engagement to discuss the procurement plan as an approach to also mitigate perceived rate shock from switching from seasonal and firm system power contracts to renewable resources and articulate the benefits of transitioning to a cleaner power supply portfolio. These efforts will be detailed further in upcoming IRP filings.

⁴² This parameter involved conducting surveys in previous years to identify if there were over 1,000 residents within its service area who primarily speak languages other than English.

Additionally, BVES acknowledges the presence of vulnerable populations, such as those on medical baselines or with access and functional needs and strives to tailor its support services to enhance their resilience and safety. BVES further acknowledges that while tribal communities do not exist within the service area, the utility appreciates its external relationships with tribal agencies, which share boundaries with USFS lands. Through targeted initiatives and planned stakeholder meetings ahead of the next IRP filing, BVES reaffirms its commitment to inclusivity and proactive engagement across all segments of the community.

c. Commission Direction of Actions

Not applicable.

This prompt is not applicable to BVES at this time as procurement decisions are made through alternative Commission procedures. BVES does not seek any new actions from the Commission at this time related to its procurement forecasts for its two Preferred Conforming Portfolio scenarios.

V. Lessons Learned

BVES appreciates the opportunity to present Conforming and Preferred Portfolio scenarios to the Commission to help meet overall objectives of an optimized resource planning portfolio under the Standard Plan template since the 2020 IRP cycle. The Commission's approach for this IRP's analysis established uniform assumptions that enable standardized comparisons across all LSEs and transfer easily into the Reference System Plan. This provides an achievable avenue for the Commission and state agencies/entities to develop an achievable pathway to successfully reduce electric sector GHG emissions and meet state mandates. BVES understands this pathway and has adapted its internal processes to remain compliant with and not conflict with biannual IRP compliance filings and long-term plan updates.

BVES has historically relied on unspecified power contracts as a least-cost option for reliable supply as unspecified system power contracts are generally more cost-favorable for long-term resource planning. BVES, however, presents in this IRP a new roadmap for meeting GHG emissions benchmarks and reducing reliance on CAISO system power along with deployment of the storage and solar facilities. BVES's current primary energy supply resource is categorized as unspecific system power and thus is tied to carbon intensity of natural gas dispatch on the CAISO-controlled grid in modeling emissions through 2035, which BVES does not believe is a true reflection of the California power mix. While internal methodology takes into account the resource mix profile of SCE's service territory for local emissions supply mix forecasts, BVES understands the applied dispatch conditions and calculated emissions allocated to LSEs that aim to account for generating units called upon by the CAISO to meet BVES load center demand and therefore necessitates an evaluation of the CAISO system mix profile for more accurate carbon emission accounting. BVES presents a common planning concern regarding potential rate impact to its customers for the discussed activities to seek clean energy power delivery agreements.

BVES requests that the Commission consider modifying the CSP modeling capabilities to allow for overwriting the proportional GHG emissions assigned to LSE dependent on system power contracts with

the California system supply mix incorporating clean energy delivery in order to, at minimum, compare prior carbon accounting methodologies with the conditional weights presented in the CPUC's CSP model assumptions in this IRP cycle. BVES also requests further discussion surrounding the incorporation of PCC 2 and PCC 3 REC products in the CSP modeling methodology and the alignment against the RPS program compliance periods and unbundled REC retirements.

Glossary of Terms

Alternative Portfolio: LSEs are permitted to submit “Alternative Portfolios” developed from scenarios using different assumptions from those used in the Preferred System Plan with updates. Any deviations from the “Conforming Portfolio” must be explained and justified.

Approve (Plan): the CPUC’s obligation to approve an LSE’s integrated resource plan derives from Public Utilities Code Section 454.52(b)(2) and the procurement planning process described in Public Utilities Code Section 454.5, in addition to the CPUC obligation to ensure safe and reliable service at just and reasonable rates under Public Utilities Code Section 451.

Balancing Authority Area (CAISO): the collection of generation, transmission, and loads within the metered boundaries of the Balancing Authority. The Balancing Authority maintains load-resource balance within this area.

Baseline resources: Those resources assumed to be fixed as a capacity expansion model input, as opposed to Candidate resources, which are selected by the model and are incremental to the Baseline. Baseline resources are existing (already online) or owned or contracted to come online within the planning horizon. Existing resources with announced retirements are excluded from the Baseline for the applicable years. Being “contracted” refers to a resource holding signed contract/s with an LSE/s for much of its energy and capacity, as applicable, for a significant portion of its useful life. The contracts refer to those approved by the CPUC and/or the LSE’s governing board, as applicable. These criteria indicate the resource is relatively certain to come online. Baseline resources that are not online at the time of modeling may have a failure rate applied to their nameplate capacity to allow for the risk of them failing to come online.

Candidate resource: those resources, such as renewables, energy storage, natural gas generation, and demand response, available for selection in IRP capacity expansion modeling, incremental to the Baseline resources.

Capacity Expansion Model: a capacity expansion model is a computer model that simulates generation and transmission investment to meet forecast electric load over many years, usually with the objective of minimizing the total cost of owning and operating the electrical system. Capacity expansion models can also be configured to only allow solutions that meet specific requirements, such as providing a minimum amount of capacity to ensure the reliability of the system or maintaining greenhouse gas emissions below an established level.

Certify (a Community Choice Aggregator Plan): Public Utilities Code 454.52(b)(3) requires the CPUC to certify the integrated resource plans of CCAs. “Certify” requires a formal act of the Commission to determine that the CCA’s Plan complies with the requirements of the statute and the process established via Public Utilities Code 454.51(a). In addition, the Commission must review the CCA Plans to determine any potential impacts on public utility bundled customers under Public Utilities Code Sections 451 and 454, among others.

Clean System Power (CSP) methodology: the methodology used to estimate GHG and criteria pollutant emissions associated with an LSE’s Portfolio based on how the LSE will expect to rely on system power on an hourly basis.

Community Choice Aggregator: a governmental entity formed by a city or county to procure electricity for its residents, businesses, and municipal facilities.

Conforming Portfolio: the LSE portfolio that conforms to IRP Planning Standards, the 2030 LSE-specific GHG Emissions Benchmark, use of the LSE's assigned load forecast, use of inputs and assumptions matching those used in developing the Reference System Portfolio, as well as other IRP requirements including the filing of a complete Narrative Template, a Resource Data Template and Clean System Power Calculator.

Effective Load Carrying Capacity: a percentage that expresses how well a resource is able avoid loss-of-load events (considering availability and use limitations). The percentage is relative to a reference resource, for example a resource that is always available with no use limitations. It is calculated via probabilistic reliability modeling, and yields a single percentage value for a given resource or grouping of resources.

Effective Megawatts (MW): perfect capacity equivalent MW, such as the MW calculated by applying an ELCC % multiplier to nameplate MW.

Electric Service Provider: an entity that offers electric service to a retail or end-use customer, but which does not fall within the definition of an electrical corporation under Public Utilities Code Section 218.

Filing Entity: an entity required by statute to file an integrated resource plan with CPUC.

Future: a set of assumptions about future conditions, such as load or gas prices.

GHG Benchmark (or LSE-specific 2030 GHG Benchmark): the mass-based GHG emission planning targets calculated by staff for each LSE based on the methodology established by the California Air Resources Board and required for use in LSE Portfolio development in IRP.

GHG Planning Price: the system wide marginal GHG abatement cost associated with achieving a specific electric sector 2030 GHG planning target.

Integrated Resources Planning Standards (Planning Standards): the set of CPUC IRP rules, guidelines, formulas and metrics that LSEs must include in their LSE Plans.

Integrated Resource Planning (IRP) process: integrated resource planning process; the repeating cycle through which integrated resource plans are prepared, submitted, and reviewed by the CPUC

Long term: more than 5 years unless otherwise specified.

Load Serving Entity: an electrical corporation, electric service provider, community choice aggregator, or electric cooperative.

Load Serving Entity (LSE) Plan: an LSE's integrated resource plan; the full set of documents and information submitted by an LSE to the CPUC as part of the IRP process.

Load Serving Entity (LSE) Portfolio: a set of supply- and/or demand-side resources with certain attributes that together serve the LSE's assigned load over the IRP planning horizon.

Loss of Load Expectation (LOLE): a metric that quantifies the expected frequency of loss-of-load events per year. Loss-of-load is any instance where available generating capacity is insufficient to serve electric demand. If one or more instances of loss-of-load occurring within the same day regardless of duration

are counted as one loss-of-load event, then the LOLE metric can be compared to a reference point such as the industry probabilistic reliability standard of “one expected day in 10 years,” i.e. an LOLE of 0.1.

Maximum Import Capability: a California ISO metric that represents a quantity in MWs of imports determined by the CAISO to be simultaneously deliverable to the aggregate of load in the ISO’s Balancing Authority (BAA) Area and thus eligible for use in the Resource Adequacy process. The California ISO assess a MIC MW value for each intertie into the ISO’s BAA and allocated yearly to the LSEs. A LSE’s RA import showings are limited to its share of the MIC at each intertie.

Net Qualifying Capacity (NQC): *Qualifying Capacity reduced, as applicable, based on: (1) testing and verification; (2) application of performance criteria; and (3) deliverability restrictions. The Net Qualifying Capacity determination shall be made by the California ISO pursuant to the provisions of this California ISO Tariff and the applicable Business Practice Manual.*

Non-modeled costs: *embedded fixed costs in today’s energy system (e.g., existing distribution revenue requirement, existing transmission revenue requirement, and energy efficiency program cost).*

Nonstandard LSE Plan: *type of integrated resource plan that an LSE may be eligible to file if it serves load outside the CAISO balancing authority area.*

Optimization: *an exercise undertaken in the CPUC’s Integrated Resource Planning (IRP) process using a capacity expansion model to identify a least-cost portfolio of electricity resources for meeting specific policy constraints, such as GHG reduction or RPS targets, while maintaining reliability given a set of assumptions about the future. Optimization in IRP considers resources assumed to be online over the planning horizon (baseline resources), some of which the model may choose not to retain, and additional resources (candidate resources) that the model is able to select to meet future grid needs.*

Planned resource: *any resource included in an LSE portfolio, whether already online or not, that is yet to be procured. Relating this to capacity expansion modeling terms, planned resources can be baseline resources (needing contract renewal, or currently owned/contracted by another LSE), candidate resources, or possibly resources that were not considered by the modeling, e.g., due to the passage of time between the modeling taking place and LSEs developing their plans. Planned resources can be specific (e.g., with a CAISO ID) or generic, with only the type, size and some geographic information identified.*

Qualifying capacity: *the maximum amount of Resource Adequacy Benefits a generating facility could provide before an assessment of its net qualifying capacity.*

Preferred Conforming Portfolio: *the conforming portfolio preferred by an LSE as the most suitable to its own needs; submitted to CPUC for review as one element of the LSE’s overall IRP plan.*

Preferred System Plan: *the Commission’s integrated resource plan composed of both the aggregation of LSE portfolios (i.e., Preferred System Portfolio) and the set of actions necessary to implement that portfolio (i.e., Preferred System Action Plan).*

Preferred System Portfolio: *the combined portfolios of individual LSEs within the CAISO, aggregated, reviewed and possibly modified by Commission staff as a proposal to the Commission, and adopted by the Commission as most responsive to statutory requirements per Pub. Util. Code 454.51; part of the Preferred System Plan.*

Short term: *1 to 3 years (unless otherwise specified).*

Staff: CPUC Energy Division staff (unless otherwise specified).

Standard LSE Plan: type of integrated resource plan that an LSE is required to file if it serves load within the CAISO balancing authority area (unless the LSE demonstrates exemption from the IRP process).

Transmission Planning Process (TPP): annual process conducted by the California Independent System Operator (CAISO) to identify potential transmission system limitations and areas that need reinforcements over a 10-year horizon.

ATTACHMENT B

2022 Integrated Resource Plan
Version 2 [REDLINE]


Standard LSE Plan

Bear Valley Electric Service, Inc.

2022 INTEGRATED RESOURCE PLAN

~~November~~ Version 2

May 1, 2022 2024



Bear Valley
Electric Service, Inc.
A Subsidiary of American States Water Company

I.	Executive Summary	9
II.	Study Design	16
a.	Objectives	19
b.	Methodology	20
i.	Modeling Tool(s)	20
ii.	Modeling Approach	20
III.	Study Results	23
a.	Conforming and Alternative Portfolios	23
b.	Preferred Conforming Portfolios	33
c.	GHG Emissions Results	34
d.	Local Air Pollutant Minimization and Disadvantaged Communities	37
i.	Local Air Pollutants	37
ii.	Focus on Disadvantaged Communities	40
e.	Cost and Rate Analysis	43
f.	System Reliability Analysis	50
g.	High Electrification Planning	55
h.	Existing Resource Planning	56
i.	Hydro Generation Risk Management	57
j.	Long-Duration Storage Planning	57
k.	Clean Firm Power Planning	58
l.	Out-of-State Wind Planning	58
m.	Offshore Wind Planning	58
n.	Transmission Planning	58
IV.	Action Plan	59
a.	Proposed Procurement Activities and Potential Barriers	61
i.	Resources to meet D.19-11-016 procurement requirements	61
ii.	Resources to meet D.21-06-035 procurement requirements, including:	
—	61	
a.	1,000 MW of firm zero-emitting resource requirements	61

b.	1,000 MW of long-duration storage resource requirements	61
c.	2,500 MW of zero-emissions generation, generation paired with storage, or demand response resource requirements	61
d.	All other procurement requirements.....	61
e.	Offshore wind	61
i.	Other renewable energy not described above.....	61
ii.	Other energy storage not described above	61
iii.	Other demand response not described above	62
iv.	Other energy efficiency not described above.....	62
v.	Other distributed generation not described above	62
vi.	Transportation electrification, including any investments above and beyond what is included in Integrated Energy Policy Report (IEPR).....	62
vii.	Building electrification, including any investments above and beyond what is included in Integrated Energy Policy Report	62
b.	Disadvantaged Communities	67
c.	Commission Direction of Actions.....	68
V.	Lessons Learned	68
	<i>Glossary of Terms</i>	70
I.	Executive Summary.....	9
II.	Study Design.....	16
a.	Objectives.....	19
b.	Methodology	20
i.	Modeling Tool(s)	20
ii.	Modeling Approach	20
III.	Study Results	23
a.	Conforming and Alternative Portfolios.....	23
b.	Preferred Conforming Portfolios.....	33
c.	GHG Emissions Results	34
d.	Local Air Pollutant Minimization and Disadvantaged Communities	37

i.	Local Air Pollutants.....	37
ii.	Focus on Disadvantaged Communities.....	40
e.	Cost and Rate Analysis.....	43
f.	System Reliability Analysis.....	50
g.	High Electrification Planning.....	55
h.	Existing Resource Planning.....	56
i.	Hydro Generation Risk Management.....	57
j.	Long-Duration Storage Planning.....	57
k.	Clean Firm Power Planning.....	58
l.	Out-of-State Wind Planning.....	58
m.	Offshore Wind Planning.....	58
n.	Transmission Planning.....	58
IV.	Action Plan.....	59
a.	Proposed Procurement Activities and Potential Barriers.....	61
i.	Resources to meet D.19-11-016 procurement requirements.....	61
ii.	Resources to meet D.21-06-035 procurement requirements, including: ___ 61	
a.	1,000 MW of firm zero-emitting resource requirements.....	61
b.	1,000 MW of long-duration storage resource requirements.....	61
c.	2,500 MW of zero-emissions generation, generation paired with storage, or demand response resource requirements.....	61
d.	All other procurement requirements.....	61
e.	Offshore wind.....	61
i.	Other renewable energy not described above.....	61
ii.	Other energy storage not described above.....	61
iii.	Other demand response not described above.....	62
iv.	Other energy efficiency not described above.....	62
v.	Other distributed generation not described above.....	62

vi. <u>Transportation electrification, including any investments above and beyond what is included in Integrated Energy Policy Report (IEPR)</u>	62
vii. <u>Building electrification, including any investments above and beyond what is included in Integrated Energy Policy Report</u>	62
b. <u>Disadvantaged Communities</u>	67
c. <u>Commission Direction of Actions</u>	68
V. <u>Lessons Learned</u>	68
<i><u>Glossary of Terms</u></i>	70

List of Figures and Tables

Figure 1: Resource Planning under 25 MMT Portfolio	18
Figure 2: Resource Planning Under 30 MMT Portfolio	18
Figure 3: Comparison of Monthly Load with Default C&I Assumption and BVES Customized C&I Assumption	22
Figure 4: Forecast Supply Mix in 2035 – 25 MMT Scenario	28
Figure 5: Forecast Supply Mix in 2035 – 30 MMT Scenario	28
Figure 6: BVES Conforming Portfolio GHG Local Emissions Results: 25 MMT Benchmark	38
Figure 7: BVES Conforming Portfolio GHG Local Emissions Results: 30 MMT Benchmark	39
Figure 8: 25 MMT LSE Capacity by Contract Status	51
Figure 9: 30 MMT LSE Capacity by Contract Status	52
Figure 1: Resource Planning under 25 MMT Portfolio	18
Figure 2: Resource Planning Under 30 MMT Portfolio	18
Figure 3: Comparison of Monthly Load with Default C&I Assumption and BVES Customized C&I Assumption	22

Figure 4: Forecast Supply Mix in 2035 - 25 MMT Scenario.....	28
Figure 5: Forecast Supply Mix in 2035 - 30 MMT Scenario.....	28
Figure 6: BVES Conforming Portfolio GHG Local Emissions Results: 25 MMT Benchmark.....	38
Figure 7: BVES Conforming Portfolio GHG Local Emissions Results: 30 MMT Benchmark.....	39
Figure 8: DACs Outside of BVES Service Territory.....	41
Figure 8: 25 MMT LSE Capacity by Contract Status.....	51
Figure 9: 30 MMT LSE Capacity by Contract Status.....	52

Table 1: 2022 IRP Cycle GHG Assigned Benchmarks.....	10
Table 2: Conforming and Preferred Portfolio Results.....	14
Table 3: BVES Assigned Load Forecast 2023 – 2035 (GWh).....	16
Table 4: BVES CSP Calculator Demand Inputs: 25 MMT and 30 MMT Scenarios.....	17
Table 5: BVES Sales Forecast and GHG Emissions Benchmark Compared to Other LSEs.....	19
Table 6: RPS Resource Custom Profile – 3 Firm RE PPAs.....	24
Table 7: Conforming Portfolio with Contract and Supply Details in 2035.....	25
Table 8: BVES Portfolio Scenarios 2023-2035.....	29
Table 9: Energy Balance Results – 25 MMT Conforming Portfolio.....	31
Table 10: Energy Balance Results – 30 MMT Conforming Portfolio.....	32
Table 11: BVES 25 MMT Conforming Scenario Carbon Dioxide Emissions Forecast.....	32
Table 12: BVES 30 MMT Conforming Scenario Carbon Dioxide Emissions Forecast.....	33
Table 13: BVES 25 MMT GHG Results Based on Clean System Power Calculator.....	35
Table 14: BVES 30 MMT GHG Results Based on Clean System Power Calculator.....	35
Table 15: Census Tracts and Demographics within BVES's Service Territory.....	43
Table 16: Revenue Requirements and Bundled System Average Rates for Baseline Scenario (2021 \$).....	46
Table 17: Revenue Requirements and Bundled System Average Rates for 25 MMT Preferred Conforming Portfolio (2021 \$).....	47
Table 18: Revenue Requirements and Bundled System Average Rates for 30 MMT Preferred Conforming Portfolio (2021 \$).....	48
Table 19: 25 MMT Load and Resource Table by Contract Status.....	50
Table 20: 30 MMT Load and Resource Table by Contract Status.....	52
Table 21: BVES Resource Mix in 2035 Compared to RSP.....	54
Table 22: Additional Contract Procurements Under High Electrification Scenario.....	56
Table 23: BVES Power Procurement Summary.....	62
Table 24: BVES Procurement Implementation Summary.....	64
Table 1: 2022 IRP Cycle GHG Assigned Benchmarks.....	10
Table 2: Conforming and Preferred Portfolio Results.....	14
Table 3: BVES Assigned Load Forecast 2023 – 2035 (GWh).....	16
Table 4: BVES CSP Calculator Demand Inputs: 25 MMT and 30 MMT Scenarios.....	17
Table 5: BVES Sales Forecast and GHG Emissions Benchmark Compared to Other LSEs.....	19
Table 6: RPS Resource Custom Profile - 3 Firm RE PPAs.....	24
Table 7: Conforming Portfolio with Contract and Supply Details in 2035.....	25
Table 8: BVES Portfolio Scenarios 2023-2035.....	29

<u>Table 9: Energy Balance Results - 25 MMT Conforming Portfolio</u>	31
<u>Table 10: Energy Balance Results - 30 MMT Conforming Portfolio</u>	32
<u>Table 11: BVES 25 MMT Conforming Scenario Carbon Dioxide Emissions Forecast</u>	32
<u>Table 12: BVES 30 MMT Conforming Scenario Carbon Dioxide Emissions Forecast</u>	33
<u>Table 13: BVES 25 MMT GHG Results Based on Clean System Power Calculator</u>	35
<u>Table 14: BVES 30 MMT GHG Results Based on Clean System Power Calculator</u>	35
<u>Table 15: Census Tracts and Demographics within BVES's Service Territory</u>	43
<u>Table 16: Revenue Requirements and Bundled System Average Rates for Baseline Scenario (2021 \$)</u>	46
<u>Table 17: Revenue Requirements and Bundled System Average Rates for 25 MMT Preferred Conforming Portfolio (2021 \$)</u>	47
<u>Table 18: Revenue Requirements and Bundled System Average Rates for 30 MMT Preferred Conforming Portfolio (2021 \$)</u>	48
<u>Table 19: 25 MMT Load and Resource Table by Contract Status</u>	50
<u>Table 20: 30 MMT Load and Resource Table by Contract Status</u>	52
<u>Table 21: BVES Resource Mix in 2035 Compared to RSP</u>	54
<u>Table 22: Additional Contract Procurements Under High Electrification Scenario</u>	56
<u>Table 23: BVES Power Procurement Summary</u>	62
<u>Table 24: BVES Procurement Implementation Summary</u>	64

Bear Valley Electric Service, Inc. (BVES) updated its 2022 Integrated Resource Plan (IRP) as a result of California Public Utilities Commission (CPUC) Rulemaking 20-05-003 proposed decision on January 19, 2024 and final decision (Decision 24-02-047) issued on February 20, 2024, which among other directives, required revisions to load-serving entity (LSE) IRPs with identified deficiencies and resubmission on May 1, 2024.¹

In response to the directives, BVES has addressed the deficiencies noted from its initial 2022 IRP submission. BVES has prepared a comprehensive revision, which includes section updates and supplementary detail focusing on the identified gaps such as incorporation of disadvantaged communities in IRP preparation and emission reduction strategies. This updated IRP has been structured to meet the CPUC's requirements and is set to be resubmitted through a Tier 2 advice letter by the deadline of May 1, 2024, as directed.

BVES prepared this update with intention to revise and update the IRP to show its consistent focus and dedication to its ratepayers and the state at large. This revision is undertaken with a firm commitment to rectifying the gaps identified in our previous filing, specifically focusing on enhancing our strategies around disadvantaged communities, even if they are not directly within our service area.

¹ CPUC. R. 20-05-003. D. 24-02-024, "Decision adopting 2023 Preferred System, Plan and Related Matters, and Addressing Two Petitions for Modification," <https://docs.cpuc.ca.gov/PublishedDocs/Published/G000/M525/K918/525918033.PDF>, pg. 19-20.

Recognizing the cross-regional impacts of air pollutants, this updated 2022 IRP details BVES's strategic path towards reducing emissions and improving communication and outreach. It details our transition to zero-emitting energy sources through the procurement of 7x24 block renewable power, alongside a detailed plan to improve our outreach and educational efforts. Additionally, this update incorporates comprehensive measures to better engage with and support medical baseline and access and functional needs groups, reflecting a deeper commitment to inclusive and sustainable energy planning.

I. Executive Summary

The 2023-2035 Integrated Resource Plan (IRP) for Bear Valley Electric Service, Inc. (BVES)² is the primary document used in planning, evaluating, and acquiring energy resources to meet the forecasted energy requirements of BVES's retail customers, consistent with goals set by the state legislature and requirements enforced by the Energy Division of the California Public Utilities Commission (hereafter, CPUC or Commission). This IRP also serves as a contributing factor to the overall electric sector profile for state regulators to prepare a pathway for load-serving entities (LSEs) to achieve 100 percent of retail energy sales coming from eligible renewable and zero-carbon resources by 2045 in accordance with Senate Bill (SB) 100 (DeLeon, Chapter 312, Statutes of 2018).³

The objective of BVES's 2023-2035 IRP is to identify reliable, best-fit, least-cost, low-carbon energy resources to serve the needs of BVES's electric customers and to provide resource portfolio scenarios that consider evaluation of supply and demand-side resources to the Commission. The amount and types of resources in the IRP must also be consistent with Commission regulations and California State laws governing, among other issues, resource adequacy (RA), renewable energy (RE), and greenhouse gas (GHG) emissions limits, and reduction targets.

IRP Proceeding History

As a result of Senate Bill (SB) 350, the Commission was directed to develop an IRP process for its regulated electric utilities and service providers for long-term resource planning needs, assuring that the collective electric sector is on track to meet GHG reduction goals with secured reliable and least-cost resources. The IRP proceeding is designed on a two-year cycle, with LSE contribution to the Commission's Reference System Plan (RSP) provided in the form of conforming portfolios and planned procurement activities within their IRPs.

The first year of the CPUC IRP cycle consists of a self-initiated process undertaken by the Commission to develop a RSP of optimal planning resources integrated to meet the state's GHG reduction targets. The Commission considers LSE IRPs in the second year of the cycle and aggregates LSE portfolios into a single system-wide portfolio, the Preferred System Portfolio (PSP). The RSP and PSP jointly provide inputs for the California Independent System Operator (CAISO) Transmission Planning Process (TPP). On February 10, 2022, the Commission adopted an optimal planning portfolio for the 2021 PSP and evaluated the 2020 individual IRP filings through Decision (D.) 22-02-004 under Rulemaking (R.) 20-05-003. The adopted PSP meets a statewide 38 million metric ton (MMT) of carbon dioxide (CO₂) GHG target for the electric sector in 2030 with 35 MMT for 2032. Commission staff adjusted the timeframe beyond 2030 to

² Bear Valley Electric Service became incorporated as a subsidiary of American States Water Company as of July 1, 2020. Hereafter, the IRP references the LSE as Bear Valley Electric Service Incorporated (BVES) and BEAR through modeling designations.

³SB 1020 (The Clean Energy, Jobs, and Affordability Act of 2022) added Interim targets to the existing policy framework established by SB 100 by requiring renewable energy and zero-carbon resources to supply 90 percent of all electric retail sales by 2035 and 95 percent by 2040.

2035 in order to add resource required under D. 21-06-035⁴ in response to the mid-term reliability assessment. The 2021 PSP decision also recommended to the CAISO that the 38 MMT PSP portfolio be utilized for both reliability and policy-driven base case for the 2022-2023 TPP. From this determination, the results urged both the Commission, CEC, and CAISO to establish a more aggressive GHG reduction case for the 2022 IRP cycle.⁵

Table 1: 2022 IRP Cycle GHG Assigned Benchmarks

Portfolio Scenario Common Title	BVES's Proportion of Total Emissions	2030 Load (GWh)	2035 Load (GWh)	2030 GHG Emissions Benchmark (MMT)	2035 Emissions Benchmark
25 MMT Benchmarks				0.014446927 ^A	0.011684697 ^B
	0.000587773	138.8195496	142.4237088		
30 MMT Benchmarks				0.019149114 ^C	0.014623564 ^D

^A Meeting the 30 MMT electric sector GHG reduction targets

^B Meeting the 25 MMT electric sector GHG reduction targets

^C Meeting the 38 MMT electric sector GHG reduction targets

^D Meeting the 30 MMT electric sector GHG reduction targets

Covering the years 2023-2035 in this IRP procedural process, the Commission established baseline assumptions and inputs that were utilized in framing the RSP. On June 15, 2022, Administrative Law Judge (ALJ) Ruling finalizing load forecasts and GHG benchmarks via R. 20-50-003. On June 28, 2022, the Commission issued the updated load forecasts and GHG benchmarks assigned to respondent LSEs through the IRP materials webpage. The Commission further updated and issued the narrative template for the IRP on June 15, 2022, the final CSP calculator on July 15, 2022, and the RDT on October 11, 2022. BVES did not elect or find the need to present an alternative portfolio for this IRP cycle. Additionally, BVES is not subject to additional procurement obligations required via D. 19-11-016⁶ or D. 21-06-035, which supported additional capacity ordering outside of the RSP and PSP adoption processes for obligated LSEs to meet urgent procurement needs.

BVES Service Area Characteristics

BVES, a subsidiary of American States Water Company, is an investor-owned utility (IOU) regulated by the CPUC. BVES provides electric service in a mountainous resort community to approximately 24,500 customers, of which approximately 22,500 are residential customers with a mix of roughly 40 percent

⁴ CPUC. Rulemaking 20-05-003, D.21-06-035 Decision Requiring Procurement to address Mid-Term Reliability (2023-2026)," <https://docs.cpuc.ca.gov/PublishedDocs/Published/G000/M389/K603/389603637.PDF>.

⁵ LSEs are required to provide portfolios for the CPUC planning target (30 MMT of GHG emissions) as well as the target of 25 MMT, which are driven by SB 350 and modified by SB 100 state objectives in achieving 100 percent of electricity sales coming from eligible renewable and zero-carbon resources by 2045. The prior 2020 IRP cycle denoted acceptable GHG benchmark levels of 46 MMT for the reliability base case and 38 MMT for the policy-driven base case.

⁶ CPUC. Rulemaking 16-02-007, D.19-11-016 "Decision Requiring Electric System Reliability Procurement for 2021-2023," <http://docs.cpuc.ca.gov/PublishedDocs/Published/G000/M319/K825/319825388.PDF>.

full-time and 60 percent part-time residents.⁷ Approximately 1,500 of the total number of customers are commercial, industrial, and public-authority customers, including two ski resorts. Additionally, approximately 500 accounts within the commercial and residential customer base are considered net energy metering (NEM) customers.

BVES's historical peak load is approximately 45 megawatts (MWs); winter monthly peaks occur when snowmaking machines at the ski resorts are operating and recreational visitors are present (generally between 5:00 pm and 11:00 pm on weekends). In the summer months, the load in BVES's service area ranges from an average minimum of about 10-12 MW (early summer mornings) to a maximum of approximately 24 MW (late evenings on holiday weekends). BVES purchases wholesale power to meet the majority of its energy requirements. To aid in meeting peak demand for electric energy, BVES installed and operates the Bear Valley Power Plant (BVPP), a natural gas-fired, 8.4 MW generation plant, with a tested heat rate of 12,000 British thermal units (Btu)/kilowatt-hour (kWh), in its service area. The BVPP became commercially operational on January 1, 2005. BVES's 45 MW peak load represents approximately 0.1 percent of the CAISO peak load.

BVES has two receipt points of power from Southern California Edison Company (SCE), which include the Goldhill transfer station and Radford Feeder. The majority of BVES's power is transmitted over SCE's 33 kilovolt (kV) subtransmission line from the Cottonwood substation to the Goldhill transfer station. The remainder of BVES's energy is transmitted over SCE's 33 kV distribution facilities from the Zanja substation near Redlands over the Radford Feeder to BVES's Village substation.⁸

BVES's distribution system is located and operates under the balancing authority (BA) of the CAISO. However, BVES does not own any transmission facilities and is not a Participating Transmission Owner (PTO) under the CAISO Tariff. BVES facilities are indirectly interconnected with the CAISO-controlled grid via wholesale distribution access facilities that are owned, controlled, and operated by SCE. These facilities are then directly interconnected with SCE transmission facilities that are part of the CAISO-controlled grid. Lastly, the BVPP does not operate under a Participating Generator Agreement (PGA) and thereby is not considered a CAISO-controlled unit under the CAISO Tariff. It should be noted that because BVES is a holder of Congestion Revenue Rights (CRRs), BVES falls under direct tariff regulation by the CAISO. BVES must indirectly adhere to the CAISO Tariff due to power scheduling and RA requirements. The requirements are imposed on BVES by its third-party schedule coordinator (SC), who must abide by the CAISO Tariff to schedule BVES's power and RA resources.⁹

IRP Process Overview & Study Findings

In this IRP, BVES includes two conforming and two preferred conforming portfolios as directed by the Commission for its proportional share of the two established benchmark targets. Consistent with BVES' inaugural Standard Plan format filing for the 2020 IRP, this 2022 IRP also follows the Standard Plan pursuant to R. 20-05-003. BVES also provides in this IRP its resource action plan through 2035, system-level planning discussions, a response addressing identification of disadvantaged communities and

⁷ Based on number of active billed accounts as of October 2022.

⁸ BVES refers to voltages on these SCE lines as 34.5 kV.

⁹ Currently APX is under contract with BVES to act as its SC and provide schedule coordination services.

supply procurement impacts, and details surrounding the modeling design and GHG emissions benchmark results using established Commission assumptions and inputs.

Carbon accounting practices at BVES had previously assumed emissions intensity alignment with the power resource mix attributed to SCE's service territory. This is supported by the condition that supply from the CAISO-controlled grid is indirectly fed onto BVES's distribution system by way of SCE infrastructure and service area.¹⁰ However, the methodology described in this IRP represents emissions factors that are assigned to LSEs with contracted system power supply and calculations supported by CPUC-driven models and assigned assumptions that address the CAISO system level proportional share to each LSE. As a result of this IRP, BVES found that additional procurement activities may be warranted in order to meet its forecasted GHG benchmark targets by 2035. These activities include securing power resources that are eligible renewable and making direct contracting agreements or market purchases for unit-specific generation. BVES plans to issue solicitations and requests for information that enable internal objectives to transition away from dependency on unspecified power generation contracts over time.

BVES is also in a hedged position in meeting the goals of the California Renewable Portfolio Standard (RPS) through its strategy in securing Renewable Energy Credits (RECs) contracts. In late 2011, D.11-12-052 defined and implemented portfolio content categories (PCCs). Most retail sellers subject to the RPS must procure certain quantities from each of the PCCs. The PCCs, in brief summary, consist of:

1. Generation facilities that have their first point of interconnection to the Western Electricity Coordinating Council transmission grid within the metered boundaries of a California BA area (PCC 1);¹¹
2. Generation from a facility that is firmed and shaped with substitute electricity scheduled into a California BA within the same calendar year as the generation from the facility eligible for the RPS, and that the substitute electricity provides incremental electricity (PCC 2); and
3. Other products like unbundled RECs that do not apply to the first two categories (PCC 3).

Of importance, D.11-12-052 confirmed that BVES may satisfy its RPS obligations without regard to the PCC limitations to which most other retail sellers must adhere. Since BVES is exempt from following the product content categories distribution, it has complied with the majority of its RPS requirements with unbundled RECs (e.g., PCC 3) to the greatest extent allowed because it is the least expensive option of the RPS-eligible products. In meeting IRP requirements, BVES understands that PCC 2 and PCC 3 RECs are ineligible for the purposes of GHG emissions benchmark targets. As such, and in aligning with clean power adoption targets, BVES has adapted its previous 2020 IRP preferred portfolio to account for bundled, firm RE PPAs, for which it expects to meet future RPS compliance periods as well as meeting applicable standards for the IRP CSP model under varying GHG benchmark thresholds.

BVES faces constraints in substantially expanding its utility-owned renewable generation buildout due to factors such as limited large parcels being available in its remote service territory and the utility is not

¹⁰ SCE, "2021 Power Content Label", <https://www.sce.com/sites/default/files/custom-files/Web%20files/2021%20Power%20Content%20Label.pdf>.

¹¹ Procurement claims from contract/ownership agreements executed before June 1, 2010, or January 13, 2011, for ESPs, are not subject to the PCC classifications established in D.11-12-052. For the purposes of RPS compliance, any eligible RPS RECs that are not subject to PCC 1, 2, or 3 will be placed in their own classification, referred to as PCC 0.

directly connected to the CAISO controlled grid. BVES will investigate the viability to procure unit-specific eligible resources that are wheeled in by the CAISO market as well as plans to secure contracts for firm renewable resources. BVES is in the process of revising its plans and resubmitting an Advice Letter for a solar photovoltaic (PV) plant coming online, (at this time planned for the fourth quarter (Q4) of 2024), which will help to support the ability to meet GHG reduction obligations, reduce reliance on wholesale power, and generate RECs for future compliance periods of the RPS. Additionally, BVES has recently worked with a third-party to develop a cost-benefit study to determine the feasibility in procuring a utility-scale battery energy storage solution (BESS) in its service territory. The current planned implementation target is also in late 2024 or early 2025 at the latest. For the purpose of the IRP modeling exercises, BVES has indicated a Q4 2024 operating date. These systems, however, are not currently planned to be hybridized.

Currently supplied primarily by shaped and firm unspecified system power contracts, BVES will continue to seek cost-appropriate renewable energy contracts and eligible renewable projects to assist in moving away from system power supply contracts over time to meet the 2035 benchmark and state energy sector GHG reduction targets.

Additional results from this IRP include the determination of net qualifying capacity (NQC) targets through 2035. BVES's latest contract for RA capacity expired in 2021. Efforts to procure additional RA capacity contracts to meet RA obligations are continuing through frequent, additional bid requests.

Preferred Portfolio & Action Plan

BVES is not seeking additional procurement actions from the Commission under its Preferred Conforming scenario through this IRP filing. BVES has historically accounted for its cost-effective, firm system power PPAs, owned BVPP, energy efficiency activities, demand response (DR) programs, and behind-the-meter (BTM) distributed energy resources (DER). BVES continues to plan for an owned solar facility supplying the BVES system, standalone BESS configuration, as well as migrating to a nearly 100 percent clean power delivery strategy through contracted firm renewable energy PPAs by 2035. Through these power supply planning characteristics, along with assigned load modifiers and the forecasted demand increase through 2035 by the most recent CEC Integrated Energy Policy Report (IEPR), BVES modeled future supply needs aligning with calculations and assumptions prescribed by the CPUC.

This analysis has resulted in an action plan that meets assigned GHG benchmarks and can be achieved over the planning horizon. Activities proposed to rapidly decrease BVES forecasted GHG emissions through energy supply management include: deploying the solar PV and battery storage projects over the next two-to-three years, obtaining cost-competitive firm RE contracts, and securing short-term system power contracts through 2035 to meet supply shortfalls aligning with state goals. Additionally, BVES will maintain awareness of local community impacts and maintain prudent utility responsibility to provide reliable, least-cost energy to all customers.

When using the CEC IEPR 2021 load modifiers and the assigned load forecast, BVES modeled its supply needs for future renewable contracts based on its ability to meet benchmarks for GHG emissions under the CPUC assumptions for carbon intensity of system power. BVES presents in this IRP Conforming Portfolio Scenarios for its proportional share among LSEs. At this time, BVES's greatest energy supply

coming from firm energy seasonal and annual contracts is characterized as unspecified “brown” energy representing available, reliable, cost-effective delivery capabilities. BVES recognizes that the modeling scenarios incorporate carbon intensity measurements for system power mapped to that of dispatchable natural gas resources as it assumes no generating units in specific hours in addition to natural gas generation.

Table 2 presents BVES’s Conforming and Preferred Portfolio results for both GHG benchmarks for 2035. BVES generated two supply portfolios that conform to the IRP requirements. Both are considered for the preferred portfolio selection. While BVES illustrates both the 25 MMT and 30 MMT scenarios, the primary preferred portfolio aligns with the 30 MMT scenario. After completing the IRP analysis, BVES modeled portfolios where emissions targets reach just below the assigned threshold benchmarks.

Table 2: Conforming and Preferred Portfolio Results

Assumptions	Supply Side Resources	BVES 2030 Assigned Load Forecast (GWh)	BVES 2035 Assigned Load Forecast (GWh)	Assigned 2030 Emissions Benchmark (MMT)	Assigned 2035 Emissions Benchmark (MMT)	IRP GHG Emissions Results 2030 (MMT)	IRP GHG Emissions Results 2035 (MMT)
Conforming Portfolio Scenario (a)							
<ul style="list-style-type: none"> Benchmarked against 25 MMT GHG threshold CEC IEPR load modifiers CEC IEPR demand side modifiers Resource generation output using CPUC assumptions and capacity factors Adjusted percent to 40 for C&I load through 2035 	See Error! Reference source not found.	138.82	142.42	0.01446927	0.011684697	0.01154	0.01068
Conforming Portfolio Scenario (b)							
<ul style="list-style-type: none"> Benchmarked against 30 MMT GHG threshold CEC IEPR load modifiers CEC IEPR demand side modifiers Resource generation output using CPUC assumptions and capacity factors Adjusted percent to 40 for C&I load through 2035 	See Figure 2	138.82	142.42	0.019149114	0.014623564	0.01819	0.01402

Assumptions	Supply Side Resources	BVES 2030 Assigned Load Forecast (GWh)	BVES 2035 Assigned Load Forecast (GWh)	Assigned 2030 Emissions Benchmark (MMT)	Assigned 2035 Emissions Benchmark (MMT)	IRP GHG Emissions Results 2030 (MMT)	IRP GHG Emissions Results 2035 (MMT)
Secondary Preferred Conforming Portfolio Scenario							
• Equal to Conforming Scenario (a) assumptions	See Error! Reference source not found.	138.82	142.42	0.0144446927	0.011684697	0.01154	0.01068
Primary Preferred Conforming Portfolio Scenario							
• Equal to Conforming Scenario (b) assumptions	See Figure 2	138.82	142.42	0.019149114	0.014623564	0.01819	0.01402

This IRP narrative discusses the objectives for the planning horizon, which aims to secure competitive bundled RE power purchase agreements (PPAs) that will replace phased out system power contracts, deploy both a battery storage device and solar generating facility within the BVES territory, and leverage BVES’s existing load characteristics and peaker plant to account for any supply shortfalls in addition to spot market purchases. This IRP presents the study results of the conforming and preferred scenarios under both the 25 MMT and 30 MMT GHG reduction scenarios, the action plan in achieving the supply plan, and ongoing lessons over the last IRP cycles.

The study design in Section II will cover the methodology utilized to develop the analyses and modeling tools and approach. The study results, as discussed in Section III, address the conforming and any viewed alternative portfolios as well as indicate the final preferred conforming portfolios selected out of the completed analysis. This section will also address the final GHG emissions results and any local air pollutants with particular focus on disadvantaged communities. This section similarly describes the cost and rate analysis for the baseline case and both portfolio cases, system reliability analysis, and several power supply planning opportunities and challenges regarding areas such as high electrification planning, existing versus new build planning, hydro, long-duration storage, wind, and transmission planning, as well as addressing how BVES will work towards achieving clean firm power contracts.

The section covering the action plan presents the proposed procurement activities and potential barriers for success, as well as additional procurement obligations for required capacity planning. While BVES is not subject to either release of the procurement obligations, it addresses the subsections accordingly. The final subsections will respond to prompts addressing disadvantaged communities, any Commission direction requests, and a summary of BVES’s lessons learned.

II. Study Design

The following describes the study design for the 2022 IRP.

Load Assignments for Each LSE

For the 2023-2035 IRP, BVES performed a study designed on key factors that impact supply and demand side needs through the forecast period. As directed by the Commission, the 2021 CEC IEPR forecast for BVES was used as a baseline in the conforming portfolio scenario development. Load modifiers such as increased penetration of BTM distributed energy resources (DERs), energy efficiency (EE), electric vehicle (EV) adoption, and expected load growth are described in detail using CEC IEPR demand modifier inputs for modeling results. These values are also determined using forecasts from the RESOLVE and SERVM modeling results and subsequent instruction from the Commission. BVES did not modify any optional input entries or deviate from the assigned assumptions apart from the C&I demand modifier percentages as explained below. As discussed, BVES does not own any transmission assets, does not have any sourced energy projects that are CAISO-controlled, and receives supplied electricity fed in at the distribution level from SCE.

Table 3: BVES Assigned Load Forecast 2023 – 2035 (GWh)

2023	2024	2025	2026	2027	2028	2029	2030	2031	2032	2033	2034	2035
132	132	133	134	136	137	138	139	140	140	141	142	142

Table 3 reports the assigned sales forecast for BVES through 2035 resulting from the 2021 IEPR Forecast and approved in R.20-05-003 on June 15, 2022. BVES relies solely on this sales forecast for this IRP effort, as directed by the Commission. BVES represents the second smallest LSE of all those reported in the CSP calculator, and has a sales forecast nearly four-times smaller than the next larger small multi-jurisdictional utility (SMJU).

In addition to the sales forecast shown above, BVES relied on load modifier assumptions as presented in the CSP calculator to remain consistent with the 2021 IEPR forecast. BVES did not supply unique load modifier shapes in the CSP calculator for either the 25 MMT or 30 MMT scenario. However, BVES did include a customized assumption regarding the annual percent of commercial and industrial (C&I) load. While the default assumption included in the CSP model is 49-50 percent, BVES's system is anticipated to be 40 percent C&I by 2024 and onwards. This is supported by recorded percentage of sales attributed to the C&I customer accounts and plans for oncoming load growth in that customer category.

Table 4 reports the calculated demand inputs for BVES assigned sales forecast as calculated by the CSP calculator.

Table 4: BVES CSP Calculator Demand Inputs: 25 MMT and 30 MMT Scenarios

Active Demand Inputs	Units	2024	2026	2030	2035
Baseline net energy for load	GWh	152	155	162	167
Non-commercial/industrial portion of baseline (included in baseline total)	GWh	91	93	97	101
Commercial/industrial portion of baseline (included in baseline total)	GWh	61	62	65	67
Electric Vehicle Load	GWh	5	8	12	18
Building Electrification	GWh	1	1	2	4
Energy Efficiency	GWh	-2	-4	-6	-9
Behind-The-Meter Photovoltaics (BTM PV)	GWh	-13	-15	-20	-26
Behind-The-Meter Storage Losses (BTM Storage)	GWh	0	0	0	0
Calculated demand at utility-scale generator bus-bar	GWh	143	145	150	154

Required and Optional Portfolios

The CPUC developed the assumptions utilized in this IRP as a result of calibrated models executed through the RESOLVE and SERVM models. Additional inputs for load modifiers are derived from the CEC 2021 IEPR. In order to address the electric sector’s proportion of GHG emissions abatement by 2035, the CPUC assigned LSEs proportional GHG emissions (in carbon dioxide CO₂ MMT) benchmarks. BVES developed its Conforming Portfolios/Preferred Portfolios using these assumptions for consistency and did not opt to select optional demand side entries. To produce a compliant IRP, BVES provides this IRP narrative and associated Resource Data Templates (RDTs) and CSP calculator models as part of its complete filing. BVES does not have any candidate resources subject to the baseline information utilized in the development of the CPUC RSP and responds to this prompt as “not applicable.” Both the storage and solar facilities are considered incremental for RSP planning purposes. BVES also assumes all future RE firm PPA generating units are online and are regional to the CAISO system.

Additionally, BVES did not produce an optional Alternative Portfolio study for this IRP cycle and does not have any resources subject to the Cost Allocation Mechanism or Power Charge Indifference Adjustment relating to departing load. BVES references internal energy supply costs in forecasting capital cost and financing information that better reflect the position and unique conditions in long-term energy resource planning. While an incremental analysis on RA capacity is not warranted for this 2021-2022 IRP cycle, BVES presents a discussion on current efforts to address this concern in the short and long-term. BVES leveraged financial information both from the RESOLVE results as well as the characterization presented in its 2023 Test Year General Rate Case (GRC) for consistency. All other cost and rate analysis values are designed from publicly available inputs. This is discussed in detail in Subsection e of Section III.

The figures below illustrate the two supply-side portfolios generated under this analysis through 2035.

Figure 1: Resource Planning under 25 MMT Portfolio


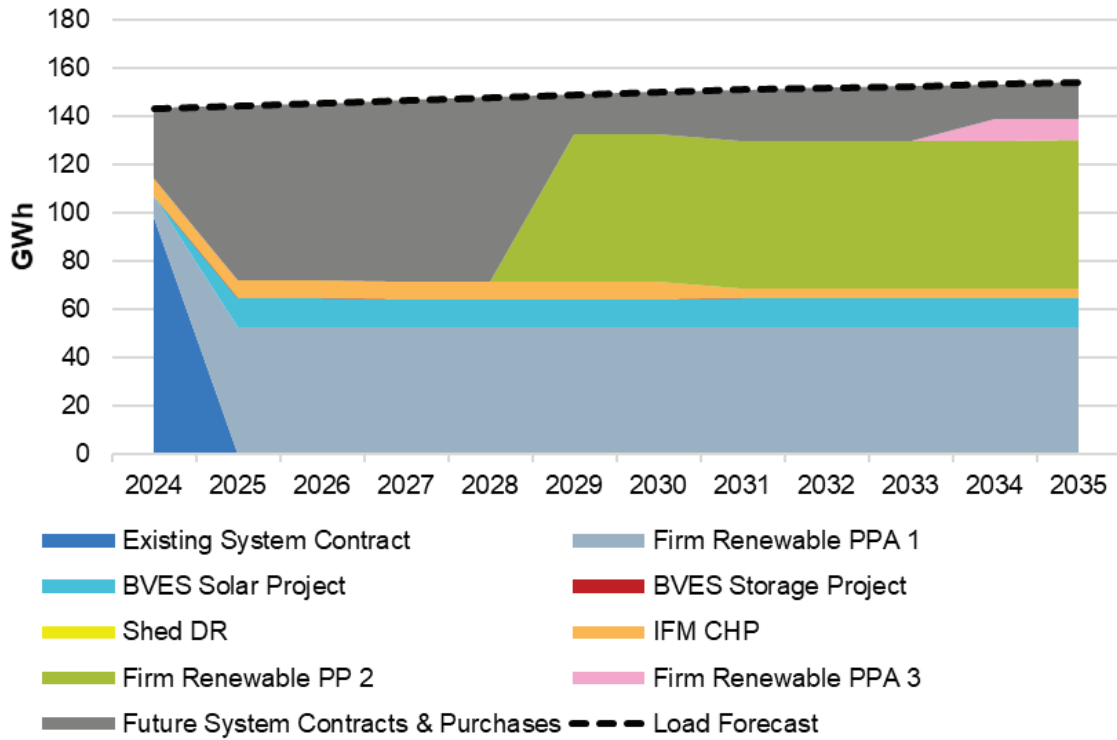


Figure 2: Resource Planning Under 30 MMT Portfolio

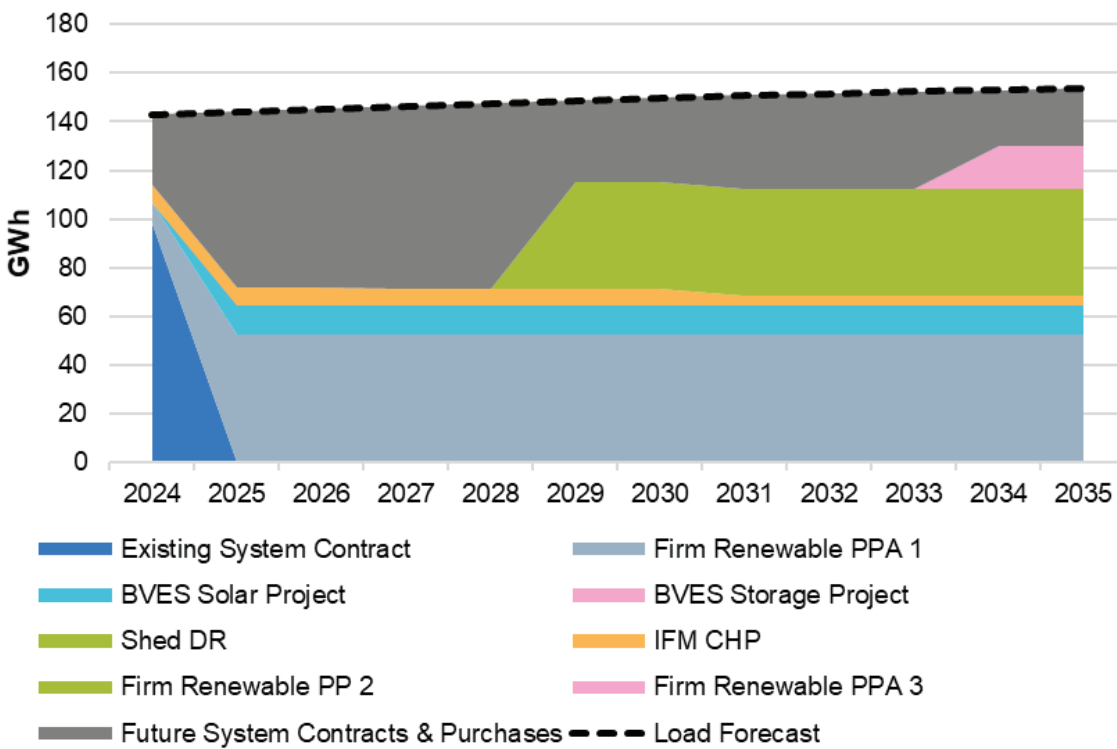

GHG Emissions Benchmark

BVES utilized benchmarks of GHG MMT CO₂ for 2030 and 2035 for both the 25 MMT and 30 MMT scenarios. BVES aligned its IRP approach to these established benchmarks as shortfall supply will be met by day-ahead energy purchases and short-term power contracts throughout BVES’s energy management planning transition to achieving supply carbon reduction goals.¹²

Table 5 compares forecast sales and GHG emissions benchmarks between BVES and the other SMJU as well as the large investor-owned utilities (IOUs). The table shows that BVES, the smallest utility in the aggregated service territory area, proportion of emissions is 0.1 percent while Pacific Gas and Electric Company, the largest utility, is 33.8 percent of total emissions (338 percent greater than BVES). Further, BVES proportion of emissions represents 10 percent of the emissions associated with the two additional SMJUs, exemplifying the small size of BVES as an electric provider. In terms of load, BVES represents only 8.7 percent of combined SMJU load in 2035 and 0.07 percent of total load for the combined small and large IOUs in 2035.

Table 5: BVES Sales Forecast and GHG Emissions Benchmark Compared to Other LSEs

Aggregated Service Territory Area	Proportion of Emissions	2030 Load (GWh)	2035 Load (GWh)	2035 GHG Emissions Benchmark (25 MMT Scenario)	2035 GHG Emissions Benchmark (30 MMT Scenario)
BVES	0.1%	139	142	0.01	0.01
Other Small Multi-Jurisdictional Utilities (Liberty Utilities & PacifiCorp)	1.0%	1,466	1,496	0.27	0.22
Pacific Gas & Electric Area	33.8%	77,800	81,536	8.43	6.74
Southern California Edison Area	33.2%	86,946	88,816	8.07	6.42
San Diego Gas & Electric Area	8.8%	17,556	17,975	2.27	1.83

a. Objectives

BVES developed this IRP analytical work with the following objectives:

1. Inform the Commission of its studied 2023-2035 IRP through use of the CSP calculator and RDT models to contribute to the CPUC’s RSP, PSP, and overall Reference System Plan;
2. Understand whether BVES is on target to meet its 2035 GHG benchmark under the Reference System Plan with its assigned load forecast and demand modifiers issued by the Commission;
3. Plan for firming renewable power contracts and model where reduction of system power reliance can commence over time;
4. Present avenues to meet current and future policy goals given its unique service area, wholesale market energy supply, and overall customer profile, noting BVES does not have disadvantaged communities in its service territory;
5. Provide discussion results that address system-wide concerns and anticipated constraints; and

¹² The IRP Standard Plan narrative prompt states, " When calculating emissions in the CSP calculator, LSEs should achieve GHG emissions results that are slightly below their GHG benchmarks to leave room in the system for BTM CHP emissions that will be added during the portfolio aggregation process."

6. Utilizing the model results, provide an actionable plan for least-cost, reliable resource planning while identifying potential constraints.

In addition, BVES submits in its 2023-2035 IRP descriptions of: i) BVES future procurement investigations to achieve the GHG targets; and ii) BVES Preferred Conforming Portfolios that are comparable with the RSP. Supporting documents to this IRP include the two Conforming Portfolio Scenarios for the RDT model and CSP calculator (for both 25MMT and 30MMT scenarios).

b. Methodology

The following discusses the 2022 IRP methodology.

i. Modeling Tool(s)

Under direction of the Commission, BVES conducted a resource and GHG emissions planning analysis through the RDT and CSP calculator Excel models issued on July 15, 2022 and October 11, 2022, respectively. BVES assumed inputs and results from the RESOLVE model to understand capacity expansion needs and price forecasting as well as the resource planning assumptions within the RDT. BVES developed, with a consultant, an internal Excel power resource planning workbook to analyze the impacts of different portfolio scenarios on the supply-demand balance and portfolio emissions. The workbook was built to reflect the key inputs, assumptions, and logic assumed by both the RDT and CSP models to ensure consistency when analyzing different portfolio options. An additional Excel workbook was developed to project incremental costs (market purchases, renewable contracts, and investment costs) to determine the functionalized revenue requirement under the presented portfolio options.

ii. Modeling Approach

The presented Conforming Scenarios were developed under policy-driven modeling objectives as a base case approach for reliability while ultimately ensuring the emissions benchmarks assigned to BVES were met. BVES approached its analysis with the goal of evaluating a diverse range of supply portfolios that considered BVES's planned generation projects, additional firm and non-firm renewable generation PPA, and, simultaneously, a decrease in unspecified system power purchases as owned assets and PPAs begin delivering renewable energy and REC products.

The 2023-2035 energy resource planning strategy aims to secure achievable, cost appropriate PPAs (preferably with a REC product) while mitigating rate impacts with increasing renewables within the supply mix contingent with reduced system power contracting. BVES-owned projects (i.e., BVES Solar Project and the BESS) are discussed in the narrative and modeled in both the RDTs and CSP calculators along with the planned BVES contract for 7x24 block renewable power. All existing contracts are captured, including the current existing contract for system power that will expire November 1, 2024. Future system RA obligation contracts are modeled out through 2035 with the assumption that resource capacity is currently available and online (i.e., not incremental to the RSP nor anticipating new resources in the CAISO interconnection queue).

In building a given portfolio scenario, BVES varied the number of planned PPAs as well as the following characteristics of the PPAs: technology type, nameplate capacity, and contract start date. BVES considered new solar PPAs, new wind PPAs, and additional contracts mimicking the 7x24 block renewable product that BVES is planning to contract for in 2024. Mechanically, these supply options were modeled using the hourly renewable profiles provided in the CSP model for Solar Baseline

California and Wind Baseline California¹³. BVES developed a custom generation profile to reflect the aggregate attributes of the 7x24 renewable block products assumed within a given portfolio scenario.

The range of supply portfolios analyzed can be summarized as a “Wind Heavy” range of portfolios (majority of future contracts were associated with wind PPAs), “Solar Heavy” (majority of future contracts were associated with solar PPAs), “Equal Technology” (both wind and solar PPAs made up the portfolio), and “Firm Renewable” (future contracts were assumed to mimic the 7x24 renewable block product). By developing scenarios with different combinations of these renewable contracts BVES was able to estimate the amount of additional system power that would be required to serve load and the associated portfolio emissions¹⁴.

BVES chose this range of scenarios to investigate as they represent the most achievable types of PPA contracts, for which BVES can hope to contract. Understanding existing procurement risks, transmission constraints, and current resources in the CAISO queue, BVES arrived at selecting a balancing portfolio of competitive RE resource types that can be assumed as online, having already received commercial operation dates, and will be available at the time of future PPA contracting.

By investigating a range of wind heavy and solar heavy supply portfolios BVES was able to analyze the impact of technology-specific renewable power on resulting supply-demand balance, portfolio emissions, and ultimately portfolio cost. As may be expected, where a greater amount of contracted solar power was assumed BVES saw an increased need for system purchases in the early-morning and late evening hours. Commensurate with those purchases, BVES saw an excess of contracted generation in the middle of the day that would need to either be sold or curtailed. These outcomes drive resulting portfolio emissions owing to the need for greater system purchases compared to a portfolio scenario that had a greater amount of contract wind generation of block 7x24 power. BVES included the analysis of portfolios centered on additional 7x24 block renewable power owing to its current early-stage success contracting for this type of product that would begin delivering in 2024.

BVES not only considered reliability and adherence to the emissions benchmark when scoring potential supply portfolios, but also analyzed the supply cost build-up for each portfolio. When investigating the range of scenarios, portfolio costs were estimated in a twostep process first to account for the contract expense associated with future renewable contracts and second to account for system purchases or sales. BVES modeled PPA costs using the levelized cost estimates (LCOE) from the RESOLVE model for wind and solar resources. Future 7x24 block product contracts were assumed to follow same escalation of other firm renewable sources like geothermal power but were indexed to BVES’s current estimate for the upcoming contract in 2024. Where contract or owned generation fell short of demand on an hourly basis, day-ahead purchases or sales were valued using power market forwards as of September 2022 for CAISO SP-15. Hourly purchases or sales were determined using an hourly supply-demand balance calculation that mimicked the logic provided in the CSP calculator and accounted for curtailment of system sales should the maximum export limit be reached. To compare costs across portfolio scenarios BVES looked both at total portfolio cost as well as average energy price (total portfolio cost divided by owned and contract generation).


¹³ In modeling all portfolio scenarios, BVES modeled generation for the upcoming BVES Solar Project using the Solar Baseline California renewable profile from the CSP model and the BVES Storage Project using the Battery Storage resource profile also from the CSP model.

¹⁴ Actual scenarios for net system power procurement will depend on the availability of solar and wind PPAs being offered at the time of awarding contracts.

As a part of this portfolio analysis BVES analyzed the CEC IEPR provided load forecast against internal, utility derived load forecasts that include updated information on future large customer loads and DG adoption. Importantly, in early fall 2022 BVES came to an agreement with its largest non-residential customer to serve an additional 7.1 gigawatt-hours (GWh) annually beginning in late 2024¹⁵. BVES had not confirmed this expansion project when the 2021 IEPR forecast proceeding was ongoing and thus this adjustment is not reflected in the IEPR forecast for BVES. With this service expansion confirmed, additional drivers of load uncertainty primarily stem from EV adoption and distributed generation uptake. BVES will continue to monitor the adoption of BTM distributed energy resources (DERs) and consult CPUC RSP and CEC IEPR study results to forecast accordingly.

Within the available customizations in the CSP calculator, BVES did ensure to include a customized assumption for the split between residential and non-residential load. Using the most recently available load data provided in Application (A.) 22-08-010, BVES estimated that non-residential sales account for only 40 percent of total retail sales, a 9 percent difference compared to the 49 percent assumption included in the CSP calculator. Figure 3 compares the monthly load between BVES’s customized non-residential load assumption and the CSP calculator default assumption. Decreasing the percent of non-residential sales has the impact of shifting load out of the shoulder months (March, April, October) and into the summer months as well as shifting the daily load profile to slightly more evening peaking. This adjustment ultimately makes it harder for BVES to reach or be below its assigned emissions benchmarks owing to the need for additional system purchases in the early evening hours when solar generation is reduced or unavailable, however, BVES included this adjustment to best reflect its load makeup.

Figure 3: Comparison of Monthly Load with Default C&I Assumption and BVES Customized C&I Assumption

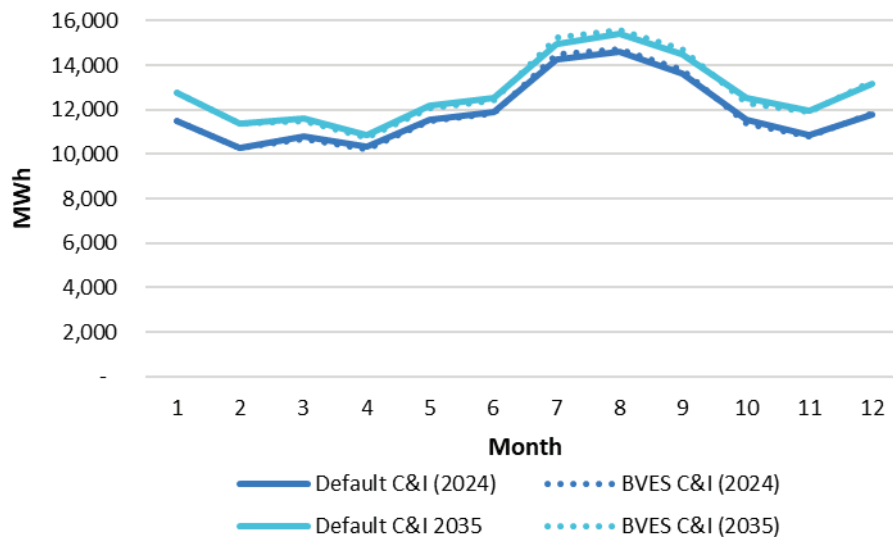

The one demand response (DR) program currently offered by BVES targets its four largest customers through a time-of-use (TOU) interruptible tariff, first approved in its 2009 GRC.¹⁶ This tariff provides a

¹⁵ BVES discussed the possibility of this load expansion in its 2020 IRP and additional details on this expansion can be found in A.22-08-010.

¹⁶ Rate Schedule A-5 TOU.

lower rate in exchange for the customer’s agreement to interrupt or reduce load when called upon by BVES to do so, even to a zero load. This DR program currently provides approximately 8.98 MW of interruptible load during winter months and 0.19 MW of interruptible load during the summer months. The 12 MW of coincident winter demand reduction can be called upon during BVES’s highest peak demands. These measures can shift load usage by a few hours and even minutes to achieve the resource balance needed during peak hours. BVES expects the additional oncoming load in late 2024 to double this interruptible load to approximately 18 MW in the winter and 0.4 MW in the summer. Additional load balancing can be achieved by way of the planned BESS and solar PV facility to meet peak load requirements, which also provides additional customer benefits. Solar production in the daytime with energy storage solution can provide some capacity constraint relief to the service area, as well.

With respect to RA capacity obligations, the calculation of this obligation begins with BVES providing its previous year’s historical annual load shape, year-ahead annual forecast, and BVPP output to the CEC who, in turn, issues to BVES its coincident peak demand level. BVES provided its updated NQC annual requirement issued by the CAISO within the RDT models. Because BVES is a winter-peaking utility and has its summer peaks on holiday weekends, BVES’s contribution to the CAISO system monthly coincident peak loads is insignificant because of the BVES system load timing diversity with CAISO. For planning purposes, BVES assumes that its RA procurement obligations are as defined by the CAISO Tariff default provisions, which parallel the CPUC’s program for jurisdictional LSEs; therefore, BVES plans for RA requirements equal to the CEC determined monthly coincident forecasted load, including reserves.

III. Study Results

The following describes the modeling results of BVES’s planned resource mix and GHG emissions benchmarks.

a. Conforming and Alternative Portfolios

The information below presents the modeled outputs in developing a Conforming Portfolio under the two GHG benchmark scenarios. BVES applied CEC IEPR assumptions that mapped to calculating factors and weights that projects the ability to meet benchmarks by 2035. Planned owned projects will be located in BVES’ service territory and, therefore, will not be directly tied to the CAISO electric grid. There are no direct comparisons to the planned buildout within the RSP that can be made from these IRP generating facility initiatives. Under the 25 MMT conforming portfolio scenario, BVES presents a case for rapid, higher capacity, procurement of renewable power supplies. This supply mix portfolio enables the utility to immediately plan for a greater portion of demand to be served by carbon-free resources.

BVES presents a change in the firm RE PPA contracting plans under the 30 MMT portfolio scenario. A reduction of delivery across all three planned RE PPA contracts covering all years represents the consideration of the updated CPUC’s reliability-driven case under the 30 MMT portfolio scenario, which will allow LSEs additional time to transform their supply mix to achieve 100 percent of electricity sales from clean resources by 2045. For the purposes of modeling planned capacity and resource mix needs, BVES plans to deploy its solar PV facility at 5 MW as well as storage facility in 2024 providing local benefits at 5 MWs / 20 MWhs four-hour discharge. Estimates for contract life are based on life-of-facility

assessments.¹⁷ Exact contracting details for these projects are still being considered or negotiated. RDTs are based on BVES’s current estimated timeline deployment and are subject to delays due to the current pandemic crisis and other constraints or barriers in executing the contract approvals.

The two projects similarly represented under both portfolio scenarios planned for implementation are identified as:

- BVES-owned approximately 5 MW solar PV facility directly connected to the BVES system; and
- BVES-owned 5 MW four-hour battery facility.

Planned renewable energy procurement will also take shape under firm competitive RE solicitations for contracts that target existing and online CAISO resources that are cost-appropriate consisting of a mix of 24x7 flat delivery. Current plans address three batches of RE firm PPA contracts. BVES plans to reach 100 percent clean energy by 2045 in alignment with state goals, however, anticipates spot market purchases for peak periods upwards of 5 percent through 2035 to mitigate risk exposure in the market. Discussion captured in the IRP narrative for identified initiatives are viewed and agreed to by BVES management and are subject to BVES Board and CPUC approval. The portfolios presented favorably position BVES in achieving its GHG emissions targets under both the 25 MMT and 30 MMT portfolio scenarios. Due to uncertainties with current implementation activities, BVES is not requesting any direct action by the Commission at this time through this 2023 -2035 IRP filing.

Table 6: RPS Resource Custom Profile - 3 Firm RE PPAs

GHG Portfolio Scenario	Annual GWhs in 2024	Annual GWhs in 2026	Annual GWhs in 2030	Annual GWhs in 2035
25 MMT	9	53	114	123
30 MMT	9	53	96	114

The following table and figures present the RDT contract information as well as the forecasted energy supply mix in 2035 as a result of this IRP modeling.

¹⁷ National Renewable Energy Laboratory. "Life Prediction Model for Grid-Connected Li-Ion Battery Energy Storage System," May 26, 2017. <https://www.nrel.gov/docs/fy17osti/67102.pdf>.

Table 7: Conforming Portfolio with Contract and Supply Details in 2035

Conforming Portfolio of Resources and Contracts						25 MMT Portfolio Scenario	30 MMT Portfolio Scenario
Resource Type (RDT) ¹⁸	Project / Resource Name	Existing Contract or Owned Asset	Existing Resource for Planned Future Contract	BVES New Resource Investment	Modeled Annual Total in 2035 (GWGs)	Modeled Annual Total in 2035 (GWGs)	
_New_generic_solar_1_axis	Bear Valley Solar Plant, solar, 5 MW	Planned utility asset	New resource that is indirectly tied to the CAISO-controlled electric grid and thus is characterized as a load modifier directly supplying the distribution system and adding BVES customer benefits	BVES will own and operate the asset	13.24		
_new_generic_battery_storage	BVES Battery Storage Project, Li-Ion or Flow storage, 5 MW / 20 MWh	Planned utility asset	New resource that is indirectly tied to the CAISO-controlled electric grid and thus is characterized as a load modifier directly charging from and dispatching to the BVES distribution system and adding BVES customer benefits	BVES will own and operate the asset	(1.55)		
_existing_generic_unknown	Competitive RE Firm PPA	Not an existing contract, i.e., to be procured	Assumes the resource is already available within the CAISO-controlled electric grid	Energy delivery only (preference given to contracts with a REC product)	52.6	52.6	
_existing_generic_unknown	Competitive RE Firm PPA	Not an existing contract, i.e., to be procured	Assumes the resource is already available within the CAISO-controlled electric grid	Energy delivery only (preference given to contracts with a REC product)	61	43.8	
_existing_generic_unknown	Competitive RE Firm PPA	Not an existing contract, i.e., to be procured	Assumes the resource is already available within the CAISO-controlled electric grid	Energy delivery only (preference given to contracts with a REC product)	9	17.5	
Existing_generic_peaker	BVPP	Existing owned asset	Existing resource not under CAISO control	BVES owns and operates this asset	0.27		
_Unspecified_non_import	Annual Shaped System Energy Contract	Existing contract	Existing unspecified annual shaped system power	Energy delivery only	N/A; Contract expires on October 31, 2024		
_Unspecified_non_import	Shaped base delivery contract of unspecified, unknown mix at a reduction of existing annual contract capacity reservations	To be procured	Assumes the resource will already be available within the CAISO-controlled electric grid	Energy delivery only	N/A; Contract expires on October 31, 2027		

¹⁸ Resource list in this table includes existing contracts but does not profile expired contracts.

Conforming Portfolio of Resources and Contracts

					25 MMT Portfolio Scenario	30 MMT Portfolio Scenario
Resource Type (RDT) ¹⁸	Project / Resource Name	Existing Contract or Owned Asset	Existing Resource for Planned Future Contract	BVES New Resource Investment	Modeled Annual Total in 2035 (GWGs)	Modeled Annual Total in 2035 (GWGs)
Unspecified - non-import	Shaped base delivery contract of unspecified, unknown mix at a reduction of existing annual contract capacity reservations	To be procured	Assumes the resource will already be available within the CAISO-controlled electric grid	Energy delivery only	49	
Unspecified - non-import	Seasonal firm energy delivery contract of unspecified, unknown mix at a reduction of existing annual contract capacity reservations	To be procured	Assumes the resource will already be available within the CAISO-controlled electric grid	Energy delivery only	23	
Sellers choice	2023 RA Capacity Contract for remaining system RA obligations	To be procured	Assumes resource will already be available for future capacity contracting with no locational preference	Generic System RA capacity contract	No energy delivered	
Sellers choice	2024 System RA Capacity Contract	To be procured	Assumes resource will already be available for future capacity contracting with no locational preference	Generic System RA capacity contract	No energy delivered	
Sellers choice	2025 System RA Capacity Contract	To be procured	Assumes resource will already be available for future capacity contracting with no locational preference	Generic System RA capacity contract	No energy delivered	
Sellers choice	2026 System RA Capacity Contract	To be procured	Assumes resource will already be available for future capacity contracting with no locational preference	Generic System RA capacity contract	No energy delivered	
Sellers choice	2027 System RA Capacity Contract	To be procured	Assumes resource will already be available for future capacity contracting with no locational preference	Generic System RA capacity contract	No energy delivered	
Sellers choice	2028 System RA Capacity Contract	To be procured	Assumes resource will already be available for future capacity contracting with no locational preference	Generic System RA capacity contract	No energy delivered	
Sellers choice	2029 System RA Capacity Contract	To be procured	Assumes resource will already be available for future capacity contracting with no locational preference	Generic System RA capacity contract	No energy delivered	
Sellers choice	2030 System RA Capacity Contract	To be procured	Assumes resource will already be available for future capacity contracting with no locational preference	Generic System RA capacity contract	No energy delivered	
Sellers choice	2031 System RA Capacity Contract	To be procured	Assumes resource will already be available for future capacity contracting with no locational preference	Generic System RA capacity contract	No energy delivered	

Conforming Portfolio of Resources and Contracts

					25 MMT Portfolio Scenario	30 MMT Portfolio Scenario
Resource Type (RDT) ¹⁸	Project / Resource Name	Existing Contract or Owned Asset	Existing Resource for Planned Future Contract	BVES New Resource Investment	Modeled Annual Total in 2035 (GWhs)	Modeled Annual Total in 2035 (GWhs)
Sellers_choice	2032 System RA Capacity Contract	To be procured	Assumes resource will already be available for future capacity contracting with no locational preference	Generic System RA capacity contract	No energy delivered	
Sellers_choice	2033 System RA Capacity Contract	To be procured	Assumes resource will already be available for future capacity contracting with no locational preference	Generic System RA capacity contract	No energy delivered	
Sellers_choice	2034 System RA Capacity Contract	To be procured	Assumes resource will already be available for future capacity contracting with no locational preference	Generic System RA capacity contract	No energy delivered	
Sellers_choice	2035 System RA Capacity Contract	To be procured	Assumes resource will already be available for future capacity contracting with no locational preference	Generic System RA capacity contract	No energy delivered	
Existing_ge neric_dr	Local demand response program to curtail commercial load	Existing	Bear Valley Electric Service, Inc., local demand response program to curtail commercial load, Tariff agreement structure	Energy delivery only	26	

Figure 4: Forecast Supply Mix in 2035 - 25 MMT Scenario

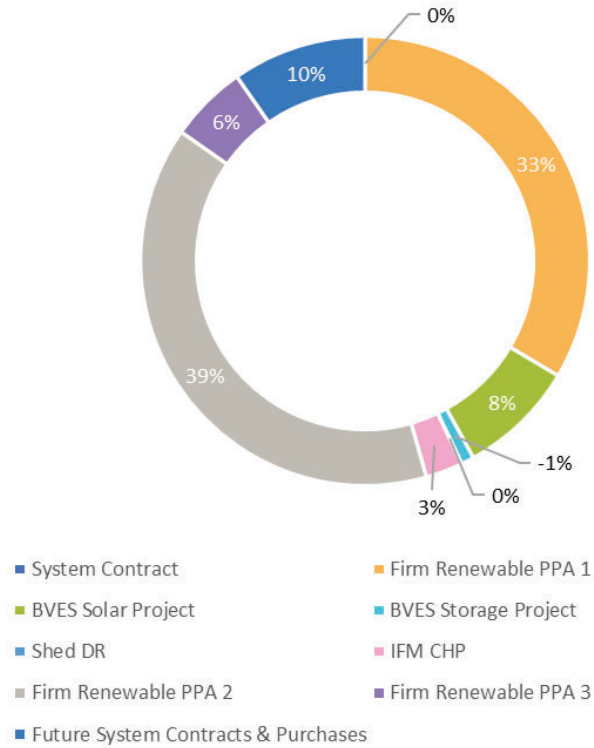


Figure 5: Forecast Supply Mix in 2035 - 30 MMT Scenario

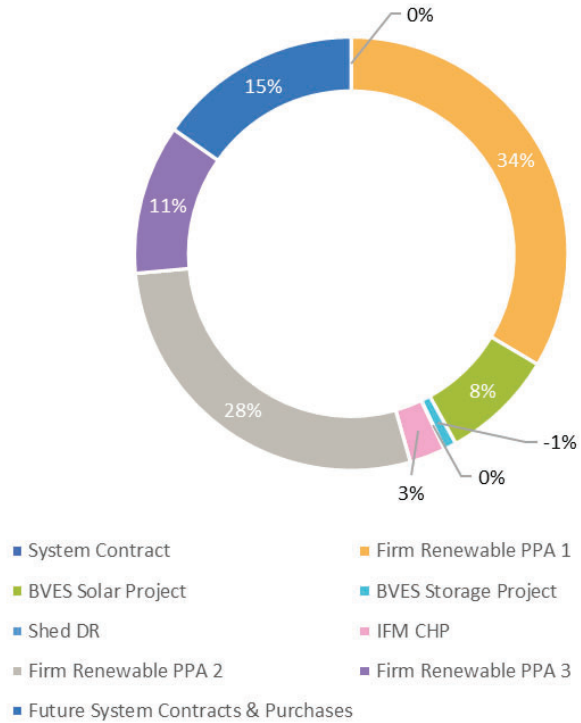


Table 8: BVES Portfolio Scenarios 2023-2035

Portfolio Scenario for 2023 - 2035	Assumptions	BVES 2030 Load Forecast (GWh)	BVES 2035 Load Forecast (GWh)	Assigned 2030 Emissions Benchmark (MMT)	Assigned 2035 Emissions Benchmark (MMT)	IRP GHG Emissions Results 2030 (CO ₂ MMT)	IRP GHG Emissions Results 2035 (CO ₂ MMT)
Conforming Scenario (a)	<ul style="list-style-type: none"> Benchmarked against 25 MMT GHG threshold CEC IEPR load modifiers CEC IEPR demand side modifiers Resource generation output using CPUC capacity factors Modified 40 percent commercial and industrial (C&I) load through 2035 	138.82	142.42	0.01447	0.01168	0.01154	0.01068
Conforming Scenario (b)	<ul style="list-style-type: none"> Benchmarked against 30 MMT GHG threshold CEC IEPR load modifiers CEC IEPR demand side modifiers Resource generation output using CPUC capacity factors Modified 40 percent commercial and industrial (C&I) load through 2035 	138.82	142.42	0.01915	0.01462	0.01819	0.01402

BVES calculated the results of both the 25 MMT and 30 MMT scenario models using the assigned load forecast and load modifiers derived from the 2021 CEC IEPR. Selected options include the modifications made to the C&I growth profile under the demand inputs and RPS-eligible custom hourly profile for the three planned RE firm PPA contracts for the submitted Conforming Portfolios. The CSP calculator’s modeled carbon emissions intensity measurements align CAISO system power (as represented by BVES unspecified firm energy contracts and day ahead market purchases) to the carbon intensity of natural gas dispatch. Additionally, BVES understands that the Commission ruled to restrict incorporation of PCC 2 and PCC 3 REC contracts into the CSP calculator for GHG emissions benchmark comparisons as stipulated in the model’s instructions and guidance documents. BVES does not own any CAISO controlled generating facilities or contracts. As a result of the modeling exercise, BVES’s power resource

forecast positions the utility along an appropriate pathway to achieve its GHG emissions benchmark thresholds for both Conforming Portfolio Scenarios.

In June 2012, BVES issued an RFP for RECs that sought pre-2011 volumes in addition to its then-current and future compliance period needs. After identifying a successful bidder, BVES began negotiations for a long-term contract for unbundled RECs. In February 2013, the filed Advice Letter 277-E proposed a ten-year RPS agreement for the purchase of RECs from Iberdrola Renewables, LLC (now called Avangrid Renewables, LLC, or Avangrid). CPUC Resolution E-4604, issued in July 2013, approved the ten-year contract. The volumes in the ten-year REC contract were originally forecasted to fulfill all of BVES's RPS obligations through 2022. The updated retail sales forecast now projects full RPS compliance through 2021-2022 with the use of PCC 3s. Understanding the movement away from contracting with long-term PCC 3 contracts, BVES will update its RPS program annual submission in 2023 to account for the targeted PPA bundled products as well as generation output from its future solar PV plant. BVES is still on target to meet its Compliance Period 4 goals of 44 percent in 2024 with the use of these additional bundled PCC 1 RECs planned with the firm PPAs.

Such that the solar PV facility moves forward in finalizing authorization to operate in 2024, BVES will be able to meet REC obligations starting late 2024 and early 2025 with option RECs to meet the difference if the awarded competitive firm RE PPA does not materialize in time for REC retirements. BVES has not secured agreements to fulfill compliance obligations for the 2024-2030 timeframe, however, this IRP strategy will influence future RPS planning to connect requirements and enable BVES to achieve both GHG reduction targets and meet RPS compliance period goals. BVES demonstrates assurance in meeting California RPS goals in each future compliance period through its former strategy in securing unbundled PCC 3 REC contracts and will shift to secure bundled generation and REC product contracts starting in 2024.

The energy balance results from the CSP calculator present a downward trend in reliance on system power by 2035 as shown in both figures below. With the inclusion of the battery facility, increased shed demand response, and the installation of the solar facility (only projected in 2035 per modeling limits), BVES can meet additional gaps by procuring firm renewable PPA contracts and shortfall market purchases in addition to reducing the need for long-term unspecified generation mix power contracts.

Table 9: Energy Balance Results - 25 MMT Conforming Portfolio

Supply Summary	Unit	2024	2026	2030	2035
Large Hydro	GWh	-	-	-	-
Imported Hydro	GWh	-	-	-	-
Asset Controlling Supplier	GWh	-	-	-	-
Nuclear	GWh	-	-	-	-
Biogas	GWh	-	-	-	-
Biomass	GWh	-	-	-	-
Geothermal	GWh	-	-	-	-
Small Hydro	GWh	-	-	-	-
Wind CAISO	GWh	-	-	-	-
Wind Out Of State	GWh	-	-	-	-
Wind Offshore	GWh	-	-	-	-
Solar Utility Scale	GWh	-	13	13	13
Solar Distributed	GWh	-	-	-	-
Hybrid or Paired Solar and Battery	GWh	-	-	-	-
Shed DR	GWh	0.0	0.0	0.0	0.0
Pumped Storage	GWh	-	-	-	-
Battery Storage	GWh	-	(1)	(2)	(1)
Storage Resource Custom Profile	GWh	-	-	-	-
RPS Resource Custom Profile	GWh	9	53	114	123
GHG-free non-RPS Resource Custom Profile	GWh	-	-	-	-
Coal	GWh	-	-	-	-
IFM CHP	GWh	7	7	7	4

Supply Demand Balance Summary	Unit	2024	2026	2030	2035
<i>LSE Supply, before curtailment and exports</i>	GWh	16	72	133	139
<i>Net Purchases, before curtailment and exports</i>	GWh	127	73	17	15
Curtailment	GWh	-	-	(1)	(2)
Exports	GWh	-	(0)	(2)	(3)
Zero Emissions Power From System	GWh	5	2	1	1
Net System Power (incurs emissions)	GWh	122	72	19	20

Table 10: Energy Balance Results - 30 MMT Conforming Portfolio

Supply Summary	Unit	2024	2026	2030	2035
Large Hydro	GWh	-	-	-	-
Imported Hydro	GWh	-	-	-	-
Asset Controlling Supplier	GWh	-	-	-	-
Nuclear	GWh	-	-	-	-
Biogas	GWh	-	-	-	-
Biomass	GWh	-	-	-	-
Geothermal	GWh	-	-	-	-
Small Hydro	GWh	-	-	-	-
Wind CAISO	GWh	-	-	-	-
Wind Out Of State	GWh	-	-	-	-
Wind Offshore	GWh	-	-	-	-
Solar Utility Scale	GWh	-	13	13	13
Solar Distributed	GWh	-	-	-	-
Hybrid or Paired Solar and Battery	GWh	-	-	-	-
Shed DR	GWh	0.0	0.0	0.0	0.0
Pumped Storage	GWh	-	-	-	-
Battery Storage	GWh	-	(1)	(1)	(1)
Storage Resource Custom Profile	GWh	-	-	-	-
RPS Resource Custom Profile	GWh	9	53	96	114
GHG-free non-RPS Resource Custom Profile	GWh	-	-	-	-
Coal	GWh	-	-	-	-
IFM CHP	GWh	7	7	7	4

Supply Demand Balance Summary	Unit	2024	2026	2030	2035
LSE Supply, before curtailment and exports	GWh	16	72	116	130
Net Purchases, before curtailment and exports	GWh	127	73	34	24
Curtailment	GWh	-	-	(1)	(2)
Exports	GWh	-	(0)	(1)	(3)
Zero Emissions Power From System	GWh	5	1	1	0
Net System Power (incurs emissions)	GWh	121	72	35	28

BVES presents its Conforming Portfolio results in benchmarking future supply GHG emissions to the proportional share attributed to electricity delivery to its service area for both the 25 MMT and 30 MMT benchmark threshold scenarios. BVES did not develop an Alternative Portfolio or apply any optional deviations from the Conforming Portfolio. Additionally, the models utilize all 2021 IEPR, RESOLVE, and CPUC-assigned assumptions and calibrations for resource attributes such as carbon intensity measurements, capacity and generating factors, and seasonal impacts to intermittent resources.

Table 11 and Table 12 present the CO₂ MMT/year results under the 25 MMT and 30 MMT Conforming Portfolios.

Table 11: BVES 25 MMT Conforming Scenario Carbon Dioxide Emissions Forecast

CO₂	Unit	2024	2026	2030	2035	Notes
Coal	MMt/yr	-	-	-	-	Included in GHG emissions total
CHP	MMt/yr	0.0032	0.0032	0.0031	0.0019	
Biogas	MMt/yr	-	-	-	-	
Biomass	MMt/yr	-	-	-	-	

CO ₂	Unit	2024	2026	2030	2035	Notes
System Power	MMt/yr	0.0519	0.0303	0.0085	0.0088	Includes emissions from in-CAISO dispatchable gas and unspecified imports
Asset Controlling Supplier	MMt/yr	-	-	-	-	
Total	MMt/yr	0.0551	0.0335	0.0115	0.0107	Includes both in-CAISO and import emissions
Average emissions intensity	tCO ₂ /MWh	0.4160	0.2491	0.0831	0.0750	Emissions per MWh of sales
Oversupply Emissions Credits	MMt/yr	-	-	0.0003	0.0004	When hourly supply exceeds hourly load and system power is on the margin, LSE receives receives credit at the system power emissions rate. Impact included in Total.

Table 12: BVES 30 MMT Conforming Scenario Carbon Dioxide Emissions Forecast

CO ₂	Unit	2024	2026	2030	2035	Notes
Coal	MMt/yr	-	-	-	-	Included in GHG emissions total
CHP	MMt/yr	0.0033	0.0033	0.0032	0.0019	
Biogas	MMt/yr	-	-	-	-	Includes emissions from in-CAISO dispatchable gas and unspecified imports
Biomass	MMt/yr	-	-	-	-	
System Power	MMt/yr	0.0516	0.0301	0.0150	0.0121	Includes both in-CAISO and import emissions
Asset Controlling Supplier	MMt/yr	-	-	-	-	
Total	MMt/yr	0.0548	0.0334	0.0182	0.0140	
Average emissions intensity	tCO ₂ /MWh	0.4140	0.2483	0.1310	0.0984	Emissions per MWh of sales
Oversupply Emissions Credits	MMt/yr	-	-	0.0000	0.0003	When hourly supply exceeds hourly load and system power is on the margin, LSE receives credit at the system power emissions rate. Impact included in Total.

b. Preferred Conforming Portfolios

In this 2023-2035 planning horizon IRP, BVES selected both Conforming Portfolios discussed above as the Preferred Conforming Portfolios for the 25 MMT and 30 MMT benchmark threshold scenarios. Please see Table 7 above for the listing.

The CPUC has demonstrated through its modeling methodology that LSEs are to move away from reliance on unspecified system power and replace with renewable LSE-owned or contracted power resources. BVES applied a thoughtful approach in capturing the distinct objectives presented under both

Conforming Portfolio scenarios. In both cases, the utility illustrates the ability to move toward achieving state objectives in GHG emissions reduction and established, by way of this IRP, a framework and roadmap for meeting 2035 targets.

BVES initially prefers the portfolio scenario under the 30 MMT reliability case as the utility faces unique constraints in deploying clean energy facilities within its service area. Compounded by the fact that BVES's system ties into SCE's distribution system, BVES understands that cost impact may be high for its customers when replacing system power contracts with renewable firm PPAs at the rate presented in the 25 MMT portfolio scenario. For this, cost estimates align with the GRC methodology with an inflation adder to account for planned revenue requirement (RR) by 2035. BVES modeled its cost analysis using its current GRC application for the 2023 Test Year. BVES will make every effort to seek cost-competitive renewable energy PPAs that maintain a parallel cost impact estimate with the RR forecast displayed in this IRP as possible. Modeling inputs assume that the applicable units to be solicited for available capacity are: (1) currently online; (2) able to provide delivery at the identified hours of demand for offloading system power supply; and (3) are located within the CAISO-controlled grid. Out-of-state contracts or a need for a new resource build are not directly modeled but are considered a risk factor in the roadmap to transition to 100 percent electric retail sales coming from clean energy resources. This IRP describes the Preferred Conforming Portfolios consistent with the relevant statutory and administrative requirements (Public Utilities Code (PUC) Section 454.52(a)(1)).

To meet the statutory requirements, this IRP demonstrates that the portfolios meet the GHG reduction targets established by the California Air Resources Board in coordination with the CEC and highlights BVES's supply-side planning indicating that BVES is poised to procure at least 60 percent RE resources by December 31, 2030. Additionally, BVES understands it must fulfill its obligation to its customers to present just and reasonable rates and minimize rate impacts. This discussion is presented later within this section. BVES also accounts for system and local reliability both in the near-term and long-term, wherever possible, and selected a supply model that does not weaken the resilience of the transmission grid while maintaining its remote location to the CAISO. BVES plans to build two utility-scale projects that will enhance its distribution system reliability and demand-side energy management while minimizing localizing air pollutants and other GHGs. Under this rationale, BVES meets the requirements set forth in PUB Section 454.52(a)(1).

As presented above, BVES's 25 MMT benchmark is slightly lower than the threshold assignment primarily due to the limitations of the CSP modeling ability, which requires whole number inputs for planned capacity. The arranged PPAs will also be structured in rounded MW units rather than proportion of energy supply, which will also account for any spot market purchase that BVES may have to leverage. The 7x24 block design will have a minimal impact on transmission capability largely due to the size of the contracts and BVES size. Lastly, BVES does not model any resources within its preferred conforming portfolios that include new natural gas units.

c. GHG Emissions Results

The result of BVES GHG emissions benchmark for two Conforming Portfolios are shown in the tables below. Based on the results from CSP calculator, the CO₂ GHG emission results are 0.01154 MMT for 2030 and 0.01068 MMT in 2035 based on the 25 MMT portfolio scenario. The benchmarks assigned to BVES for 2030 and 2035 are 0.0145 MMT and 0.0117 MMT, respectively. In the 30 MMT CO₂ GHG reduction scenario, BVES achieved GHG emissions results of 0.01819 MMT in 2030 and 0.01402 MMT in

2035. The benchmarks assigned to BVES under this scenario for these years are 0.1915 MMT and 0.0146 MMT, respectively.

BVES included a custom hourly load shape in the CSP calculator for both scenarios assuming 100 percent guaranteed delivery despite the capacity factors of solar and wind mixed resources. Contingent on the analysis of the current contract(s) in negotiation, BVES finds it achievable to shape profiles with firm RE PPAs for its particular size based on current market availability.

Table 13: BVES 25 MMT GHG Results Based on Clean System Power Calculator

<i>Emissions Total</i>	<i>Unit</i>	<i>2024</i>	<i>2026</i>	<i>2030</i>	<i>2035</i>	<i>Notes</i>
CO2	MMt/yr	0.0551	0.0335	0.0115	0.0107	Includes both in-CAISO and import emissions
PM2.5	tonnes/yr	2.0372	1.2912	0.4919	0.4246	Only In-CAISO emissions
SO2	tonnes/yr	0.1932	0.1233	0.0483	0.0411	Only In-CAISO emissions
NOx	tonnes/yr	2.9629	2.1061	1.1965	0.8338	Only In-CAISO emissions

Table 14: BVES 30 MMT GHG Results Based on Clean System Power Calculator

<i>Emissions Total</i>	<i>Unit</i>	<i>2024</i>	<i>2026</i>	<i>2030</i>	<i>2035</i>	<i>Notes</i>
CO2	MMt/yr	0.0548	0.0334	0.0182	0.0140	Includes both in-CAISO and import emissions
PM2.5	tonnes/yr	2.0219	1.3872	0.7947	0.6542	Only In-CAISO emissions
SO2	tonnes/yr	0.1920	0.1324	0.0766	0.0626	Only In-CAISO emissions
NOx	tonnes/yr	2.9683	2.2055	1.5594	1.0911	Only In-CAISO emissions

The CSP calculator models for both 25 MMT GHG and 30 MMT GHG opt not to present seasonality mixtures or time-of-day dispatch units. BVES did include a shaped hourly profile for RPS-eligible PPAs for its plan RE firm contracts beginning in 2024. This determination is based on 100 percent of delivery of the blended resource of predominately solar and wind. This due diligence in available units has been part of BVES’s investigation into contracting for this first PPA in the next year. The contract is still under negotiations.

The results of GHG emissions in both portfolios are favorable in meeting the Commission’s benchmark limits, BVES anticipates meeting this benchmark (for both 25MMT and 30MMT portfolios) that the 2030 and 2035 emissions target years will remain at or below the target values as strategic planning efforts enable more deployment of DER resources and procurement of renewable firm PPA contracts when existing system power contracts are poised to expire. BVES understands that the CSP modeling inputs present a conservative, GHG policy-driven calibration of carbon emissions related to system power.

As system power mix varies during different periods of the day, seasons, and peak scenarios, internal GHG forecasts for BVES consider the unspecified system power contracts aligning with more appropriate dispatch schedules based on the contract details. For example, when renewable intermittent resources are typically generating, the CAISO system supply dashboard can display from 25 - 50 percent of system power, including CAISO mix resources and imports, is from renewable resources including wind and

solar.¹⁹ Additionally, CAISO and imported power carbon emissions per MWh of production is anticipated to continue declining from 2020 to 2030 due to tax incentives policy, reduced cost of solar panels, and California RPS goals. This will lead to even more penetration of renewable resources including solar and wind generation at the CAISO system level and the continued growth in customer-based DG adoption. Other states in the Western Electricity Coordinating Council regions will share in this trend. These changes lead to a reduction in the annual carbon emissions for imported power serving BVES's service area.

In aligning with the Commission's approach, and to comply with the requirements from the IRP process to depict these conservative emissions intensity calculations, BVES conducted an evaluation of a new procurement strategy to rapidly contract with existing CAISO generators for eligible renewable power and move away from the previous approach. Aside from the BVES-owned generation assets being considered, any increase in GHG-related costs will be passed onto BVES via its wholesale energy purchases as demonstrated by the results of the CSP calculator models for both 25 MMT and 30 MMT benchmark thresholds. BVES understands the critical need to reduce its reliance on system power by procuring renewable PPAs and investing in eligible renewable generators. The costs of GHG and state emissions reduction requirements will be compared via the competitive bidding process that BVES undergoes when acquiring resources and entering into future agreements with energy providers. BVES anticipates this situation will continue in future RFP processes.

BVES's resource supply portfolio in the RDT supports the movement toward meeting goals for reduced GHG emissions. In future planning cycles, BVES intends to use a larger share of solar and wind supply within the CAISO balancing area in the resource portfolio over the next ten years by pursuing cost favorable, RE firm PPAs and battery technologies. BVES will be using more transmitted supply to hedge contracts, which will have less carbon emissions per MWh due to more solar penetration in the CAISO market, though it is not modeled in the emissions calculations provided for this IRP study. Further, BVES expects to have a significant amount of load displaced by EE and customer solar generation.

With a ten-year contract for RECs expiring, BVES anticipates satisfying its obligations under California's RPS program through bundled firm RE PPAs along with generation from its solar facility. The current PCC3 REC contract, approved by the Commission in July 2013, provides the flexibility needed to manage the current RPS requirements that ramp up to 60 percent by 2030.²⁰ BVES understands that the nature of the RPS program and IRP misalign with the restrictions of PCC2 and PCC3 RECs within the GHG reduction model. BVES has worked to change its prior power supply strategy to account for these restrictions and now aims to procure bundled PCC1 REC products with generation. The rest of the RPS requirement will materialize upon deployment of the BVES solar facility, which is expected to generate approximately 13.24 GWh annually and a new REC contract either by way of planned renewable energy PPAs or as a separate solicitation if unavailable at the time of bid awarding. This project is expected to have a 25-year life, and the MWh of generation is expected to qualify as local renewable energy meeting the RPS. BVES will evaluate the additional RECs required after the solar project is approved and will base the decision for modification to the plan contracting capacity for renewable PPAs in a subsequent IRP.

¹⁹ <http://www.caiso.com/TodaysOutlook/Pages/supply.aspx>

²⁰ SB 100 was signed by Governor Brown in 2018 and, among other changes, accelerates eligible-renewable electricity sales targets to achieve 60 percent by 2030 and 100 percent by 2045.

d. Local Air Pollutant Minimization and Disadvantaged Communities

i. Local Air Pollutants

BVES presents the results of local air pollutants that may directly impact those in and surrounding its service area. Because BVES plans for PPAs, firm and shaped energy contracts, and wholesale market purchases, system power emissions reflect the majority of GHG accountability for the utility. ~~BVES addresses within~~ Within the Action Plan of this IRP, ~~BVES outlines~~ its strategy ~~infor~~ securing affordable, reliable energy contracts ~~contingent with future,~~ which are informed by ongoing investigations into locally sited and utility-owned DERs.

BVES has updated this IRP to reinforce its commitment to minimizing local air pollutants that extend beyond the immediate service territory. For example, BVES has incorporated timeline planning to better reflect the implementation of applicable California Environmental Quality Act (CEQA) requirements within its resource planning strategy to achieve 100 percent retail sales from low-carbon or carbon-free resources as it continues to plan anticipated solar and storage plants. BVES also reviewed internally to better understand the larger regional impact of emitting sulfur dioxide (SO₂), nitrogen oxide (NO_x), and particulate matter (PM_{2.5} and PM₁₀), noting their potential to cause both immediate and prolonged respiratory and health issues.²¹

As part of concurrent community engagement efforts, BVES plans to enhance its awareness and education initiatives by integrating health-focused information in outreach activities to disseminate actionable tips on minimizing exposure to air pollutants, which are of significant concern during the fire season. Recognizing the limited influence BVES can exert beyond its service territory, the utility is committed to empowering local communities with knowledge and strategies to protect their health against air pollution.

BVES views its IRP framework as a structured approach with achievable targets, serving as a roadmap for meeting carbon reduction goals. The shift in carbon accounting practices at BVES moved strategies from previous emissions intensity, which were based on the carbon emissions intensity across SCE's service territory, to a methodology that accounts for emissions factors assigned to the load serving entities with contracted system power supply, as supported by CPUC-driven models and assumptions. As a result, the 2020 IRP development led to a new procurement strategy identifying the preferred portfolio aimed at providing a reliable, best-fit, low-carbon resource mix that is well-diversified and consistent with CPUC regulations and state laws governing resource planning, resource adequacy, renewable portfolio standards, and GHG emissions benchmarks. This strategic approach highlights BVES's dedication to reducing GHG emissions.

BVES recognizes that emissions from its operations are not bound by geography and can impact broader regions, including disadvantaged communities. This acknowledgment is integrated into the planning efforts, with BVES committed to ensuring its Preferred Conforming Portfolios adhere to stringent emissions benchmarks, thus minimizing future emissions. This approach embodies BVES's commitment to minimize the environmental and community impacts of its energy procurement processes. By broadening the scope of its communication to include health information related to air quality, BVES

²¹ World Health Organization. "Air quality, Energy and Health," <https://www.who.int/teams/environment-climate-change-and-health/air-quality-and-health/health-impacts/types-of-pollutants>.

aims to ensure that residents are better informed to take preventive actions, for disadvantaged populations where the risks may be more pronounced.

Under the Preferred Conforming Scenario using 25 MMT GHG benchmark thresholds, the figure below presents the particulate matter (PM2.5), sulfur dioxide (SO₂), and nitrogen oxide (NOx) results from the CSP calculator.

Figure 6: BVES Conforming Portfolio GHG Local Emissions Results: 25 MMT Benchmark

CO ₂	Unit	2024	2026	2030	2035	Notes
Coal	MMt/yr	-	-	-	-	Included in GHG emissions total
CHP	MMt/yr	0.0032	0.0032	0.0031	0.0019	
Biogas	MMt/yr	-	-	-	-	
Biomass	MMt/yr	-	-	-	-	
System Power	MMt/yr	0.0519	0.0303	0.0085	0.0088	Includes emissions from in-CAISO dispatchable gas and unspecified imports
Asset Controlling Supplier	MMt/yr	-	-	-	-	
Total	MMt/yr	0.0551	0.0335	0.0115	0.0107	Includes both in-CAISO and import emissions
Average emissions intensity	tCO ₂ /MWh	0.4160	0.2491	0.0831	0.0750	Emissions per MWh of sales
Oversupply Emissions Credits	MMt/yr	-	-	0.0003	0.0004	When hourly supply exceeds hourly load and system power is on the margin, LSE receives credit at the system power emissions rate. Impact included in Total.

PM _{2.5}	Unit	2024	2026	2030	2035	Notes
Coal	tonnes/yr	-	-	-	-	Information only, not included in total
CHP	tonnes/yr	0.1801	0.1775	0.1730	0.1038	
Biogas	tonnes/yr	-	-	-	-	
Biomass	tonnes/yr	-	-	-	-	
System Power	tonnes/yr	1.8571	1.1138	0.3189	0.3208	In-CAISO emissions only - unspecified import emissions excluded
Total	tonnes/yr	2.0372	1.2912	0.4919	0.4246	
Average emissions intensity	kg/MWh	0.0154	0.0096	0.0035	0.0030	Emissions per MWh of sales

SO ₂	Unit	2024	2026	2030	2035	Notes
Coal	tonnes/yr	-	-	-	-	Information only, not included in total
CHP	tonnes/yr	0.0192	0.0189	0.0184	0.0110	
Biogas	tonnes/yr	-	-	-	-	
Biomass	tonnes/yr	-	-	-	-	
System Power	tonnes/yr	0.1740	0.1044	0.0299	0.0300	In-CAISO emissions only - unspecified import emissions excluded
Total	tonnes/yr	0.1932	0.1233	0.0483	0.0411	
Average emissions intensity	kg/MWh	0.0015	0.0009	0.0003	0.0003	Emissions per MWh of sales

NO _x	Unit	2024	2026	2030	2035	Notes
Coal	tonnes/yr	-	-	-	-	Information only, not included in total
CHP	tonnes/yr	0.8389	0.8205	0.7870	0.4099	
Biogas	tonnes/yr	-	-	-	-	
Biomass	tonnes/yr	-	-	-	-	
System Power	tonnes/yr	2.1240	1.2856	0.4096	0.4238	In-CAISO emissions only - unspecified import emissions excluded
Total	tonnes/yr	2.9629	2.1061	1.1965	0.8338	
Average emissions intensity	kg/MWh	0.0224	0.0157	0.0086	0.0059	Emissions per MWh of sales

Under the Preferred Conforming Scenario using 30 MMT GHG benchmark thresholds, the figure below presents the PM_{2.5}, SO₂, and NO_x results from the CSP calculator.

Figure 7: BVES Conforming Portfolio GHG Local Emissions Results: 30 MMT Benchmark

CO ₂	Unit	2024	2026	2030	2035	Notes	
Coal	MMt/yr	-	-	-	-	Included in GHG emissions total	
CHP	MMt/yr	0.0033	0.0033	0.0032	0.0019		
Biogas	MMt/yr	-	-	-	-		
Biomass	MMt/yr	-	-	-	-		
System Power	MMt/yr	0.0516	0.0301	0.0150	0.0121		Includes emissions from in-CAISO
Asset Controlling Supplier	MMt/yr	-	-	-	-		
Total	MMt/yr	0.0548	0.0334	0.0182	0.0140	Includes both in-CAISO and import	
Average emissions intensity	tCO ₂ /MWh	0.4140	0.2483	0.1310	0.0984	Emissions per MWh of sales	
Oversupply Emissions Credits	MMt/yr	-	-	0.0000	0.0003	When hourly supply exceeds hourly load	

PM _{2.5}	Unit	2024	2026	2030	2035	Notes
Coal	tonnes/yr	-	-	-	-	Information only, not included in total
CHP	tonnes/yr	0.1803	0.1789	0.1768	0.1060	
Biogas	tonnes/yr	-	-	-	-	
Biomass	tonnes/yr	-	-	-	-	
System Power	tonnes/yr	1.8417	1.2083	0.6179	0.5482	In-CAISO emissions only - unspecified
Total	tonnes/yr	2.0219	1.3872	0.7947	0.6542	
Average emissions intensity	kg/MWh	0.0153	0.0103	0.0057	0.0046	Emissions per MWh of sales

SO ₂	Unit	2024	2026	2030	2035	Notes
Coal	tonnes/yr	-	-	-	-	Information only, not included in total
CHP	tonnes/yr	0.0192	0.0190	0.0188	0.0113	
Biogas	tonnes/yr	-	-	-	-	
Biomass	tonnes/yr	-	-	-	-	
System Power	tonnes/yr	0.1728	0.1134	0.0578	0.0513	In-CAISO emissions only - unspecified
Total	tonnes/yr	0.1920	0.1324	0.0766	0.0626	
Average emissions intensity	kg/MWh	0.0014	0.0010	0.0006	0.0004	Emissions per MWh of sales

NO _x	Unit	2024	2026	2030	2035	Notes
Coal	tonnes/yr	-	-	-	-	Information only, not included in total
CHP	tonnes/yr	0.8411	0.8309	0.8125	0.4220	
Biogas	tonnes/yr	-	-	-	-	
Biomass	tonnes/yr	-	-	-	-	
System Power	tonnes/yr	2.1272	1.3746	0.7469	0.6691	In-CAISO emissions only - unspecified
Total	tonnes/yr	2.9683	2.2055	1.5594	1.0911	
Average emissions intensity	kg/MWh	0.0224	0.0164	0.0112	0.0077	Emissions per MWh of sales

ii. Focus on Disadvantaged Communities

BVES utilized the most recent [California Communities Environmental CalEnviroScreen tool Health Screening Tool](#) (CalEnviroScreen 4.0) to determine whether any disadvantaged communities fall within the utility service territory. ~~Disadvantaged for the November 2022 filing.~~ [The modified 2022 IRP²² presents an updated discussion reviewing the determination of the state of disadvantaged communities areas defined by CalEPA’s CalEnviroScreen tool as well as an additional visual representation.](#)²³ These

²² [Refiled to R. 20-05-003 as a Tier 2 Advice Letter on May 1, 2024.](#)

²³ [California EPA. "Final Designation of Disadvantaged Communities Pursuant to Senate Bill 535." May 2022. https://calepa.ca.gov/wp-content/uploads/sites/6/2022/05/Updated-Disadvantaged-Communities-Designation-DAC-May-2022-Eng.a.hp - 1.pdf#:~:text=In%20this%20designation%2C%20CalEPA%20generally%20defines%20communities%20in,areas%20under%20the%20control%20of%20federally%20recognized%20Tribes.2](#)

communities include any community scoring in the top 25 percent statewide, any community in one of the 22 census tracts within the top five percent of communities with the highest pollution burden that do not have an overall score, any lands under control of federally recognized Tribes, or any of the 307 census identified in the 2017 Disadvantaged Communities designation by CalEPA²⁴. Table 15 reports the status CalEnviroScreen4.0 scores for those census tracts within BVES's service territory which consists of Big Bear Lake, Big Bear City, and Fawnskin.²⁵

BVES determined has prior awareness into the identification of disadvantaged populations, access and functional needs groups, medical baseline customers, and predominate languages spoken within the service area as exemplified with the development and updates of its annual Wildfire Mitigation Plans. Pursuant to R. 18-10-007 D. 20-03-004 issued on March 18, 2020, BVES surveyed its territory and customer base to understand differing populations in an effort to promote community awareness, public outreach, and support before, during, and after a wildfire.²⁶ BVES continues with quarterly engagement meetings, files a quarterly access and functional needs report, and routinely reviews any new self-identifications across its customer base.

The utility annually reviews its customer base for any new self-identifications under these major customer classification designations. Similarly, these efforts consistently reinforce that no communities within the service territory meet the designation of ~~disadvantaged community~~ indigenous or tribal communities, as well.

As discussed, BVES reaffirms that no identified disadvantaged communities exist within its service territory under the CalEPA's designation. BVES did not incorporate direct feedback from DACs or vested stakeholder groups in developing its 2022 IRP update, however, has provided updates on changes and plans for its solar and storage projects for public comment. BVES plans to carry out targeted stakeholder workshops for the next IRP update.


The map below represents the CalEPA census track at the time of this update.

Figure 8: DACs Outside of BVES Service Territory

²⁴ See <http://oehha.ca.gov/calenviroscreen/report/calenviroscreen-30> and https://calepa.ca.gov/wp-content/uploads/sites/62/2017/04/SB-535-Designation-Final6/2021/10/2021_CalEPA_Prelim_DAC_1018_English_a.pdf?emrc=2970f7#:~:text=In%20the%20most%20recent%20designation%2C%20in%202017%2C%20CalEPA,but%20did%20not%20have%20an%20overall%20CalEnviroScreen%20score.

²⁵ Fawnskin is located in census track 6071011300.

²⁶ BVES. "Wildfire Mitigation Plan 2020 Revision Refile." pg. 212. https://www.bvesinc.com/assets/migrated/managed/bveswmp/BVES_2020_WMP_REVISION_20200226_Clean.pdf.

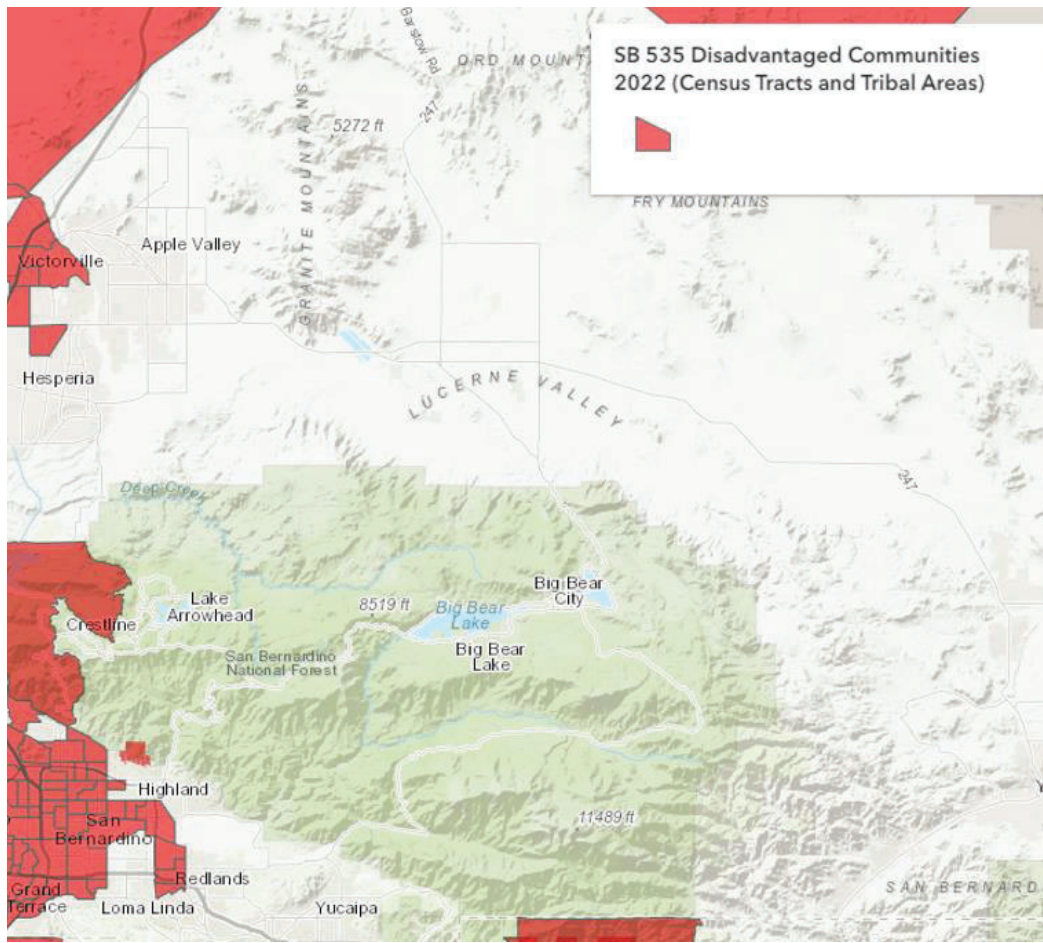

While the utility does not immediately border any tribal lands, BVES consults with the Morongo and San Manuel Tribes with regards to projects jointly enacted with the United States Forest Service (USFS) as BVES’s territory is surrounded by USFS land. Additionally, capital projects such as the Radford circuit covered conductor replacement initiative require coordination and awareness with any neighboring tribal agencies.²⁷

While BVES recognizes the emphasis on engaging with and DACs in the development of the IRP Conforming Portfolios, it is important to note that there are no DACs directly within BVES’s service territory as defined by current regulatory frameworks. However, BVES understands that air pollution and environmental impacts do not recognize geographic boundaries. Consequently, our commitment extends beyond our immediate service area to encompass potential impacts on nearby regions that might experience indirect effects from our operations.

BVES will continue to track applicable disadvantaged community metric reports to ensure proper representation of its customer base that may be impacted by the local emissions profile while ensuring safe and reliable delivery of electricity. BVES will also incorporate community engagement workshops to review progress of the next IRP development, which will benefit the community at large.

²⁷ The project consists of replacing a bare wire sub-transmission line that operates at 34.5 kV with a capacity of 8 MW and 95 wood poles with high performance covered conductor and fire resistant (ductile iron) poles.

In lieu of direct DAC engagement within its service territory, BVES continues to actively explore ways to contribute positively to broader regional initiatives that benefit DACs.

Table 15: Census Tracts and Demographics within BVES's Service Territory

Census Tract Number	Total Population	County	CES 4.0 Percentile	CES 4.0 Percentile Range	SB 535 Disadvantaged Community
6071011102	1,760	San Bernardino	34	30-40	No
6071011203	1,404	San Bernardino	53	50-60	No
6071011204	1,685	San Bernardino	23	20-30	No
6071011300	1,398	San Bernardino	51	50-60	No
6071011401	4,507	San Bernardino	54	50-60	No
6071011403	3,451	San Bernardino	17	10-20	No
6071011404	4,585	San Bernardino	19	10-20	No
6071011500	2,125	San Bernardino	24	20-30	No

BVES understands that emissions associated with its system contracts and market purchases do not abide by geographic boundaries but instead are felt across the broader region. As a part of this planning effort BVES ensured that the Preferred Conforming Portfolios met the emissions benchmarks and as such limit BVES’s future emission significantly, especially compared to a portfolio scenario completely reliant on system power. By planning for a low emissions future, BVES aims to limit the impact of emissions associated with its generation on disadvantaged communities across the state.

e. Cost and Rate Analysis

Cost and Rate Analysis Background and Methodology

BVES’s power supply costs come from two categories: purchase power costs and owned asset costs (including the BVPP). Because BVES has historically relied predominantly on system power contracts and PCC3 contracts, purchase power costs have accounted for more than 93 percent of BVES’s total supply cost. Other costs beyond purchase power and owned assets include transmission on SCE-owned and operated facilities (including the 33 kV lines from Cottonwood Substation to Goldhill transfer station and Zanja Substation to BVES’s Village Substation), transmission over the CAISO grid, ancillary services charges, reserve requirements, schedule-dispatch charges and CAISO grid-management charges, including CRRs.

When modeling portfolio costs and associated rate payer impacts, BVES relied on the inputs and modeling approach used in GRC application A.22-08-010 to ensure consistency between proceedings. Notably the costs shown in **Table 16: Revenue Requirements and Bundled System Average Rates for Baseline Scenario (2021 \$)** Table 16 for the “Baseline Scenario” directly reflects those costs presented in A.22-08-010 though adjusted to reflect the IEPR load forecast.²⁸ Key inputs that were held constant from A.22-08-010 in this modeling exercise included: system contract prices and REC price

²⁸ In determining costs for the "Baseline Scenario" BVES utilized the supply portfolio assumptions from A.22-08-010 with those variable costs (system contracts, energy purchases, and similar) adjusted downwards to reflect lower load forecast utilized in this IRP compared to the load forecast utilized in A.22-08-010. Fixed costs like CAISO charges were assumed fixed and not adjusted downwards.

assumptions, forward power prices for day-ahead purchases, and the requested change to return on equity and associated weighted cost of capital.

Purchase power costs were modeled following the methodology BVES utilized in A.22-08-010 whereby costs related to capacity and energy purchases are built up from volumes purchased and the associated purchase price. Fixed costs related to BVES's market purchases and use of SCE's transmission system are also included and discussed later in this section. Where the makeup of purchase power contracts deviated from the Baseline Scenario presented in Table 16 (e.g., both Preferred Conforming Portfolios include 7x24 block renewable contracts), day-ahead and system contract purchases were reduced to accommodate the additional contract generation in-line with results shown in the RDT and CSP calculators. Future contract costs for planned 7x24 block renewable contracts were estimated by indexing LCOE estimates for similar sources of firm renewable power (e.g., geothermal generation) to BVES's most recent estimate for the upcoming 7x24 block renewable contract set to deliver in 2024.

Because both the Baseline Scenario and the Preferred Conforming Portfolios all depend in some part on contracts for system power as well as day-ahead purchases for monthly short positions, a key driver in these costs estimates are the forecast of CAISO market prices. Since the inception of the CAISO market, BVES has been able to meet its monthly short positions with Day-Ahead purchases and Inter-SC Trades. The price BVES pays for short positions is the Locational Marginal Price (LMP) at the default SCE load aggregation point and is calculated and published by approximately 1:00 PM the day before power flows. To align this cost exercise with results presented in A.22-08-010, BVES used power market forward curves from November 2021 published by IHS Markit.

Recently, wholesale power markets have seen significant price volatility stemming from a myriad of factors including the COVID-19 pandemic, an overall slowdown in US natural gas production, and persistent issues and required maintenance for natural gas storage and delivery in Southern California. At the same time hydro production, a key source for low-cost baseload generation, has plunged below 50 percent of normal production in Northern California boosting the demand for natural gas. Looking forward commodity prices are expected to decline from their current high-point as storage and delivery maintenance is completed and as natural gas demand on the whole declines in response to policy initiatives and clean energy goals. Intermittency of renewables production will continue to challenge the CAISO markets as gas fired generation assets with fast ramp-up capabilities are required to follow renewable production declines. Careful planning will pay off significantly in mitigating the supply cost exposure due to market price volatility during these uncertain times.

BVES will continue to manage energy requirement prices with firm power agreements after the existing and proposed contracts expire through this IRP forecast horizon. Electricity and capacity prices are anticipated to increase, potentially creating price spikes in the energy and RA capacity market. The result would be significant increases in energy and non-energy price components, which would affect supply costs for BVES. BVES will pursue energy and capacity products to mitigate this potentially significant price increase from 2023 to 2035.

Transmission costs represent the next largest cost component within BVES purchase power costs. BVES pays SCE for transmission service on SCE's 33 kV lines that deliver power up the mountain to BVES, and for SCE wholesale distribution access tariff (WDAT) service (for service from SCE's Victor Substation near Victorville to SCE's Cottonwood Substation in Lucerne Valley and from SCE's Vista Substation to SCE's

Zanja Substation near Redlands). BVES also pays the CAISO for transmission of energy imported into and through California. Together these transmission charges are approximately \$3,700,000 annually.²⁹

Currently, BVES is charged on a monthly basis for four different uses of SCE's non-CAISO grid. The four different categories of monthly charges for transmission and wholesale distribution services from SCE total approximately \$890,000 annually. The CAISO charges BVES, through its Scheduling Coordinator (SC) Automated Power Exchange (APX), for ancillary services, grid management charges, imbalance energy, and CAISO uplifts.³⁰ Ancillary services are the services necessary to follow the moment-to-moment changes in load, such as regulation, load following, voltage support and operating reserve capacity. Grid management charges are the cost of operating the California transmission grid and include costs associated with running the CAISO markets. Imbalance energy charges apply to deviations between scheduled and metered energy and typically represent a very small portion of BVES's energy requirements. BVES will continue to strive to minimize imbalance costs through accurate day ahead power forecasts.

Congestion Costs are one of the two components of the cost to deliver energy from one point to another within the CAISO (transmission losses being the other). The cost of congestion is the difference in the Marginal Congestion Cost (MCC) component of the LMP between the price nodes specified for energy delivery and takeout.³¹ For BVES supply contracts, the source from the CAISO settlements perspective is the aggregated generation hub price for SP15 (TH_SP15_Gen-APND) area.³² The sink, or takeout, point is the SCE Default Load Aggregation Price (DLAP_SCE). This price is the load weighted aggregation of all load nodes within the SCE TAC area. The Congestion Cost is calculated using the Day Ahead Market Prices as follows:

$$\text{Congestion Costs} = \text{Source Marginal Congestion Cost} - \text{Sink Marginal Congestion Costs}$$

Congestion costs can be mitigated through the use of CRRs. BVES's power contracts are for delivery to the SP15 area, so BVES must bear the cost for any congestion between SP15 and the DLAP. As the economic conditions within California improve and system load increases, the cost of congestion may increase corresponding to heavier system loading.

While purchase power costs are anticipated to represent the majority of supply costs for BVES through the forecast period under Preferred Conforming Portfolios, owned asset costs will grow as new facilities come online. As discussed previously in this IRP, BVES plans to build a 5 MW solar facility and a 5 MW storage facility with both facilities planned to come online by Q4 of 2024 or early 2025. BVES is still in

²⁹ Including Schedule Coordinator fees.

³⁰ CAISO uplift charges are collected from all customers to ensure market participants, including suppliers, are made whole. They reflect costs incurred to run the market for which there is no direct assignment to specific LSEs. They are collected from all customers to ensure the CAISO market is ultimately revenue neutral.

³¹ The CAISO's market design creates marginal nodal or locational prices in its Day Ahead market process. The Locational Marginal Price or LMP is the algebraic sum of the 1) Marginal Energy Cost (MCE), 2) MCC, and 3) Marginal Loss Cost (MLC).

³² The CAISO derives the aggregated generation hub price by calculating a weighted average for all generators within the SP15 area. Weights are pre-determined by the CAISO on an annual basis based on previous year output. Generator hub prices are calculated for NP15, ZP26 and SP15 areas. Generation scheduled to the aggregate generation hub is paid/charged the weighted hub price as calculated in the Day Ahead market.

the pre-planning phase for these projects and as such anticipates asset costs and resulting impact on rate payers may change as additional details of the projects are finalized. For the cost estimate presented here BVES modeled costs associated with the key revenue requirement line items of Net Income, Operations and Maintenance Expense, Administrative and General Expense, Property and Local Taxes, and State and Federal Income Tax, which result in a final all-in annual expense. BVES leveraged estimates of variable operations and maintenance expense by technology type from the RESOLVE model.

To maintain consistency with BVES’s recent GRC proceeding, the IRP cost and rate analysis and calculations leveraged the same return on equity and associated weighted cost of capital as submitted in the 2023 Test Year GRC. BVES also included an adjustment to account for an assumed 26 percent ITC tax credit for the solar facility and a 20 percent ITC tax credit for the storage facility³³. Because these future owned assets were not included as a part of BVES’s GRC these costs are not included in Table 16.

Table 16: Revenue Requirements and Bundled System Average Rates for Baseline Scenario (2021 \$)

Line No.	Cost Category	2023	2024	2025	2026	2027	2028
1	Distribution	\$ 7,329,038	\$ 7,449,956	\$ 7,572,869	\$ 7,697,810	\$ 7,824,813	\$ 7,953,910
2	Transmission	\$ 210,826	\$ 216,962	\$ 223,277	\$ 229,775	\$ 236,463	\$ 243,345
3	Generation (Less Purchase Power)	\$ 728,224	\$ 750,827	\$ 774,131	\$ 798,159	\$ 822,932	\$ 848,475
4	Demand Side Programs	\$ -	\$ -	\$ -	\$ -	\$ -	\$ -
5	Other (Purchase Power Expense)	\$10,688,810	\$10,181,350	\$ 9,521,969	\$ 9,837,405	\$10,258,877	\$10,284,901
6 (sum lines 1-5)	Preferred Conforming Portfolio Revenue Requirement	\$18,956,898	\$18,599,095	\$18,092,246	\$18,563,150	\$19,143,085	\$19,330,631
7	System Sales (GWh)	143.0	143.0	144.1	145.1	146.5	147.6
8	Bundled Sales (GWh)	143.0	143.0	144.1	145.1	146.5	147.6
9	System Average Delivery Rate (¢/kWh)	5.27	5.36	5.41	5.46	5.50	5.55
10	Bundled Generation Rate (¢/kWh)	0.51	0.52	0.54	0.55	0.56	0.57
11	Bundled System Average Rate (¢/kWh)	13.26	13.00	12.55	12.79	13.07	13.09

Table 16 Continued

Line No.	Cost Category	2029	2030	2031	2032	2033	2034	2035
1	Distribution	\$ 8,085,138	\$ 8,218,531	\$ 8,354,124	\$ 8,491,955	\$ 8,632,059	\$ 8,774,475	\$ 8,919,241
2	Transmission	\$ 250,428	\$ 257,716	\$ 265,217	\$ 272,936	\$ 280,880	\$ 289,055	\$ 297,468

³³ BVES is aware that the recently passed Inflation Reduction Act modifies these tax incentives as well as provides additional areas of financial incentive for renewable facilities. BVES will update these assumptions as well as the estimated installed asset price in future proceedings as appropriate while the projects continue to develop in the pre-construction phase.

Line No.	Cost Category	2029	2030	2031	2032	2033	2034	2035
3	Generation (Less Purchase Power)	\$ 874,810	\$ 901,963	\$ 929,958	\$ 958,823	\$ 988,583	\$ 1,019,267	\$ 1,050,903
4	Demand Side Programs	\$ -	\$ -	\$ -	\$ -	\$ -	\$ -	\$ -
5	Other (Purchase Power Expense)	\$ 10,469,468	\$ 11,314,199	\$ 11,711,811	\$ 11,968,934	\$ 12,296,427	\$ 12,695,906	\$ 13,150,024
6 (sum lines 1-5)	Preferred Conforming Portfolio Revenue Requirement	\$ 19,679,844	\$ 20,692,409	\$ 21,261,110	\$ 21,692,647	\$ 22,197,949	\$ 22,778,703	\$ 23,417,636
7	System Sales (GWh)	148.8	149.9	150.9	151.6	152.4	153.0	153.8
8	Bundled Sales (GWh)	148.8	149.9	150.9	151.6	152.4	153.0	153.8
9	System Average Delivery Rate (¢/kWh)	5.60	5.65	5.71	5.78	5.85	5.92	5.99
10	Bundled Generation Rate (¢/kWh)	0.59	0.60	0.62	0.63	0.65	0.67	0.68
11	Bundled System Average Rate (¢/kWh)	13.22	13.80	14.09	14.31	14.57	14.88	15.22

Table 17: Revenue Requirements and Bundled System Average Rates for 25 MMT Preferred Conforming Portfolio (2021 \$)

Line No.	Cost Category	2023	2024	2025	2026	2027	2028
1	Distribution	\$ 7,329,038	\$ 7,449,956	\$ 7,572,869	\$ 7,697,810	\$ 7,824,813	\$ 7,953,910
2	Transmission	\$ 210,826	\$ 216,962	\$ 223,277	\$ 229,775	\$ 236,463	\$ 243,345
3	Generation (Less Purchase Power)	\$ 728,224	\$ 750,827	\$ 3,754,858	\$ 3,771,600	\$ 3,644,317	\$ 3,523,074
4	Demand Side Programs	\$ -	\$ -	\$ -	\$ -	\$ -	\$ -
5	Other (Purchase Power Expense)	\$10,661,906	\$10,372,884	\$10,892,193	\$11,025,737	\$11,207,596	\$11,185,101
6 (sum lines 1-5)	Preferred Conforming Portfolio Revenue Requirement	\$18,929,994	\$18,790,629	\$22,443,197	\$22,724,923	\$22,913,188	\$22,905,430
7	System Sales (GWh)	143.0	143.0	144.1	145.1	146.5	147.6
8	Bundled Sales (GWh)	143.0	143.0	144.1	145.1	146.5	147.6
9	System Average Delivery Rate (¢/kWh)	5.27	5.36	5.41	5.46	5.50	5.55
10	Bundled Generation Rate (¢/kWh)	0.51	0.52	2.61	2.60	2.49	2.39
11	Bundled System Average Rate (¢/kWh)	13.24	13.14	15.57	15.66	15.64	15.51

Table 17 Continued

Line No.	Cost Category	2029	2030	2031	2032	2033	2034	2035
1	Distribution	\$ 8,085,138	\$ 8,218,531	\$ 8,354,124	\$ 8,491,955	\$ 8,632,059	\$ 8,774,475	\$ 8,919,241

Line No.	Cost Category	2029	2030	2031	2032	2033	2034	2035
2	Transmission	\$ 250,428	\$ 257,716	\$ 265,217	\$ 272,936	\$ 280,880	\$ 289,055	\$ 297,468
3	Generation (Less Purchase Power)	\$ 3,407,732	\$ 3,298,159	\$ 3,197,276	\$ 3,101,912	\$ 3,011,949	\$ 2,931,130	\$ 2,851,549
4	Demand Side Programs	\$ -	\$ -	\$ -	\$ -	\$ -	\$ -	\$ -
5	Other (Purchase Power Expense)	\$ 13,725,787	\$ 13,785,135	\$ 13,781,429	\$ 13,768,569	\$ 13,797,956	\$ 14,237,910	\$ 14,254,094
6 (sum lines 1-5)	Preferred Conforming Portfolio Revenue Requirement	\$ 25,469,085	\$ 25,559,541	\$ 25,598,046	\$ 25,635,372	\$ 25,722,844	\$ 26,232,570	\$ 26,322,352
7	System Sales (GWh)	148.8	149.9	150.9	151.6	152.4	153.0	153.8
8	Bundled Sales (GWh)	148.8	149.9	150.9	151.6	152.4	153.0	153.8
9	System Average Delivery Rate (¢/kWh)	5.60	5.65	5.71	5.78	5.85	5.92	5.99
10	Bundled Generation Rate (¢/kWh)	2.29	2.20	2.12	2.05	1.98	1.92	1.85
11	Bundled System Average Rate (¢/kWh)	17.11	17.05	16.96	16.91	16.88	17.14	17.11

Table 18: Revenue Requirements and Bundled System Average Rates for 30 MMT Preferred Conforming Portfolio (2021 \$)

Line No.	Cost Category	2023	2024	2025	2026	2027	2028
1	Distribution	\$ 7,329,038	\$ 7,449,956	\$ 7,572,869	\$ 7,697,810	\$ 7,824,813	\$ 7,953,910
2	Transmission	\$ 210,826	\$ 216,962	\$ 223,277	\$ 229,775	\$ 236,463	\$ 243,345
3	Generation (Less Purchase Power)	\$ 728,224	\$ 750,827	\$ 3,754,858	\$ 3,771,600	\$ 3,644,317	\$ 3,523,074
4	Demand Side Programs	\$ -	\$ -	\$ -	\$ -	\$ -	\$ -
5	Other (Purchase Power Expense)	\$ 10,661,906	\$ 10,372,884	\$ 10,892,193	\$ 11,025,737	\$ 11,207,596	\$ 11,185,101
6 (sum lines 1-5)	Preferred Conforming Portfolio Revenue Requirement	\$ 18,929,994	\$ 18,790,629	\$ 22,443,197	\$ 22,724,923	\$ 22,913,188	\$ 22,905,430
7	System Sales (GWh)	143.0	143.0	144.1	145.1	146.5	147.6
8	Bundled Sales (GWh)	143.0	143.0	144.1	145.1	146.5	147.6
9	System Average Delivery Rate (¢/kWh)	5.27	5.36	5.41	5.46	5.50	5.55
10	Bundled Generation Rate (¢/kWh)	0.51	0.52	2.61	2.60	2.49	2.39
11	Bundled System Average Rate (¢/kWh)	13.24	13.14	15.57	15.66	15.64	15.51

Table 18 Continued

Line No.	Cost Category	2029	2030	2031	2032	2033	2034	2035
1	Distribution	\$ 8,085,138	\$ 8,218,531	\$ 8,354,124	\$ 8,491,955	\$ 8,632,059	\$ 8,774,475	\$ 8,919,241

2	Transmission	\$	\$	\$	\$	\$	\$	\$
		250,428	257,716	265,217	272,936	280,880	289,055	297,468
3	Generation (Less Purchase Power)	\$	\$	\$	\$	\$	\$	\$
		3,407,732	3,298,159	3,197,276	3,101,912	3,011,949	2,931,130	2,851,549
4	Demand Side Programs	\$	\$	\$	\$	\$	\$	\$
		-	-	-	-	-	-	-
5	Other (Purchase Power Expense)	\$	\$	\$	\$	\$	\$	\$
		12,981,527	13,152,515	13,207,618	13,237,689	13,313,541	13,946,849	13,985,887
6 (sum lines 1-5)	Preferred Conforming Portfolio Revenue Requirement	\$	\$	\$	\$	\$	\$	\$
		24,724,824	24,926,921	25,024,235	25,104,492	25,238,429	25,941,509	26,054,146
7	System Sales (GWh)	148.8	149.9	150.9	151.6	152.4	153.0	153.8
8	Bundled Sales (GWh)	148.8	149.9	150.9	151.6	152.4	153.0	153.8
9	System Average Delivery Rate (c/kWh)	5.60	5.65	5.71	5.78	5.85	5.92	5.99
10	Bundled Generation Rate (c/kWh)	2.29	2.20	2.12	2.05	1.98	1.92	1.85
11	Bundled System Average Rate (c/kWh)	16.61	16.63	16.58	16.56	16.56	16.95	16.94

Cost and Rate Impact

Table 16 through Table 18 report the results of BVES’s cost and rate impact analysis for the Baseline Scenario (reflecting those inputs and assumptions from A.22-08-010) and the two Preferred Conforming Portfolios. In terms of the Bundled System Average Rate (total costs divided by total load), the 25 MMT scenario is shown to be 12.4 percent higher by 2035 compared to the Baseline Scenario and the 30 MMT scenario is shown to be 11.3 percent higher than the Baseline Scenario by 2035. The largest cost disparities between these profiles occur in 2029 and decline throughout the remainder of the IRP forecast horizon. The drivers for this increased cost stem from both categories of supply costs – purchase power and owned assets. Purchase power costs increased under the Preferred Conforming Portfolios owing to the inclusion of higher priced 7x24 block renewable power contracts rather than system power contracts or market purchases. This impact is seen most in 2029 when the second 7x24 block renewable contract is assumed to begin delivering in both conforming portfolios.

While these contracts are higher priced than alternative options like system power contracts, they present several key strengths that outweigh their estimated price including but not limited to the bundled nature of the product (these products offer 1:1 RECs), the firm nature of the product (ensuring BVES does not have to over-size renewable contracts to make up for the shaped nature of wind or solar only PPAs), the simplicity in contracting for and administering fewer contracts instead of numerous alternative renewable contracts and increased local reliability. BVES’s portfolio modeling indicated that relying on wind or solar only PPAs would necessitate four or more renewable contracts over the IRP forecast horizon (the larger number necessitated by the shaped nature of the generation from these technologies), while the same emissions benchmarks could be achieved from only two additional 7x24

block renewable contracts.³⁴ As discussed elsewhere in this IRP filing, BVES has struggled to contract for renewable generation historically owing to low bid receivables and lack of cost-competitive offers and thus minimizing the number of required contracts is essential in ensuring supply portfolio achievability. Since the last IRP cycle, BVES has continuously issued RFPs for available RE contracts with preference given to bundled products including RECs. Only recently, BVES has identified a potential pathway to securing firm RE PPAs, for which an initial purchase agreement for roughly one-third of supply needs will be met by 2024, subject to negotiations and contracting requirements.

Owned asset costs as reflected on Line 3 of Tables 16 ~~Through~~ 18 also increase under the Preferred Conforming Portfolios compared to the Baseline Scenario as they include the costs associated with BVES's solar project and the separate storage project. While these assets are higher priced than what commensurate system contracts or market purchases would require, the benefits these projects provide in terms of reliability for BVES's system and independence from the grid cannot be overstated.

Ultimately, BVES is keenly aware of the current financial pressures on rate payers in this time of high inflation and significant power market volatility. BVES considered portfolio costs in each step of this IRP planning process from the initial investigation of a broad range of supply portfolios through to the final comparison between the Baseline Scenario and Preferred Conforming Portfolios. While the portfolios presented here represent an increased cost compared to the Baseline Scenario, it is important to remember the Baseline Scenario does not meet the emissions benchmarks and thus does not provide a fulsome view of BVES's future supply costs under these emissions requirements. To meet the further encouraged GHG reduction policy initiatives and clean energy targets set by the state of California, significant changes will have to be made to BVES's supply portfolio and that evolution in generation will ultimately be felt by the utility and the rate payer.

f. System Reliability Analysis

The following tables depict the RDT modeling results for utility-controlled energy supply. Due to the lack of CAISO-controlled resources mapped to RSP-identified generators and the BVPP considered to reduce capacity needs for BVES's local load center, RA system capacity needs must be met through available contracts as no physical resources currently owned by or contracted with the utility provide this qualified capacity. To address CAISO system reliability needs, BVES's load can be reduced by continued CAISO BTM deployments and other load modifying efforts. BVES assumes enough RA to be available in future years to compensate for any supply shortfalls. BVES continues to seek RA capacity reservations for flexible and generic system needs. BVES will update the Commission through RDT biannual filings as contracts are secured over the 2023-2035 horizon.

Table 19: 25 MMT Load and Resource Table by Contract Status

³⁴ BVES included the planned generation from the 7x24 block renewable contract it is currently negotiating to begin delivering in Q4 2024 in all portfolios analyzed.

Load and Resource Table by Contract Status													
	2024	2025	2026	2027	2028	2029	2030	2031	2032	2033	2034	2035	
LSE reliability need (MW)	47	49	50	49	48	49	51	49	48	46	45	43	
ELCC by contract status (effective MW)													
Online	-	-	-	-	-	-	-	-	-	-	-	-	
Development	-	-	-	-	-	-	-	-	-	-	-	-	
Review	-	-	-	-	-	-	-	-	-	-	-	-	
PlannedExisting	-	-	-	-	-	-	-	-	-	-	-	-	
PlannedNew	-	1	1	1	0	0	0	0	0	0	0	0	
BTM PV	0	0	0	0	1	1	0	1	1	1	1	1	
LSE total supply (effective MW)	0	1	1	1	1	1	1	1	1	1	1	1	
Net capacity position (+ve = excess, -ve = shortfall) (effective MW)	(47)	(48)	(49)	(48)	(47)	(48)	(50)	(48)	(47)	(45)	(44)	(42)	

Load and Resource Table by Contract Status													
	2024	2025	2026	2027	2028	2029	2030	2031	2032	2033	2034	2035	
LSE reliability need (MW)	47	49	50	49	48	49	51	49	48	46	45	43	
ELCC by contract status (effective MW)													
Online	-	-	-	-	-	-	-	-	-	-	-	-	
Development	-	-	-	-	-	-	-	-	-	-	-	-	
Review	-	-	-	-	-	-	-	-	-	-	-	-	
PlannedExisting	-	-	-	-	-	-	-	-	-	-	-	-	
PlannedNew	-	1	1	1	0	0	0	0	0	0	0	0	
BTM PV	0	0	0	0	1	1	0	1	1	1	1	1	
LSE total supply (effective MW)	0	1	1	1	1	1	1	1	1	1	1	1	
Net capacity position (+ve = excess, -ve = shortfall) (effective MW)	(47)	(48)	(49)	(48)	(47)	(48)	(50)	(48)	(47)	(45)	(44)	(42)	

Figure 9: 25 MMT LSE Capacity by Contract Status


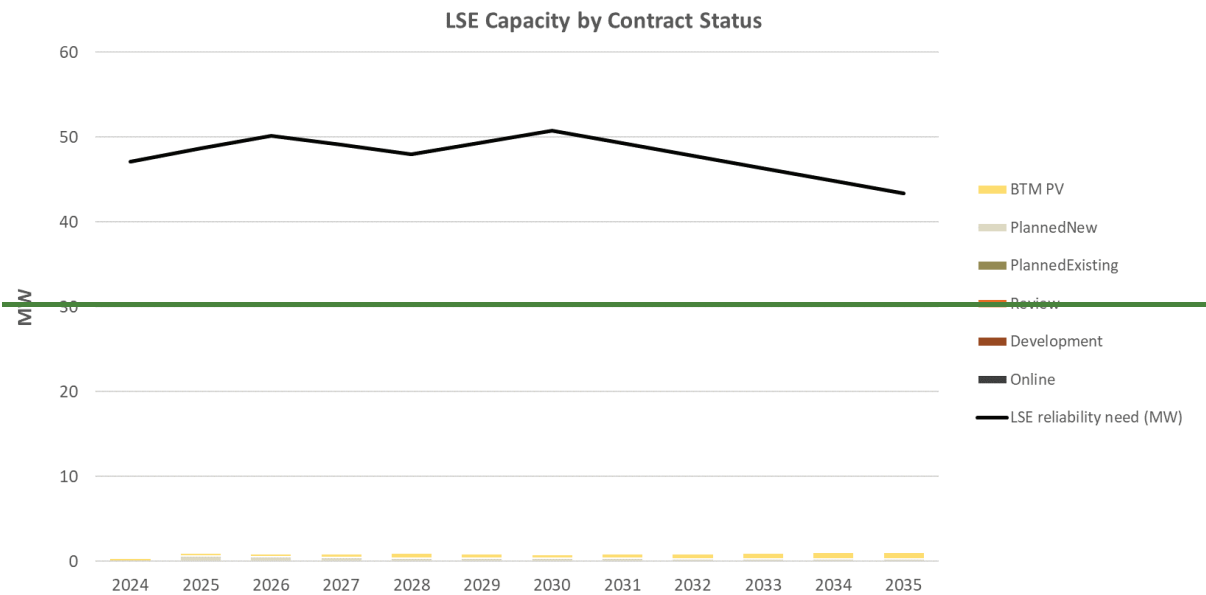




Table 20: 30 MMT Load and Resource Table by Contract Status

<i>Load and Resource Table by Contract Status</i>													
	2024	2025	2026	2027	2028	2029	2030	2031	2032	2033	2034	2035	
LSE reliability need (MW)	49	51	52	50	48	48	47	46	46	45	45	44	
ELCC by contract status (effective MW)													
Online	-	-	-	-	-	-	-	-	-	-	-	-	
Development	-	-	-	-	-	-	-	-	-	-	-	-	
Review	-	-	-	-	-	-	-	-	-	-	-	-	
PlannedExisting	-	-	-	-	-	-	-	-	-	-	-	-	
PlannedNew	-	1	1	1	0	0	0	0	0	0	0	0	
BTM PV	1	1	1	1	1	1	0	1	1	1	1	1	
LSE total supply (effective MW)	1	1	1	1	1	1	1	1	1	1	1	1	
Net capacity position (+ve = excess, -ve = shortfall) (effective MW)	(48)	(49)	(51)	(49)	(47)	(47)	(46)	(46)	(45)	(44)	(44)	(43)	
<i>Load and Resource Table by Contract Status</i>													
	2024	2025	2026	2027	2028	2029	2030	2031	2032	2033	2034	2035	
LSE reliability need (MW)	49	51	52	50	48	48	47	46	46	45	45	44	
ELCC by contract status (effective MW)													
Online	-	-	-	-	-	-	-	-	-	-	-	-	
Development	-	-	-	-	-	-	-	-	-	-	-	-	
Review	-	-	-	-	-	-	-	-	-	-	-	-	
PlannedExisting	-	-	-	-	-	-	-	-	-	-	-	-	
PlannedNew	-	1	1	1	0	0	0	0	0	0	0	0	
BTM PV	1	1	1	1	1	1	0	1	1	1	1	1	
LSE total supply (effective MW)	1	1	1	1	1	1	1	1	1	1	1	1	
Net capacity position (+ve = excess, -ve = shortfall) (effective MW)	(48)	(49)	(51)	(49)	(47)	(47)	(46)	(46)	(45)	(44)	(44)	(43)	

Figure 10: 30 MMT LSE Capacity by Contract Status

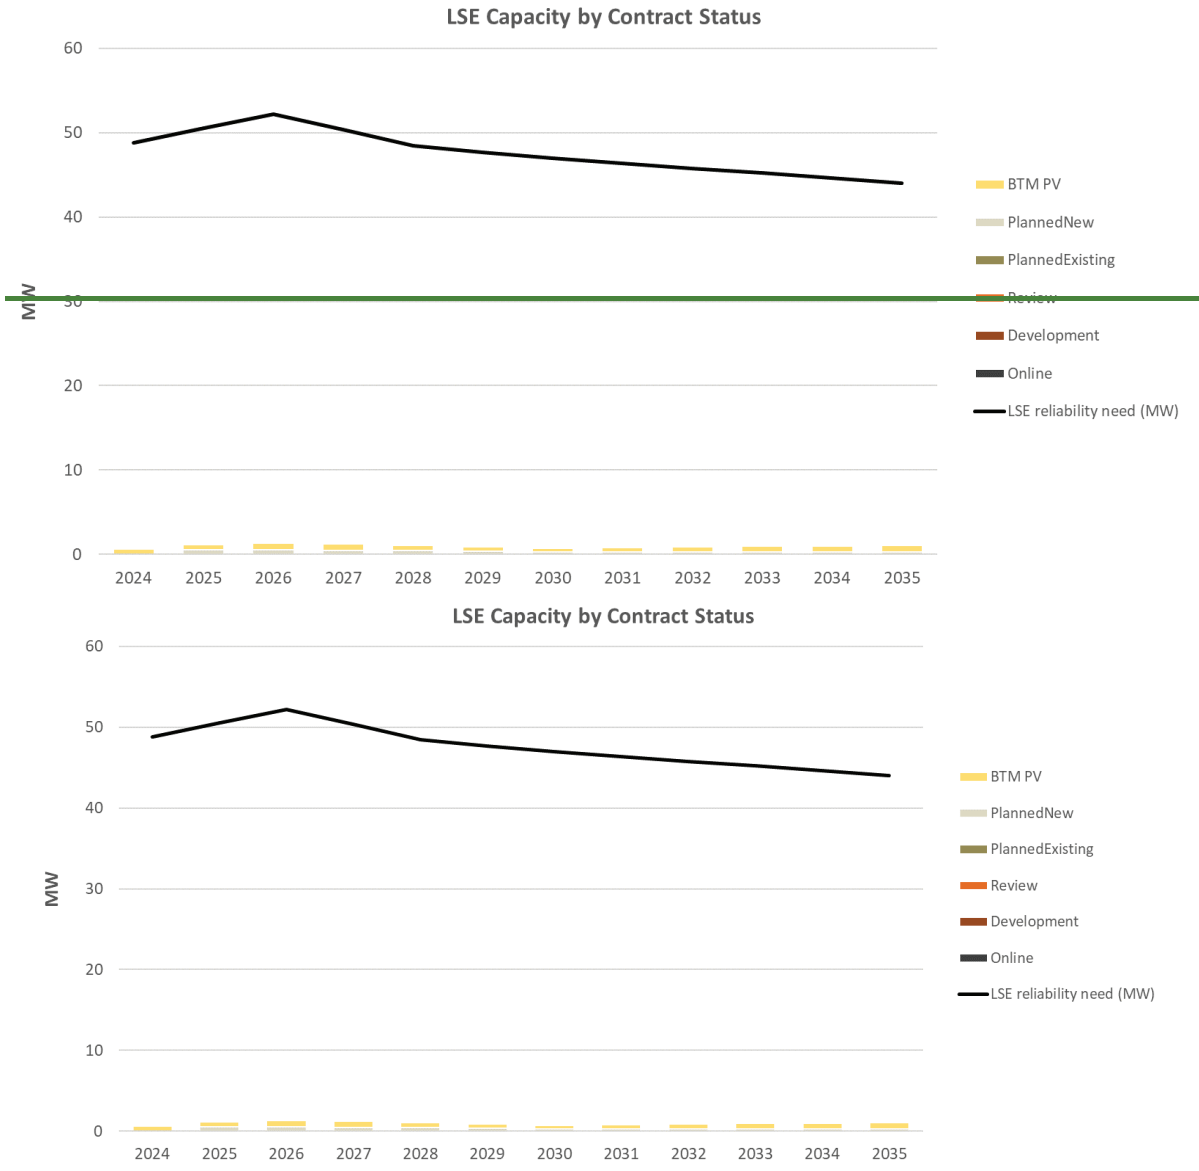

The potential significant increase in load due to forecasted expansion at Snow Summit and implementation of BVES-owned solar PV and storage projects will modify the hourly load profile and shift energy use towards a more fully utilized capacity. Facilitating this change in the load shape and capacity utilization will be the battery used for stored energy forecasted to come online in later years. Daytime load is increased as the battery charges over a four-hour period, and the evening load is reduced as the battery discharges. This will allow BVES to serve load above the capacity limit set by the SCE transmission contract serving BVES and the BVPP capacity combined. Planned solicitations to procure renewable firm contracts will also support load shape flattening as reliance on system power agreements is reduced over the ten-year planning cycle.

The annual and seasonal contracts combined will hedge approximately 90 percent of the load requirement through 2024 with anticipated wholesale market purchases to meet the shortfall in 2023 that is a result of delayed implementation of the solar generating facility. The BVPP provides a partial hedge for the remaining 10 percent as gas prices still drive the BVPP generation marginal power cost.

The BVPP has an 8.4 MW capacity and can therefore provide hedge equal to the gas price plus transportation cost at the approximate 12,000 BTU/kWh heat rate of the BVPP. Although this provides some protection, the BVPP supply price is subject to potential gas price spikes.

In 2004, the CPUC adopted an RA policy framework (PUC Section 380) to ensure the reliability of electric service in California. In an effort to meet its RA requirements, BVES will continue to issue solicitations to contract RA resources including a 15 percent reserve margin and will use its BVPP as a BTM DG resource. BVES will also continue to comply with the CAISO Tariff applicable to LSEs and their RA obligations through its SC.

BVES complies with Federal Energy Regulatory Commission requirements and the CAISO Tariff by following these key provisions:

- BVES closely mirrors the State’s monthly coincident peak demand calculation and provides the data to the CEC.³⁵
- BVES treats the BVPP as a distributed generation resource because the BVPP is not under a PGA and is behind the CAISO metering point.

Other options for reducing the RA obligations and the associated cost will include development of the BVES-owned solar project and to facilitate further renewable DG growth in the residential and commercial sectors, as well as the development of the 5 MW / 20 MWh (four-hour) battery solution. These sources of solar production will decrease BVES’s overall load and therefore reduce the RA requirement for BVES. BVES is assessing the benefits of stored power as a means to manage its load profile and reduce peak load and therefore contribute to the reduction of its RA requirement. Results of the preliminary analysis indicate that the battery solution would provide a reduction in the RA requirement, a daily arbitrage, an increase in capacity served, and other load shaping and frequency benefits.

The planned solar project will also offer a long-term strategy on pricing, RA, RECS, a daytime capacity increase, and a means of reducing emissions for BVES. The Federal Investment Tax Credit available for the solar and battery solution makes this proposal even more cost effective for customers provided that this incentive is available in the implementation stage.

Due to its small size and as a distribution-only utility, BVES has virtually no impact on the CAISO system. BVES’s peak load of approximately 45 MW when compared to the CAISO peak load of over 45,000 MWs represents less than one percent of the total CAISO peak load. Compared to the CPUC 2021 RSP, BVES presents the following table.

Table 21: BVES Resource Mix in 2035 Compared to RSP

RSP Resource Mix (Cumulative MWs) Compared to 2019-2020 RSP Assessment	25 MMT Scenario Preferred	30 MMT Scenario Preferred	Comments
---	---------------------------	---------------------------	----------

³⁵ The CEC reviews this data and provides to BVES a procurement obligation value consistent with the treatment provided to other CPUC-jurisdictional LSEs.

Resource Type	2020	2021	2022	2023	2024	2026	2030	Owned & Contracted Resources (rounded whole MWs) in 2035		
Nuclear	2,935	2,935	2,935	2,935	1,785	635	635	0	0	<i>BVPP</i>
CHP	2,296	2,296	2,296	2,296	2,296	2,296	2,296	0	0	
Natural Gas	27,562	25,113	25,113	25,113	25,113	25,113	25,084	8	8	
Coal	480	480	480	480	480	-	-	0	0	
Hydro (Large)	7,070	7,070	7,070	7,070	7,070	7,070	7,070	0	0	
Hydro (Scheduled Imports)	2,852	2,852	2,852	2,852	2,852	2,852	2,852	0	0	
Biomass	903	903	903	903	903	903	901	0	0	
Geothermal	1,851	1,851	1,851	1,851	1,851	1,851	1,851	0	0	
Hydro (Small)	974	974	974	974	974	974	974	0	0	
Wind	7,357	7,490	9,406	9,406	10,193	10,193	10,293	0	0	
Out-of-State Wind on New	-	-	-	-	-	-	606	0	0	<i>BVPP</i>
Transmission	-	-	-	-	-	-	-	0	0	
Solar	16,310	18,766	20,887	22,887	22,887	22,887	25,905	13	13	<i>BVES Solar Facility</i>
Customer Solar	9,827	11,137	12,284	13,303	14,288	16,156	20,066	26	26	<i>IEPR/CSP assumptions</i>
Battery Storage	1,846	4,614	4,717	4,887	6,073	9,065	12,138	5	5	<i>BVES BESS Facility</i>
Pumped (long-duration) Storage	1,599	1,599	1,599	1,599	1,599	2,573	2,573	0	0	<i>Interruptible customers</i>
Shed Demand Response	2,195	2,418	2,418	2,418	2,418	2,418	2,418	10	10	
Gas Capacity Not Retained	-	-	-	-	-	-	-30	0	0	

Source Data: 2019 - 2020 RSP R.16-02-007, Table 6

g. High Electrification Planning

To investigate the impact of a “High Electrification” scenario on BVES’s Preferred Conforming Portfolios, BVES modelled a high load scenario within its supply model. The high load scenario assumed additional load from electrification beginning in 2026 and growing an additional 10 percent of total load by 2035, a load increase of 14.2 GWh in 2035 (prior to application of demand modifiers). Under this scenario, BVES would need to increase the size of planned 7x24 block renewable contracts to serve a portion of this additional load while maintaining compliance with the emissions benchmarks and may require additional batteries or expanded capacity in the Big Bear Valley. Table 22 shows the result of this analysis.

Under the 25 MMT emissions benchmark and the High Electrification scenario BVES would need to procure an additional 2 MW of 7x24 block renewable generation. Under the 30 MMT emissions benchmark and the High Electrification scenario, BVES would need to procure an additional 1 MW of 7x24 block renewable power in 2029 and an additional 2 MW of 7x24 block renewable power in 2034 compared to the Preferred Conforming Portfolios. The 30 MMT Preferred Conforming Portfolio requires a greater increase in non-emitting generation when applied to the “High Electrification” scenario

because the included firm renewable contracts are sized smaller than those under the 25 MMT Preferred Conforming Portfolio.

Table 22: Additional Contract Procurements Under High Electrification Scenario³⁶

Resource Type	MWs	Annual GWh	2035 GHG target	Transmission Zone	Substation/ Bus	Alternative location
7x24 Block Renewable Power	2	17,520	25 MMT	n/a	n/a	n/a
7x24 Block Renewable Power	3	26,280	30 MMT	n/a	n/a	n/a

h. Existing Resource Planning

In developing the preferred conforming portfolios, BVES considered both existing and new resources to fulfill its supply needs. Specifically, BVES plans to bring online two new generation facilities – the 5 MW BVES Solar Project and the 5 MW BVES Storage Project. Outside of these two new resources, BVES’s Preferred Conforming Portfolios rely on the contracts that deliver 7x24 block renewable power from existing resources. BVES is in the unique position currently of being actively engaged with a counterparty to contract for this type of firm renewable product that would begin delivery in Q4 2024. The counterparty for this contract operates a significant renewable generation portfolio that can promise delivery for the relatively small amount of contract power (53 GWh annually) BVES requires. While BVES engages in the competitive procurement process, in the time since the 2020 IRP BVES has been unable to contract for cost competitive renewable PPAs to replace existing system power contracts. Owing to these challenges as well as BVES’s recent early-stage success with its counterparty for firm renewable power, BVES believes it is reasonable to plan to contract for the same firm renewable product in 2029 and 2034 (as both Preferred Conforming Portfolios require). BVES’s small size is an unusual benefit when seeking 7x24 block renewable as some counterparties are able to leverage large, diverse renewable portfolios that are oversized compared to the generation BVES ultimately requires.

BVES determined the size of these future 7x24 block renewable contracts based on the supply-demand balancing analysis and the resulting emissions of the portfolio as a part of determining the Preferred Conforming Portfolios. Notably under both the 25 MMT and 30 MMT scenarios future contracts for firm renewable power are at most 1 MW larger in terms of contract capacity compared to the contract BVES is under negotiations for with its current counterparty. BVES thus believes the size of these contracts are achievable and also fall well within the size of the generation portfolio managed by the current counterparty as well as similar counterparties that offer these types of products.

Challenges to procuring generation from existing facilities will not be unique to BVES as the broader pool of LSEs are likely interested in the broad benefits provided by firm renewable power. While BVES’s small size is a benefit in terms of contract achievability, it also limits BVES’s risk appetite owing to its small customer base as well as limits the amount of financial collateral BVES is able to put up to support these long-term power contracts. BVES chose the final Preferred Conforming Portfolios as they broke up the

³⁶ BVES does not presently have guidance on the transmission zone or substation/bus that would be associated with these additional contract capacities as they would be largely dependent on the counterparty's broader portfolio within CAISO.

required contracts into two tranches so as to limit the amount of financial collateral BVES would have to support at any one time. Additionally, BVES acknowledges the risk of depending on a single counterparty for both the upcoming contract in 2024 as well as the planned future contracts in 2029 and 2034. Accordingly, the financial size and strength of the single counterparty will be an important consideration for BVES in selecting the counterpart to these contracts.

i. Hydro Generation Risk Management

While BVES is not directly exposed to hydro generation risk, delivery from large hydro facilities carried through the CAISO power grid can lead to a market risk exposure that may impact the CPUC's RSP as well as BVES's power supply forecasts in shortfall day-ahead demand scheduling. During drought years, the availability of hydroelectric generation production can be severely limited. It is well known that the Big Creek/Ventura area is a local capacity requirement area that relies on Big Creek generation to meet North American Electricity Reliability Corporation planning standards. The recent trend shows that hydroelectricity generation declined between 2001 and 2015, largely due to drought conditions. The precipitation and hydro reservoir subsequently increased from 2015 to 2017, prior to declining again in 2018 through 2021. Additionally, more supply of run-of-river hydroelectric power generally reduces the need for baseload generation and imports. Hydro conditions also impact the amount of hydroelectric power and ancillary services available during peak hours from units with reservoir storage.

Year-to-year variation in hydroelectric power supply in California can have a significant impact on supply mix and the performance of the wholesale energy market. Hydro-electric generation in 2015 was the lowest since 1998 and followed many years of decreasing output.³⁷ During a drought year in 2015 the Big Creek area of the SCE system experienced a reduction of generation production 80 percent below average production. Natural gas-fired capacity and renewables were used to help offset lower levels of generation from hydropower facilities. Total hydro-electric production increased in both 2016 and 2017 before exhibiting a 39 percent decrease in 2018. While California hydro conditions for 2019 were above normal, hydro conditions in 2020 were down and hydro production in 2021 amounted to a 26 percent decrease compared to 2020.³⁸ The current forecast shows the potential changes in hydro conditions and availability within the state for future resource planning periods. Results indicate a likelihood of reduction of released hydroelectric generation and an increase in in-state supply from new solar generation.

j. Long-Duration Storage Planning

Both the remote nature as well as the small customer base associated with BVES make long duration storage financially infeasible for BVES at this time owing to increased TAC charges among other factors. BVES does however, plan to own and operate a 5 MW, 4-hour duration storage facility within its service territory that will come online in 2025 at the latest. As a part of future IRP proceedings BVES will continue to investigate the cost effectiveness and practicality of long-duration storage.

³⁷ CAISO. "Annual Report on Market Issues and Performance." 2016. <http://www.caiso.com/Documents/2016AnnualReportonMarketIssuesandPerformance.pdf>.

³⁸ CAISO. "Annual Report on Market Issues and Performance." 2021. <http://www.caiso.com/Documents/2021-Annual-Report-on-Market-Issues-Performance.pdf>

k. Clean Firm Power Planning

As discussed above, BVES is currently in the process of contracting for a 7x24 block renewable product that would deliver approximately 30 percent of BVES annual supply beginning in late 2024. This product will be delivered on a 7x24 basis for a block of 6 MW of renewable power indicating a 100 percent capacity factor. The counterparty indicates this type of product is achievable through a mix of multiple renewable resources that together can provide a firm product, made easier by the small contract capacity BVES requires. BVES understands from discussions with its potential counterparty that the resources that will provide this firm renewable product in 2024 are all located within the CAISO balancing authority. BVES sees significant benefits for contracting for this type of generation product both in the near future as well as for the planned procurements included in the Preferred Conforming Portfolios in 2029 and 2034.

These types of firm renewable contract generation are especially advantageous to BVES, which is limited in its ability to sell existing excess system power contract generation that would be inherent in procuring the amount of generation required from shaped, renewable resources. Additionally, contracting for this type of firm renewable power can be readily aligned with BVES historic approach of procuring firm system power but does not require the additional step of having to purchase unbundled RECs via PCC3 contracts to retire towards the RPS program. Ultimately, procuring firm renewable contracts for BVES is its best path forward to ensure compliance with the emissions benchmarks.

l. Out-of-State Wind Planning

BVES understands that out-of-state (OOS) wind development is being proposed to supplement existing generation capacity due to land and resource constraints on further wind development within the state of California. However, BVES believes it would incur significant losses should it pursue out-of-state wind generation, likely making this initiative cost-prohibitive for investment. BVES does not currently see potential in pursuing contracts with OOS wind resources and does not project a need to procure power generated by any new OOS wind developments before the end of this IRP forecast horizon.

m. Offshore Wind Planning

Given the size of BVES's load (< 0.1 percent of total large and small IOU load in CA) and commensurately small customer base (<25,000 total customers), at this time BVES does not view offshore wind as a necessary option to achieve its clean energy goals and emissions benchmarks at this time. BVES will continue to monitor related offshore wind proceedings and investigate the need for such generation and affordability should such generation be required in future IRP proceedings.

n. Transmission Planning

Due to BVES's two supply interconnection points, transmission capacity expansion is not applicable nor a suitable, least-cost option to present in this IRP. BVES understands that as more renewable generation is added within the CAISO area, it is expected that transmission use will increase and ultimately add to the overall cost of congestion. To mitigate this direct risk, BVES will continue to participate in the CAISO CRR process to secure the appropriate financial hedge to mitigate potentially increasing congestion costs or secure PPAs that deliver energy to the DLAP_SCE on behalf of BVES.

Additionally, BVES evaluations do not require busbar mapping exercises for capacity planning with regard to its presented resource portfolio as it has no current projects under CAISO-control and no current projects in the interconnection queue.

IV. Action Plan

BVES's action plan to meet the targets proposed in this IRP is as follows:

1. Strive to meet forecasted GHG emissions benchmark from BVES energy supply:
 - a. Transition to obtaining "unit-specific renewable energy block contracts" (firm renewable energy contracts for both base and seasonal loads);
2. Reduce reliance on system power over this IRP planning period:
 - a. BVES has acquired an annual hourly variable shaped contract from December 1, 2019 to October 31, 2024;
 - b. BVES has acquired the contract for seasonal hourly shaped delivery from November 1, 2019 – December 31, 2022;
 - c. Any daily imbalances are either purchased or sold through the CAISO market; and
 - d. BVES plans- to meet GHG emissions benchmark by focusing on procuring competitive PPAs for renewable power supply. This includes filling the gap in its portfolio due to the delay of the solar project and, over time, changing term lengths for future system power seasonal and baseload contracts and procure unit specific renewable resources as available.
3. Develop a pathway to deploy approximately 5 MW total capacity solar PV project:
 - a. BVES has secured a new site location and conducted preliminary studies to assure viability of the projects;
 - b. BVES has begun the process of negotiating a purchase and sales agreement and plans to submit an application to the Commission in 2023; and
 - c. The RECs and energy generated from this project will hedge BVES for future RPS and IRP compliance terms.
 - d. BVES will continue to update the Commission as concrete implementation steps materialize.
4. Local, flex, and system RA capacity obligations:
 - a. BVES continues to seek new RA contracts, facing significantly higher costs for capacity since California reserve margins may drop below 15 percent unless additional resources are brought online, stimulating higher capacity prices and therefore, higher RA prices, in the power market;
 - b. Securing cost competitive or any RA contracts has been a challenging issue among most LSEs in California, including BVES;
 - c. BVES's BVPP is not an eligible RA program resource for local capacity requirements; and;
 - d. BVES will continue to frequently solicit RFPs for RA capacity contracts in a commercially reasonable manner in an effort to procure additional RA capacity.
5. BESS facility:

- a. BVES conducted a battery study with an outside consultant and is currently working with a vendor to install a battery solution; and
 - b. Plans to implement the initial approval steps for an approximate 5 MW BESS device after working with the outside consultant.
6. Secure firm future renewable energy only contracts
- a. Focus on firm RE supply starting in 2024; and
 - b. Two additional blended firm RE PPAs over the course of the planning horizon
7. Expand capacity to provide supplemental service to BVES's largest customer:
- a. BVES's largest customer, the Snow Summit ski resort, plans to retire its diesel fueled power generation; and
 - b. The Commission recently approved an Added Facilities Agreement between BVES and Snow Summit to construct and operate facilities to increase the capacity to provide supplemental service to the Snow Summit ski resort.

8. DACs and Community Engagement:

- a. Within 2024, BVES will engage its community and the local geographic area to gain insights for its next IRP update, which will expand its existing quarterly meeting practice with access and functional needs and public safety partner groups to better represent external feedback and incorporate direct needs of its ratepayers and the local region.
- b. Starting in summer 2024, provide more awareness to GHG and particulate health impacts added to existing community awareness campaigns, especially where relevant to energy resource emissions and/or wildfire smoke during fire season.

8.9. Demand side management:

- a. BVES uses electric vehicle pilot program, time of use rate program, and energy efficiency in an effort to optimize load patterns to achieve higher load factor.
- b. Transportation Electrification Pilot Program:
 - i. BVES began the process of implementing this program and will track adoption and success rates; and
 - ii. At the time of this filing at least 15 residential customers (and one commercial customer) are in the process of acquiring EV charging stations at their residence.
- c. Lighting EE Program:
 - i. BVES has successfully implemented two EE programs and is considering new programs for BVES customers. BVES has one active EE program as part of its Energy Savings Assistance (ESA) program.³⁹
- d. Investigation into TOU rate structure:
 - i. Pilot study program for a TOU incentive rate for EV and EV charger customers.

³⁹ The ESA program, funded through the Public Purpose Program Adjustment Mechanism, is available only for qualifying low-income residential customers. The ESA Program provides funding for energy efficient refrigerators, hard-wired compact fluorescent fixtures, compact fluorescent bulbs, LEDs, smart strip surge protectors, low-flow showerheads and weatherization measures. BVES also provides educational materials to all customers promoting the use of energy efficient appliances, weatherization materials, thermostatic controls, and lifestyle changes.

a. Proposed Procurement Activities and Potential Barriers

The LSE should provide responses for each of the following resource categories:

- i. Resources to meet D.19-11-016 procurement requirements

Not applicable. BVES was not assigned an additional procurement obligation in D. 19-11-016.

- ii. Resources to meet D.21-06-035 procurement requirements, including:

Not applicable. BVES was not assigned an additional procurement obligation in response the mid-term reliability analysis in D.21-06-035. This response addresses the following subcategories below relating to this Commission Decision.

- a. 1,000 MW of firm zero-emitting resource requirements

Not applicable. BVES was not assigned an additional procurement obligation in response the mid-term reliability analysis in D.21-06-035.

- b. 1,000 MW of long-duration storage resource requirements

Not applicable. BVES was not assigned an additional procurement obligation in response the mid-term reliability analysis in D.21-06-035.

- c. 2,500 MW of zero-emissions generation, generation paired with storage, or demand response resource requirements

Not applicable. BVES was not assigned an additional procurement obligation in response the mid-term reliability analysis in D.21-06-035.

- d. All other procurement requirements

Not applicable. BVES was not assigned an additional procurement obligation in response the mid-term reliability analysis in D.21-06-035.

- e. Offshore wind

Not applicable. BVES was not assigned an additional procurement obligation in response the mid-term reliability analysis in D.21-06-035.

Out-of-state wind

Not applicable. BVES was not assigned an additional procurement obligation in response the mid-term reliability analysis in D.21-06-035.

- i. Other renewable energy not described above

Not applicable. BVES plans to attain 7x24 block RE PPAs, which are based on the counterparty's supply portfolio of existing generation or planned generation ahead of the contract operational date.

- ii. Other energy storage not described above

Not applicable. BVES plans to attain 7x24 block RE PPAs, which are based on the counterparty's supply portfolio of existing generation or planned generation ahead of the contract operational date.

iii. Other demand response not described above

Not applicable. BVES already has a DR program in place with its largest C&I customer enabling the ability to curtail load if ever called upon. No other potential barriers are considered in this analysis.

iv. Other energy efficiency not described above

Not applicable. BVES maintains its energy efficiency program and does not find any potential barrier or proposed activity to report.

v. Other distributed generation not described above

Not applicable. BVES has no other additional DER potential barriers to address for this analysis.

vi. Transportation electrification, including any investments above and beyond what is included in Integrated Energy Policy Report (IEPR)

Not applicable. BVES did not find additional insight into transportation electrification beyond what is discussed in the IEPR.

vii. Building electrification, including any investments above and beyond what is included in Integrated Energy Policy

Not applicable. BVES did not find additional insight into building electrification beyond what is discussed in the IEPR.

BVES does not have direct activities that necessitate approval from the Commission through this IRP filing. In order to implement the Preferred Conforming Portfolios and reduce forecasted GHG emissions attributed to BVES supply, BVES will investigate all available resource procurement options. BVES will consider other local supply options and storage solutions as a hedge for supply cost, an instrument for increasing capacity, and a means of reducing carbon emissions during the timeframe of this IRP. For the current IRP outlook, the PPAs for system power will continue to supply power through 2024 and any shortfalls will be addressed with wholesale power purchases until an anticipated RE 24x7 block PPA is successfully contracted. BVES will continue its efforts to develop a pathway forward to deploy a utility-scale and owned solar PV facility as well as the BESS.

Table 23: BVES Power Procurement Summary

RDT Resource Procurement Plan Summary				
Resource Type	Procurement Plan	Correspondence to Proposed Activities	Potential Barriers	Resource Viability
New_generic_solar_1axis	Utility-owned solar generating plant directly supplying the BVES distribution system	Addresses #3 in the action plan	Contracting and construction timelines; potential delays due to uncontrolled factors and pricing	BVES does not require financing or interconnection process for this project.

RDT Resource Procurement Plan Summary

Resource Type	Procurement Plan	Correspondence to Proposed Activities	Potential Barriers	Resource Viability
_new_gen _ric_batt _storage	Utility-owned, standalone storage facility Li-Ion or flow technology	Addresses #5 in the action plan	Contracting and construction timelines; siting constraints; potential delays due to uncontrolled factors	BVES does not require financing or interconnection process for this project.
_existing_generic _unknown	Currently negotiation with a counterparty for a ten-year contract to supply nearly one third of supply needs with bundled REC and capacity products	Addresses #2 and #6 in the action plan	In-state PPAs may not be available or cost competitive; counterparty risk concerns; competition for firm RE PPAs; cost prohibited investments; may have to procure out-of-state	BVES does not require financing for this PPA
_existing_generic _unknown	Seeking to replicate the initial firm RE PPA contract to provide up to two-thirds of RE firm 7x24 contracts to replace termed system power PPAs	Addresses #2 and #6 in the action plan	In-state PPAs may not be available or cost competitive; counterparty risk concerns; competition for firm RE PPAs; cost prohibited investments; may have to procure out-of-state	BVES does not require financing for this PPA
_existing_generic _unknown	Seeking to replicate the initial and second firm RE PPA contracts to supply nearly all BVES's load with RE firm 7x24 contracts, replacing the system power PPAs once they expire	Addresses #2 and #6 in the action plan	In-state PPAs may not be available or cost competitive; counterparty risk concerns; competition for firm RE PPAs; cost prohibited investments; may have to procure out-of-state	BVES does not require financing for this PPA
_Unspecified_non_imp ort	In effort to reduce system power reliance, seeking 75-85 percent initially of current base annual contract amounts after current contract expires	Addresses #2 in the action plan	Prioritizing renewable PPA procurement, BVES may have to rely on system power contracts and day ahead purchases in the interim but forecasts to require the conservative presentations of unspecific system power within its power mix by 2035	BVES does not require financing for this PPA
_Unspecified_non_i mport	BVES plans to support its peak periods with seasonal firm contracts for an additional term that aligns with renewable power contracting plans	Addresses #2 in the action plan	Prioritizing renewable PPA procurement, BVES may have to rely on system power contracts in the interim but forecasts to require the conservative presentations of unspecific system power within its power mix by 2035	BVES does not require financing for this PPA

BVES aims to minimize criteria air pollutants through the proposed initiatives in this IRP to provide air quality benefits to part-time and permanent residents within its service area through the planned utility-

owned renewable generation projects. As discussed in this IRP, BVES does not have disadvantaged communities that would warrant additional outreach or input relative to these proposed activities. BVES will continue its efforts to implement steps for the solar facility and BES solution projects, secure renewable firm PPAs, issue RFPs for available local, flex, and system RA capacity, and exhaust its ten-year PCC 3 REC contract strategy and replace it with bundled energy and REC product contracts to hedge for its long-term supply needs as well as to meet the state objectives of GHG emissions reduction from retail electricity sales as available. Net baseline supply will otherwise be supported by short-term PPAs for system power or unit-specific renewable power purchases as the utility phases in new renewable energy contracts to its power content mix.

Table 24: BVES Procurement Implementation Summary

RDT Procurement Plan Execution					
Resource Type	RDT Resource Line #	Contract Anticipated Start ⁴⁰	Solicitation Type	Solicitation Plan	Notes
new_generic_solar_1axis	6	12/1/2024	System design elements and construction needs	Reengage contract negotiations for phased deployment; BVES withdrew prior applications and is working with an external party for the design phase	Bear Valley Solar Plant, solar, 5 MW
new_generic_battery_storage	7	12/1/2024	RFPs for system design elements and construction needs; siting needs	Issue solicitations as siting is secured	Bear Valley Electric Service Battery Storage Project, Li-Ion or Flow storage, 5 MW with four-hour discharge

⁴⁰ Contract start dates are estimated based on this IRP cycle, the IEPR demand forecast, and the state of decision-making under the BVES' senior leadership approval process.

RDT Procurement Plan Execution					
Resource Type	RDT Resource Line #	Contract Anticipated Start ⁴⁰	Solicitation Type	Solicitation Plan	Notes
generic_unknown	23	11/1/2024	RFPs for available competitive RE 7x24 block PPAs; BVES is currently in negotiations with a counterparty	Negotiations with counterparty	No locational preference, full contract supply, assumes unit-specific solar and wind is currently available for power purchase agreement; bundled with RECs and capacity
generic_unknown	24	1/1/2029	RFPs for available competitive RE 7x24 block PPAs	Begin developing RFPs immediately after the operational date of the first RE PPA	No locational preference, full contract supply, assumes unit-specific solar and wind is currently available for power purchase agreement; bundled with RECs and capacity
generic_unknown	25	1/1/2034	RFPs for available competitive RE 7x24 block PPAs	Begin developing RFPs after the operational date of the second RE PPA	No locational preference, full contract supply, assumes unit-specific solar and wind is currently available for power purchase agreement; bundled with RECs and capacity
_unspecified_n _on_import	21	11/1/2024	Solicitations will be issued for system power as a net resource as renewable PPAs are acquired	Harden netted system energy needs as firm RE 7x24 PPA contracts come online	BVES plans to execute a shorter-term contract for annual firm delivery and seasonal energy to support high load months as all firm RE PPAs come online
	22	1/1/2023			
sellers_choice	8	1/1/2023	BVES will issue Request for offers (RFOs) in continued effort to hedge its RA capacity reservation requirements	BVES must purchase its capacity amounts to meet RA obligations through contracts	Anticipating the need to secure future system RA capacity contracts through 2035
	9	1/1/2024			
	10	1/1/2025			
	11	1/1/2026			
	12	1/1/2027			
	13	1/1/2028			
	14	1/1/2029			
	15	1/1/2030			
	16	1/1/2031			
	17	1/1/2032			
	18	1/1/2033			
	19	1/1/2034			
20	1/1/2035				

As a prudent utility, BVES assumes a low-risk posture. BVES seeks greater certainty in total power supply costs through long-term contracts rather than risk substantial upward price movements in the volatile spot market. For many years, BVES has been able to fix a large percentage of its total power supply costs through long-term PPAs. This has allowed BVES to reduce its exposure to market price uncertainty, but BVES still faces other sources of risk. BVES takes into account the Value at Risk (VAR) when determining how much of its future energy supplies to purchase through long-term PPAs. The VAR is a measure of

how much total costs change when underlying variables, such as natural gas prices, change. Steps taken or under consideration to mitigate VAR include the following:

- use of assets such as gas fired generation, which indexes power prices to natural gas prices;
- use of solar project(s) to fix prices to the cost of capital of the solar facility;
- use of physical call options with fixed strike prices to cap power prices; and
- battery applications to condition the system load and facilitate asset and contract coverage are under review at this time.

Two major goals in risk management strategy of BVES resources are as follows. 1) Meet the capacity of the firm customers first and interruptible customers second, and 2) secure favorable prices through a competitive bid process for future energy requirement expenditures via fixed price contracts for both interruptible and non-interruptible customers, addition of utility owned solar capacity, and the conditioning of system load to fit assets and contracts through batteries. Additional risks BVES faces include forecast accuracy, market-price fluctuations, regulatory uncertainty, unplanned supply constraints, counterparty decision making, customer behavior, or any combination thereof. The growing portion of energy consumption from customer-owned distributed generation via the NEM program and its successor tariff is also a significant concern. BVES continues to closely monitor customer DG growth and will reassess resource requirements in future IRPs.

Forecast risk is the risk associated with over- or under-forecasting BVES's retail requirements and having either too much or too little energy under long-term PPAs, requiring that BVES either buy at higher than expected costs in the spot market or sell surplus energy from existing contracts at a loss.⁴¹ BVES mitigates this risk by improving on forecasting models, using multiple models (regression, statistically adjusted end-use, conditional demand analysis models for individual customers) for long-term and mid-term forecasting periods, and neural network models for next day forecasting.

Market-price risk is the risk associated with entering into long-term PPAs with wholesale prices subsequently falling, such that BVES could have purchased the energy less expensively in the short-term or spot market. Conversely, if BVES chooses not to enter into a long-term PPA at current prices and then prices rise, BVES's price of power could rise dramatically as compared to not locking in prices at current rates. To mitigate market-price risk, BVES's planning assumptions utilize the forecasting of IHS-Cambridge Energy Research Associates (CERA) experts in global and regional economic trends, all facets of energy markets, policy assessments, and industry practices. IHS-CERA fully integrates all of the forecast products into one harmonious determination of available power fuels markets, and economy. The firm is well connected with energy, policy, manufacturing, and service sector leaders. Scenario analysis is also incorporated in the IHS-CERA support of BVES's IRP planning process. BVES incorporates this external analysis into the internal analysis used to plan for its future resource needs.

Counterparty risk is the risk that a counterparty defaults on its obligations and BVES incurs additional costs to replace energy contracted from the counterparty. To attempt to mitigate this risk, BVES utilizes collateral requirements and parent company guarantees to the extent possible. BVES also attempts to deal primarily with companies that have good credit ratings.

⁴¹ BVES is refining its Load Research Project to improve forecasts; specifically, future plans are to include addition of more refined customer data via, among other methods, a pole top collection system.

BVES cannot avoid all risk. Risk that cannot be avoided is managed to the extent feasible. Although BVES cannot control the actions of the market or other entities, BVES seeks to design its resource acquisition strategy to minimize the potential financial impacts of forecast and market risk. For example, BVES has fixed the price of roughly 90 percent of its energy requirements until new renewable contracts come online through the acquisition of competitively priced long-term PPAs, which minimizes the impact of sudden price spikes in the spot market. BVES's planned new generation assets of solar and battery storage should secure supply and offer price hedges tied to another source. This is in addition to the planned competitive RE 7x24 block PPAs. Diversity of resources is a key element in the development of the capacity mix available to BVES.

BVES will seek to meet its RA obligation based on its contribution to monthly CAISO coincident peak load and will offset its peak with the use of the BVPP as a DER BTM resource and future batteries. Local RA and flexible capacity requirements will remain an area of focus for BVES. BVES will continue to seek use of RA contracts, solar production, and energy storage to meet all of the flexible, local, and system RA requirements in the future. BVES continues to promote the benefits of reduced consumption, in line with state goals and regulatory policies.

Regulatory risk is the risk of changes in regulations or new regulations that increase BVES's cost of doing business. For example, if BVES takes actions to meet current regulations and regulations are subsequently changed, BVES may incur increased and unforeseen costs to (1) undo earlier actions, and (2) meet the new regulations. To mitigate regulatory risk, BVES utilizes a number of resources to assess current and future policy affecting California energy markets. BVES utilizes various legal and market consultants as well as internal subject matter experts to fully assess options that BVES should take in planning for the future. BVES will continue to monitor, assess, and reduce, where possible, its regulatory risk at both the federal and state levels. Different or new energy and environmental goals, at both the federal and state levels, could add new complexity and costs to BVES's operations. Any proposed changes, both at the federal and state level, will be taken into consideration by BVES in its integrated resource planning process.

b. Disadvantaged Communities

~~While no BVES does not have disadvantaged communities sit within BVES's direct service territory, BVES understand the LSE recognizes that air pollutants do not abide by pollution transcends geographic boundaries and thus could impact disadvantaged communities outside of BVES's service territory. In understanding this, BVES aims to reduce the impact of notes that GHG emissions on disadvantaged communities primarily through its long-term goal of reducing dependence on system power. BVES strives to do this under can affect any population within the San Bernardino County, which includes nearby disadvantaged areas. Accordingly, BVES is committed to minimizing emissions and any potential cross-regional impacts, particularly on these communities. BVES is actively advancing its long-term strategy to decrease reliance on system power by enacting its Preferred Conforming Portfolios through procurement of that include 7x24 block renewable power, which is zero-emitting emits no greenhouse gases. This will significantly reduce the accounting of GHG emissions for BVES over time.~~

~~To ensure all community members can provide accessible access updated energy resource information, BVES provides materials in predominatethe predominant languages spoken in the state including Spanish, Mandarin, and Tagalog. No community. Apart from English, no other tribal communities major languages are present requiring additional language capabilities. predominantly spoken within the~~

service territory.⁴² ~~General outreach has been limited over~~ was curtailed during the last IRP cycle due to the COVID-19 pandemic. ~~BVES will also strive to communicate targeted and adaptation from the approved 2020 IRP filed plan. Webpage updates provided IRP materials and notices to alert residents of changes to the 2020 and 2022 IRPs and updated procurement strategy.~~

~~BVES adhered to traditional outreach on its new~~ methods such as email notices, bill inserts, and media announcements related to planned procurement ~~plan~~ projects when communicating the IRP results. ~~However, the LSE acknowledges the importance of direct stakeholder feedback in order to mitigate rate shock and express~~ shaping the Preferred Conforming Portfolio, particularly from disadvantaged groups. ~~Recognizing the absence of formal stakeholder engagement workshops in the 2020 and 2022 IRP cycles, BVES is dedicated to incorporating structured feedback sessions and direct engagement in future IRP processes.~~

~~Future IRP submissions will feature an overview of the mechanisms performed in capturing insights of underrepresented community members, particularly those in medical baseline or access and functional needs groups, ensuring their perspectives significantly shape strategic planning. BVES notes that forthcoming efforts will focus on enhanced communication and stakeholder engagement to discuss the procurement plan as an approach to also mitigate perceived rate shock from switching from seasonal and firm system power contracts to renewable resources and articulate the benefits of shifting/transitioning to a clean/cleaner power supply portfolio. This/These efforts will be detailed further described in a future/upcoming IRP filings.~~

~~Additionally, BVES acknowledges the presence of vulnerable populations, such as those on medical baselines or with access and functional needs and strives to tailor its support services to enhance their resilience and safety. BVES further acknowledges that while tribal communities do not exist within the service area, the utility appreciates its external relationships with tribal agencies, which share boundaries with USFS lands. Through targeted initiatives and planned stakeholder meetings ahead of the next IRP filing-, BVES reaffirms its commitment to inclusivity and proactive engagement across all segments of the community.~~

c. Commission Direction of Actions

Not applicable.

This prompt is not applicable to BVES at this time as procurement decisions are made through alternative Commission procedures. BVES does not seek any new actions from the Commission at this time related to its procurement forecasts for its two Preferred Conforming Portfolio scenarios.

V. Lessons Learned

BVES appreciates the opportunity to present Conforming and Preferred Portfolio scenarios to the Commission to help meet overall objectives of an optimized resource planning portfolio under the

⁴² ~~This parameter involved conducting surveys in previous years to identify if there were over 1,000 residents within its service area who primarily speak languages other than English.~~

Standard Plan template since the 2020 IRP cycle. The Commission’s approach for this IRP’s analysis established uniform assumptions that enable standardized comparisons across all LSEs and transfer easily into the Reference System Plan. This provides an achievable avenue for the Commission and state agencies/entities to develop an achievable pathway to successfully reduce electric sector GHG emissions and meet state mandates. BVES understands this pathway and has adapted its internal processes to remain compliant with and not conflict with biannual IRP compliance filings and long-term plan updates.

BVES has historically relied on unspecified power contracts as a least-cost option for reliable supply as unspecified system power contracts are generally more cost-favorable for long-term resource planning. BVES, however, presents in this IRP a new roadmap for meeting GHG emissions benchmarks and reducing reliance on CAISO system power along with deployment of the storage and solar facilities. BVES’s current primary energy supply resource is categorized as unspecific system power and thus is tied to carbon intensity of natural gas dispatch on the CAISO-controlled grid in modeling emissions through 2035, which BVES does not believe is a true reflection of the California power mix. While internal methodology takes into account the resource mix profile of SCE’s service territory for local emissions supply mix forecasts, BVES understands the applied dispatch conditions and calculated emissions allocated to LSEs that aim to account for generating units called upon by the CAISO to meet BVES load center demand and therefore necessitates an evaluation of the CAISO system mix profile for more accurate carbon emission accounting. BVES presents a common planning concern regarding potential rate impact to its customers for the discussed activities to seek clean energy power delivery agreements.

BVES requests that the Commission consider modifying the CSP modeling capabilities to allow for overwriting the proportional GHG emissions assigned to LSE dependent on system power contracts with the California system supply mix incorporating clean energy delivery in order to, at minimum, compare prior carbon accounting methodologies with the conditional weights presented in the CPUC’s CSP model assumptions in this IRP cycle. BVES also requests further discussion surrounding the incorporation of PCC 2 and PCC 3 REC products in the CSP modeling methodology and the alignment against the RPS program compliance periods and unbundled REC retirements.

Glossary of Terms

Alternative Portfolio: LSEs are permitted to submit “Alternative Portfolios” developed from scenarios using different assumptions from those used in the Preferred System Plan with updates. Any deviations from the “Conforming Portfolio” must be explained and justified.

Approve (Plan): the CPUC’s obligation to approve an LSE’s integrated resource plan derives from Public Utilities Code Section 454.52(b)(2) and the procurement planning process described in Public Utilities Code Section 454.5, in addition to the CPUC obligation to ensure safe and reliable service at just and reasonable rates under Public Utilities Code Section 451.

Balancing Authority Area (CAISO): the collection of generation, transmission, and loads within the metered boundaries of the Balancing Authority. The Balancing Authority maintains load-resource balance within this area.

Baseline resources: Those resources assumed to be fixed as a capacity expansion model input, as opposed to Candidate resources, which are selected by the model and are incremental to the Baseline. Baseline resources are existing (already online) or owned or contracted to come online within the planning horizon. Existing resources with announced retirements are excluded from the Baseline for the applicable years. Being “contracted” refers to a resource holding signed contract/s with an LSE/s for much of its energy and capacity, as applicable, for a significant portion of its useful life. The contracts refer to those approved by the CPUC and/or the LSE’s governing board, as applicable. These criteria indicate the resource is relatively certain to come online. Baseline resources that are not online at the time of modeling may have a failure rate applied to their nameplate capacity to allow for the risk of them failing to come online.

Candidate resource: those resources, such as renewables, energy storage, natural gas generation, and demand response, available for selection in IRP capacity expansion modeling, incremental to the Baseline resources.

Capacity Expansion Model: a capacity expansion model is a computer model that simulates generation and transmission investment to meet forecast electric load over many years, usually with the objective of minimizing the total cost of owning and operating the electrical system. Capacity expansion models can also be configured to only allow solutions that meet specific requirements, such as providing a minimum amount of capacity to ensure the reliability of the system or maintaining greenhouse gas emissions below an established level.

Certify (a Community Choice Aggregator Plan): Public Utilities Code 454.52(b)(3) requires the CPUC to certify the integrated resource plans of CCAs. “Certify” requires a formal act of the Commission to determine that the CCA’s Plan complies with the requirements of the statute and the process established via Public Utilities Code 454.51(a). In addition, the Commission must review the CCA Plans to determine any potential impacts on public utility bundled customers under Public Utilities Code Sections 451 and 454, among others.

Clean System Power (CSP) methodology: the methodology used to estimate GHG and criteria pollutant emissions associated with an LSE’s Portfolio based on how the LSE will expect to rely on system power on an hourly basis.

Community Choice Aggregator: a governmental entity formed by a city or county to procure electricity for its residents, businesses, and municipal facilities.

Conforming Portfolio: the LSE portfolio that conforms to IRP Planning Standards, the 2030 LSE-specific GHG Emissions Benchmark, use of the LSE's assigned load forecast, use of inputs and assumptions matching those used in developing the Reference System Portfolio, as well as other IRP requirements including the filing of a complete Narrative Template, a Resource Data Template and Clean System Power Calculator.

Effective Load Carrying Capacity: a percentage that expresses how well a resource is able avoid loss-of-load events (considering availability and use limitations). The percentage is relative to a reference resource, for example a resource that is always available with no use limitations. It is calculated via probabilistic reliability modeling, and yields a single percentage value for a given resource or grouping of resources.

Effective Megawatts (MW): perfect capacity equivalent MW, such as the MW calculated by applying an ELCC % multiplier to nameplate MW.

Electric Service Provider: an entity that offers electric service to a retail or end-use customer, but which does not fall within the definition of an electrical corporation under Public Utilities Code Section 218.

Filing Entity: an entity required by statute to file an integrated resource plan with CPUC.

Future: a set of assumptions about future conditions, such as load or gas prices.

GHG Benchmark (or LSE-specific 2030 GHG Benchmark): the mass-based GHG emission planning targets calculated by staff for each LSE based on the methodology established by the California Air Resources Board and required for use in LSE Portfolio development in IRP.

GHG Planning Price: the ~~systemwide~~ system wide marginal GHG abatement cost associated with achieving a specific electric sector 2030 GHG planning target.

Integrated Resources Planning Standards (Planning Standards): the set of CPUC IRP rules, guidelines, formulas and metrics that LSEs must include in their LSE Plans.

Integrated Resource Planning (IRP) process: integrated resource planning process; the repeating cycle through which integrated resource plans are prepared, submitted, and reviewed by the CPUC

Long term: more than 5 years unless otherwise specified.

Load Serving Entity: an electrical corporation, electric service provider, community choice aggregator, or electric cooperative.

Load Serving Entity (LSE) Plan: an LSE's integrated resource plan; the full set of documents and information submitted by an LSE to the CPUC as part of the IRP process.

Load Serving Entity (LSE) Portfolio: a set of supply- and/or demand-side resources with certain attributes that together serve the LSE's assigned load over the IRP planning horizon.

Loss of Load Expectation (LOLE): a metric that quantifies the expected frequency of loss-of-load events per year. Loss-of-load is any instance where available generating capacity is insufficient to serve electric demand. If one or more instances of loss-of-load occurring within the same day regardless of duration

are counted as one loss-of-load event, then the LOLE metric can be compared to a reference point such as the industry probabilistic reliability standard of “one expected day in 10 years,” i.e. an LOLE of 0.1.

Maximum Import Capability: a California ISO metric that represents a quantity in MWs of imports determined by the CAISO to be simultaneously deliverable to the aggregate of load in the ISO’s Balancing Authority (BAA) Area and thus eligible for use in the Resource Adequacy process. The California ISO assess a MIC MW value for each intertie into the ISO’s BAA and allocated yearly to the LSEs. A LSE’s RA import showings are limited to its share of the MIC at each intertie.

Net Qualifying Capacity (NQC): *Qualifying Capacity reduced, as applicable, based on: (1) testing and verification; (2) application of performance criteria; and (3) deliverability restrictions. The Net Qualifying Capacity determination shall be made by the California ISO pursuant to the provisions of this California ISO Tariff and the applicable Business Practice Manual.*

Non-modeled costs: *embedded fixed costs in today’s energy system (e.g., existing distribution revenue requirement, existing transmission revenue requirement, and energy efficiency program cost).*

Nonstandard LSE Plan: *type of integrated resource plan that an LSE may be eligible to file if it serves load outside the CAISO balancing authority area.*

Optimization: *an exercise undertaken in the CPUC’s Integrated Resource Planning (IRP) process using a capacity expansion model to identify a least-cost portfolio of electricity resources for meeting specific policy constraints, such as GHG reduction or RPS targets, while maintaining reliability given a set of assumptions about the future. Optimization in IRP considers resources assumed to be online over the planning horizon (baseline resources), some of which the model may choose not to retain, and additional resources (candidate resources) that the model is able to select to meet future grid needs.*

Planned resource: *any resource included in an LSE portfolio, whether already online or not, that is yet to be procured. Relating this to capacity expansion modeling terms, planned resources can be baseline resources (needing contract renewal, or currently owned/contracted by another LSE), candidate resources, or possibly resources that were not considered by the modeling, e.g., due to the passage of time between the modeling taking place and LSEs developing their plans. Planned resources can be specific (e.g., with a CAISO ID) or generic, with only the type, size and some geographic information identified.*

Qualifying capacity: *the maximum amount of Resource Adequacy Benefits a generating facility could provide before an assessment of its net qualifying capacity.*

Preferred Conforming Portfolio: *the conforming portfolio preferred by an LSE as the most suitable to its own needs; submitted to CPUC for review as one element of the LSE’s overall IRP plan.*

Preferred System Plan: *the Commission’s integrated resource plan composed of both the aggregation of LSE portfolios (i.e., Preferred System Portfolio) and the set of actions necessary to implement that portfolio (i.e., Preferred System Action Plan).*

Preferred System Portfolio: *the combined portfolios of individual LSEs within the CAISO, aggregated, reviewed and possibly modified by Commission staff as a proposal to the Commission, and adopted by the Commission as most responsive to statutory requirements per Pub. Util. Code 454.51; part of the Preferred System Plan.*

Short term: *1 to 3 years (unless otherwise specified).*

Staff: CPUC Energy Division staff (unless otherwise specified).

Standard LSE Plan: type of integrated resource plan that an LSE is required to file if it serves load within the CAISO balancing authority area (unless the LSE demonstrates exemption from the IRP process).

Transmission Planning Process (TPP): annual process conducted by the California Independent System Operator (CAISO) to identify potential transmission system limitations and areas that need reinforcements over a 10-year horizon.

BEAR VALLEY ELECTRIC SERVICE, INC.

G.O. 96-B

SERVICE LIST

AGNES ROBERTS, FINANCIAL ANALYST
AGNES.ROBERTS@BBCCSD.ORG
EMAIL ONLY

CITY CLERK
CITY OF BIG BEAR LAKE
39707 BIG BEAR BLVD.
P.O. BOX 10000
BIG BEAR LAKE, CA 92315

CITY ATTORNEY
CITY OF BIG BEAR LAKE
39707 BIG BEAR BLVD.
P.O. BOX 10000
BIG BEAR LAKE, CA 92315

COUNTY CLERK
COUNTY OF SAN BERNARDINO
385 N. ARROWHEAD AVENUE - 2ND FLOOR
SAN BERNARDINO, CA 92415-0140

COUNTY COUNSEL
COUNTY OF SAN BERNARDINO
385 N. ARROWHEAD AVENUE - 2ND FLOOR
SAN BERNARDINO, CA 92415-0140

ASST ATTORNEY GENERAL
OFFICE OF THE ATTORNEY GENERAL
STATE OF CALIFORNIA
300 SOUTH SPRING STREET
LOS ANGELES, CA 90013

ERIC JANSSEN
ELLISON, SCHNEIDER & HARRIS LLP
2600 CAPITOL AVE., STE. 400
SACRAMENTO, CA 95816-5905
ERICJ@ESLAWFIRM.COM

WADE REESER, VP, OPERATIONS
BIG BEAR MOUNTAIN RESORTS
P.O. BOX 77, 880 SUMMIT BLVD.
BIG BEAR LAKE CA 92315
WREESER@MAMMOTHRESORTS.COM

PETER EICHLER
LIBERTY UTILITIES
2865 BRISTOL CIRCLE
OAKVILLE, ONTARIO L6H 7H7
PETER.EICHLER@LIBERTYUTILITIES.COM

MIKE LONG
CALIFORNIA PACIFIC ELECTRIC CO., LLC
933 ELOISE AVENUE
SOUTH LAKE TAHOE, CA 96150
MIKE.LONG@LIBERTY-ENERGY.COM

RANDLE COMMUNICATIONS
500 CAPITOL MALL, SUITE 1950
SACRAMENTO, CA 95814
MGAZDA@RANDLECOMMUNICATIONS.COM

ITZIAR ROMO
OPR COMMUNICATIONS
19318 JESSE LANE, SUITE 200
RIVERSIDE, CA 92508
IROMO@OPRUSA.COM

FRED YANNEY, YANNEY LAW OFFICE
2082 MICHELSON DRIVE, SUITE 100
IRVINE, CA 92612
FREDYANNEY@GMAIL.COM

BRENT TREGASKIS
BEAR MOUNTAIN RESORT
P O BOX 77
BIG BEAR LAKE, CA 92315

SOUTHERN CALIFORNIA EDISON CO.
P. O. BOX 800
ROSEMEAD, CA 91770

PATRICK O'REILLY
OPR COMMUNICATIONS
19318 JESSE LANE, SUITE 200
RIVERSIDE, CA 92508
POREILLY@OPRUSA.COM

ARLENE HERRERA
OPR COMMUNICATIONS
19318 JESSE LANE, SUITE 200
RIVERSIDE, CA 92508
AHERRERA@OPRUSA.COM

NAVAL FACILITIES ENGINEERING COMMAND
REA. D. ESTRELLA
SOUTHWEST DIVISIONM
1220 PACIFIC HIGHWAY
SAN DIEGO, CA 92132
REA.ESTRELLA@NAVY.MIL

LIBERTY UTILITIES
9750 WASHBURN ROAD
DOWNEY, CA 90241
AdviceLetterService@libertyutilities.com

DOWNEY BRAND LLP
455 MARKET STREET, SUITE 1500
SAN FRANCISCO, CA 94105
msomogyi@DowneyBrand.com
tmacbride@DowneyBrand.com
mday@DowneyBrand.com

BRIAN T. CRAGG
DOWNEY BRAND LLP
455 MARKET STREET, SUITE 1500
SAN FRANCISCO, CA 94105
BCRAGG@DOWNEYBRAND.COM

WILLIAM A. MONSEN
MRW & ASSOCIATES, LLC
1736 FRANKLIN STREET, SUITE 700
OAKLAND, CA 94612
WAM@MRWASSOC.COM



California
Public Utilities
Commission



[CPUC Home](#)

I. CALIFORNIA PUBLIC UTILITIES COMMISSION Service Lists

PROCEEDING: R2005003 - CPUC - OIR TO CONTIN

FILER: CPUC

LIST NAME: LIST

LAST CHANGED: APRIL 29, 2024

[Download the Comma-delimited File](#)
[About Comma-delimited Files](#)

[Back to Service Lists Index](#)

II. Parties

BARBARA BOSWELL
INTERIM CEO
CLEAN ENERGY ALLIANCE
EMAIL ONLY
EMAIL ONLY, CA 00000
FOR: CLEAN ENERGY ALLIANCE

BARBARA BOSWELL
CITY OF POMONA
EMAIL ONLY
EMAIL ONLY, CA 00000
FOR: CITY OF POMONA

BARBARA BOSWELL
SANTA BARBARA CLEAN ENERGY
EMAIL ONLY
EMAIL ONLY, CA 00000
FOR: SANTA BARBARA CLEAN ENERGY

CARRIE BENTLEY
GRIDWELL CONSULTING
EMAIL ONLY
EMAIL ONLY, CA 00000
FOR: GENON HOLDINGS, INC

JEANNE ARMSTRONG
SR. ATTORNEY - REGULATORY
SOLAR ENERGY INDUSTRIES ASSOCIATION
EMAIL ONLY
EMAIL ONLY, CA 00000

MAX FRIEDMAN
ASSIST. GEN. COUNSEL
RWE RENEWABLES AMERICAS, LLC
U.S. OFFSHORE WIND
EMAIL ONLY

FOR: SOLAR ENERGY INDUSTRIES ASSOCIATION EMAIL ONLY, AA 00000
FOR: RWE RENEWABLES AMERICAS, LLC

S.BRADLEY VAN CLEVE
ATTORNEY AT LAW
ASSOCIATE
DAVISON VAN CLEVE, PC
EMAIL ONLY
EMAIL ONLY, AA 00000
FOR: VALLEY ELECTRIC ASSOCIATION

SARAH HARPER
POLICY AND REGULATORY AFFAIRS

FERVO ENERGY
EMAIL ONLY
EMAIL ONLY, CA 00000
FOR: FERVO ENERGY

SERJ BERELSON
SENIOR POLICY MANAGER
MAINSRING ENERGY, INC.
EMAIL ONLY
EMAIL ONLY, CA 00000
FOR: MAINSPRING ENERGY, INC.

THOMAS R. DARTON
PILOT POWER GROUP, INC. (1365)
EMAIL ONLY
EMAIL ONLY, CA 00000
FOR: PILOT POWER GROUP, LLC

PILOT POWER GROUP, LLC
EMAIL ONLY
EMAIL ONLY, CA 00000
FOR: PILOT POWER GROUP, LLC

JASON HOUCK
MGR - POLICY / REGULATORY
FORM ENERGY, INC.
30 DANE STREET
SOMMERVILLE, MA 02143
FOR: FORM ENERGY, INC.

LAURA SALVESEN
PALMCO POWER CA
1350 - 60TH STREE
BROOKLYN, NY 11219
FOR: PALMCO POWER CA
LP

VINCE GUNTLE
AMERICAN POWERNET MANAGEMENT, LP
45 COMMERCE DRIVE
WYOMING, PA 19610
FOR: AMERICAN POWERNET MANAGEMENT,

JENNIFER SOLOMON
ASSIST. GENERAL COUNSEL
EXELON CORPORATION
INC.
101 CONSTITUTION AVE., NW, STE. 400 EAST
WASHINGTON, DC 20001
FOR: CONSTELLATION NEWENERGY, INC., ESP
ASSOCIATIONS,
NUMBER 1359.

MICHAEL PURDIE
DIR - REGULATORY
NATIONAL HYDROPOWER ASSOCIATION,
200 MASSACHUSETTS AVE., STE. 320
WASHINGTON, DC 20001
FOR: NATIONAL HYDROPOWER
INC.

BRIAN TURNER
REGULATORY DIR., WESTERN STATES
ADVANCED ENERGY UNITED, INC.
1010 VERMONT AVE. NW, SUITE 1050
WASHINGTON, DC 20005
FOR: ADVANCED ENERGY UNITED

DANIEL WAGGONER
DIRECTOR
ADVANCED ENERGY ECONOMY
1000 VERMONT AVE., N.W., 3RD FL.
WASHINGTON, DC 20005
FOR: ADVANCED ENERGY ECONOMY (AEE)

KENNETH W. IRVIN

MARGARET E. MCNAUL

ATTORNEY
SIDLEY AUSTIN LLP
1501 K STREET, NW
WASHINGTON, DC 20005
FOR: VINEYARD OFFSHORE, LLC
BANNING,

MEGAN MCDOWELL
ATTORNEY
STEPHENS & JOHNSON LLP
1330 CONNECTICUT AVE NW
WASHINGTON, DC 20036
FOR: SWAN LAKE NORTH HYDRO, LLC

TABITHA CANTY
LIBERTY POWER DELAWARE, LLC
LLC
1901 W. CYPRESS CREEK ROAD, STE. 600
FT. LAUDERDALE, FL 33309
FOR: LIBERTY POWER DELAWARE, LLC

GRID

MARIAN BONAR
PROGRAM MANAGER
GALLATIN POWER PARTNERS, LLC
270 W KAGY BLVD, SUITE E
BOZEMAN, MT 59715
FOR: GALLATIN POWER PARTNERS, LLC

JOANNE BRADLEY
LS POWER DEVELOPMENT, LLC
16150 MAIN CIRCLE DRIVE, SUITE 310
CHESTERFIELD, MO 63017
FOR: LS POWER DEVELOPMENT, LLC

KATHRYN L. PATTON
GRIDLIANCE WEST LLC
201 E JOHN CARPENTER FREEWAY, SUITE 900
IRVING, TX 75062
FOR: GRIDLIANCE WEST LLC

JASON ARMENTA
CALPINE POWERAMERICA-CA, LLC
717 TEXAS AVENUE, SUITE 1000
HOUSTON, TX 77002
FOR: CALPINE POWER AMERICA-CA, LLC

ATTORNEY
THOMPSON COBURN LLP
1909 K STREET, N.W., SUITE 600
WASHINGTON, DC 20006
FOR: CITIES OF ANAHEIM, AZUSA,

COLTON, PASADENA, AND RIVERSIDE,
CALIFORNIA

KARL MEEUSEN, PH.D
DIR - MARKETS, REGULATORY
WARTSILA NORTH AMERICA, INC.
900 BESTGATE ROAD STE. 300
ANNAPOLIS, MD 21401
FOR: WARTSILA NORTH AMERICA, INC.

MARTY R. WALICKI
CALIFORNIA WESTERN GRID DEVELOPMENT

2112 EAST GRANSON
JACKSON, MI 49202
FOR: CALIFORNIA WESTERN GRID
DEVELOPMENT, LLC (FORMERLY WESTERN

DEVELOPMENT, LLC)

JESSICA YARNALL LOARIE
VP - REGULATORY, WEST
INVENERGY, LLC
ONE SOUTH WACKER DRIVE, STE. 1800
CHICAGO, IL 60606
FOR: INVENERGY, LLC

BETHANY SOLER
REPRESENTATIVE
TIGER NATURAL GAS, INC.
EMAIL ONLY
TULSA, OK 74136
FOR: TIGER NATURAL GAS, INC.

CURRY ALDRIDGE
TENASKA POWER SERVICES CO.
1701 E. LAMAR BLVD., STE 100
ARLINGTON, TX 76006
FOR: TENASKA POWER SERVICES CO.

REBECCA LEE
SENIOR MANAGER, GOVERNMENT AFFAIRS
DIRECT ENERGY BUSINESS
910 LOUISIANA ST
HOUSTON, TX 77002

FOR: DIRECT ENERGY BUSINESS, LLC

SCOTT D. LIPTON
ENERGY POLICY MGR, WESTERN REGION
ENCHANTED ROCK, LLC
1113 VINE STREET, STE. 101
HOUSTON, TX 77002
FOR: ENCHANGED ROCK, LLC

KEVIN BOUDREAUX
ENERCAL USA, LLC YEP ENERGY
7660 WOODWAY DRIVE, STE. 471A
HOUSTON, TX 77063
FOR: YEP ENERGY

JOHN H. RITCH
GEXA ENERGY CALIFORNIA, LLC
20455 STATE HIGHWAY 249, STE. 200
LLC
HOUSTON, TX 77070
FOR: GEXA ENERGY CALIFORNIA, LLC

CHRISTINE HUGHEY
SR. ANALYST - REGULATORY
BP RETAIL ENERGY COMPANY CALIFORNIA
201 HELIO WAY
HOUSTON, TX 77079
FOR: BP ENERGY RETAIL COMPANY
CALIFORNIA LLC (FORMERLY EDF
POWER SERVICES (CA), LLC)

INDUSTRIAL

AMANDA FRAZIER
VP - REGULATORY
VISTRA CORP
1005 CONGRESS AVE., STE. 750
AUSTIN, TX 78701
FOR: VISTRA CORP.

TRACY C. DAVIS
SR. ATTORNEY
NEXTERA ENERGY TRANSMISSION, LLC
5920 W. WILLIAM CANNON DR., BLDG 2
AUSTIN, TX 78749
FOR: HORIZON WEST TRANSMISSION, LLC

DAVID F. SMITH
DIR - ENGINEERING AND OPERATIONS
TRANSWEST EXPRESS LLC
555 SEVENTEENTH STREET, STE. 2400
DENVER, CO 80202
FOR: TRANSWEST EXPRESS LLC
LLC

RAHUL KALASKAR
DIR - REGULATORY
AES CLEAN ENERGY DEVELOPMENT, LLC
2180 SOUTH 1300 EAST, STE. 600
SALT LAKE CITY, UT 84106-4462
FOR: AES CLEAN ENERGY DEVELOPMENT,

JASON R. SMITH
PRESIDENT
TRANSCANYON, LLC
ONE ARIZONA CENTER
400 EAST VAN BUREN ST., STE. 350
PHOENIX, AZ 85004
LLC
FOR: TRANSCANYON, LLC

RAVI SANKARAN
DIRECTOR OF BUSINESS DEVELOPMENT
SOUTHWESTERN POWER GROUP II, LLC
3610 N. 44TH STREET, SUITE 250
PHOENIX, AZ 85018
FOR: SOUTHWESTERN POWER GROUP II,

JOHN STERLING
DIR - MKT & POLICY AFFAIRS
FIRST SOLAR, INC.
119
350 W WASHINGTON ST., STE. 600
TEMPE, AZ 85281
FOR: FIRST SOLAR, INC.

CHRISTIAN LENCI
LINDE, INC. WEST REGION
1620 WEST FOUNTAINHEAD PKWY, SUITE
TEMPE, AZ 85282
FOR: PRAXAIR PLAINFIELD, INC.

JODI STEPHENS
COALITION MGR.
C.O.R.D.
1 EAST LIBERTY STREET, SUITE 444
RENO, NV 89501
FOR: COALITION FOR THE OPTIMIZATION OF
RENEWABLE DEVELOPMENT (C.O.R.D.)

TORI N. SUNDHEIM
DEPUTY ATTORNEY GENERAL
OFFICE OF THE ATTORNEY GENERAL
100 NORTH CARSON STREET
CARSON CITY, NV 89701-4717
FOR: NEVADA GOVERNOR'S OFFICE OF ENERGY
(NV GOE)

EDWARD L. HSU
SR COUNSEL
SOUTHERN CALIFORNIA GAS COMPANY
555 WEST 5TH STREET, GT14E7, STE. 1400
LOS ANGELES, CA 90013
FOR: SOUTHERN CALIFORNIA GAS COMPANY

PAUL SHEPARD
COO
DIAMOND GENERATING LLC
633 WEST FIFTH STREET, STE. 2700
LOS ANGELES, CA 90071
FOR: DIAMOND GENERATING LLC F/K/A
DIAMOND GENERATING COMPANY

INGER GOODMAN
JUST ENERGY SOLUTIONS INC.
ENERGY
6 CENTERPOINTE DRIVE, SUITE 750
LA PALMA, CA 90623
FOR: JUST ENERGY SOLUTIONS INC.
MUNICIPAL

GREGORY S.G. KLATT
ATTORNEY
DOUGLASS, LIDDELL & KLATT
EMAIL ONLY
EMAIL ONLY, CA 91006
FOR: WESTERN POWER TRADING FORUM (WPTF)

CATHY A. KARLSTAD
SR. ATTORNEY

ALORA BARTOSZ
BUSINESS DEVELOPMENT ANALYST
ORMAT TECHNOLOGIES, INC.
6140 PLUMAS STREET
RENO, NV 89519
FOR: ORMAT TECHNOLOGIES, INC.

C.C. SONG
DIR - REGULATORY
CLEAN POWER ALLIANCE
555 W. 5TH STREET, 35TH FLOOR
LOS ANGELES, CA 90013
FOR: CLEAN POWER ALLIANCE

VILKO DOMIC
DIRECTOR
CITY OF COMMERCE
2535 COMMERCE WAY
COMMERCE, CA 90040
FOR: CITY OF COMMERCE

MICHAEL MAZUR
3 PHASES RENEWABLES, INC.
1228 E. GRAND AVENUE
EL SEGUNDO, CA 90245
FOR: 3 PHASES RENEWABLES, INC.

KATHERINE HERNANDEZ
PICO RIVERA INNOVATIVE MUNICIPAL
ENERGY
6615 PASSONS BLVD
PICO RIVERA, CA 90660
FOR: PICO RIVERA INNOVATIVE
ENERGY

JEAN M. AYALA
CITY CLERK
CITY OF BALDWIN PARK
14403 E. PACIFIC AVE
BALDWIN PARK, CA 91706
FOR: CITY OF BALDWIN PARK

NQUYEN QUAN
BEAR VALLEY ELECTRIC SERVICE

SOUTHERN CALIFORNIA EDISON COMPANY
2244 WALNUT GROVE AVE., PO BOX 800
ROSEMEAD, CA 91770
FOR: SOUTHERN CALIFORNIA EDISON COMPANY

630 E. FOOTHILL BLVD.
SAN DIMAS, CA 91773
FOR: BEAR VALLEY ELECTRIC SERVICE

DIANE CONKLIN
SPOKESPERSON
MUSSEY GRADE ROAD ALLIANCE
PO BOX 683
RAMONA, CA 92065
FOR: MUSSEY GRADE ROAD ALLIANCE

JOSE TORRE-BUENO PH.D.
EXECUTIVE DIRECTOR
CENTER FOR COMMUNITY ENERGY
249 SOUTH HIGHWAY 101, SUITE 564
SOLANA BEACH, CA 92075
FOR: CENTER FOR COMMUNITY ENERGY

GREG BASS
WESTERN REGULATORY AFFAIRS DIR.
CALPINE ENERGY SOLUTIONS, LLC
FOUNDATION
401 WEST A STREET, SUITE 500
SAN DIEGO, CA 92101
FOR: CALPINE ENERGY SOLUTIONS, LLC

MALINDA DICKENSON
DIR - LEGAL & EXEC.
THE PROTECT OUR COMMUNITIES
FOUNDATION
4452 PARK BLVD., STE 309
SAN DIEGO, CA 92116
FOR: THE PROTECT OUR COMMUNITIES
FOUNDATION

THOMAS R. DARTON, ESQ.
ATTORNEY
PILOT POWER GROUP, INC.
8910 UNIVERSITY CENTER LANE, STE. 520
SAN DIEGO, CA 92122
COMPANY
FOR: KING CITY COMMUNITY POWER

AIMEE SMITH
SAN DIEGO GAS & ELECTRIC COMPANY
8330 CENTURY PARK CT., CP32D
SAN DIEGO, CA 92123
FOR: SAN DIEGO GAS & ELECTRIC

ANDREA ALTMANN
SAN DIEGO COUNTY WATER AUTHORITY
4677 OVERLAND AVE.
SAN DIEGO, CA 92123
FOR: SAN DIEGO COUNTY WATER AUTHORITY

CHRIS DEVON
DIR - ENERGY MARKET POLICY
TERRA-GEN, LLC
11455 EL CAMINO REAL STE 160
SAN DIEGO, CA 92130
FOR: TERRA-GEN, LLC

MIKE CRUZ
SENTINEL ENERGY CENTER, LLC
15775 MELISSA LANE
NORTH PALM SPRINGS, CA 92258
FOR: SENTINEL ENERGY CENTER, LLC

ISAIAH HAGERMAN
DIR - ADMINISTRATIVE SERVICES
CITY OF RANCHO MIRAGE
69-825 HIGHWAY 111
RANCHO MIRAGE, CA 92270
FOR: RANCHO MIRAGE ENERGY AUTHORITY

KOFI ANTOBAM
DIRECTOR OF FINANCE
APPLE VALLEY CHOICE ENERGY (AVCE)
14955 DALE EVANS PARKWAY
APPLE VALLEY, CA 92307
FOR: APPLE VALLEY CHOICE ENERGY

KEVIN SHORT
GENERAL MGR.
ANZA ELECTRIC COOPERATIVE INC.
58470 US HIGHWAY 371
ANZA, CA 92539
FOR: ANZA ELECTRIC COOPERATIVE

ROBERT JOHNSON
CITY MGR.
CITY OF SAN JACINTO
595 S. SAN JACINTO AVE., BLDG A
SAN JACINTO, CA 92583
FOR: SAN JACINTO POWER

PATRICK VANBEEK
COMMERCIAL ENERGY OF CALIFORNIA
2875 MICHELLE DR. STE 100
IRVINE, CA 92606
FOR: COMMERCIAL ENERGY OF CA

MATTHEW LLOYD
DIR - ENERGY STORGE
BAYWA R.E. SOLAR PROJECTS, LLC
18575 JAMBOREE ROAD, STE. 850
IRVINE, CA 92612
FOR: BAYWA R.E. SOLAR PROJECTS, LLC

RYAN M. F. BARON
ATTORNEY
BEST BEST & KRIEGER LLP
18101 VON KARMAN AVE, SUITE 1000
IRVINE, CA 92612
FOR: ORANGE COUNTY POWER AUTHORITY

RYAN M. F. BARON
ATTORNEY
BEST BEST & KRIEGER, LLP
18101 VON KARMAN AVE., STE. 1000
IRVINE, CA 92612
FOR: WESTERN COMMUNITY ENERGY

RYAN M. F. BARON
ATTORNEY
BEST BEST & KRIEGER LLP
18101 VON KARMAN AVE., SUITE 1000
IRVINE, CA 92612
FOR: DESERT COMMUNITY ENERGY

EMANUEL WAGNER
DEPUTY DIR
CALIFORNIA HYDROGEN BUSINESS COUNCIL
18847 VIA SERENO
YORBA LINDA, CA 92866
FOR: CALIFORNIA HYDROGEN BUSINESS
COUNCIL (CHBC)

DANIEL KIM
VP - GOVN'T & REGULATORY
GOLDEN STATE CLEAN ENERGY, LLC
4125 W NOBLE AVE., STE 310
VISALIA, CA 93277
FOR: GOLDEN STATE CLEAN ENERGY, LLC

GENE A. NELSON, PH.D
SR. LEGAL RESEARCHER & PRESIDENT
CALIFORNIANS FOR GREEN NUCLEAR POWER
1375 EAST GRAND AVE., STE. 103, NO. 523
ARROYO GRANDE, CA 93420
FOR: CALIFORNIANS FOR GREEN NUCLEAR
POWER, INC.

CATHY DEFALCO, EJD, C.P.M.
ENERGY MGR. - REGULATORY
CITY OF LANCASTER
44933 FERN AVENUE
LANCASTER, CA 93534
FOR: LANCASTER CHOICE ENERGY

JERRI STRICKLAND
POLICY ADVISOR
CENTRAL COAST COMMUNITY ENERGY
70 GARDEN COURT, SUITE 300
MONTEREY, CA 93940
FOR: CENTRAL COAST COMMUNITY ENERGY
(3CE)

ADAM STERN
EXE DIR
OFFSHORE WIND CALIFORNIA
PO BOX 955
MENLO PARK, CA 94026
FOR: OFFSHORE WIND CALIFORNIA (OWC)

RACHAEL E. KOSS
ATTORNEY
ADAMS BROADWELL JOSEPH & CARDOZO
601 GATEWAY BLVD., SUITE 1000
SOUTH SAN FRANCISCO, CA 94080
FOR: COALITION OF CALIFORNIA UTILITY

RACHAEL KOSS
ATTORNEY
ADAMS BROADWELL JOSEPH & CORDOZO
601 GATEWAY BLVD., STE. 1000
SOUTH SAN FRANCISCO, CA 94080
FOR: CALIFORNIA UNIONS FOR RELIABLE

EMPLOYEES

BIJIT KUNDU
MGR - REGULATORY & LEGISLATIVE
SFPUC POWER ENTERPRICE
525 GOLDEN GATE AVENUE
SAN FRANCISCO, CA 94102
FOR: CLEANPOWERSF

MATT MILEY
CALIF PUBLIC UTILITIES COMMISSION
LEGAL DIVISION
ROOM 5135
HERRERA
505 VAN NESS AVENUE
234
SAN FRANCISCO, CA 94102-3214
FOR: PUBLIC ADVOCATES OFFICE
FRANCISCO

MATTHEW FREEDMAN
STAFF ATTORNEY
THE UTILITY REFORM NETWORK
785 MARKET STREET, 14TH FL
SAN FRANCISCO, CA 94103
FOR: THE UTILITY REFORM NETWORK (TURN)
ADVOCATES

MOHIT CHABBRA
NATURAL RESOURCES DEFENSE COUNCIL
111 SUTTER STREET, 21ST FLOOR
SAN RANCISCO, CA 94104
FOR: NATURAL RESOURCES DEFENSE COUNCIL

SHELL

SETH D. HILTON
ATTORNEY
STOEL RIVES LLP
ONE MONTGOMERY ST., STE 3230
SAN FRANCISCO, CA 94104
FOR: AES ALAMITOS, LLC
INC.

SHERIDAN PAUKER
ATTORNEY
KEYES & FOX LLP
580 CALIFORNIA STREET, 12TH FLOOR
SAN FRANCISCO, CA 94104

ENERGY

YOCHANAN ZAKAI
ATTORNEY
SHUTE MIHALY & WEINBERGER LLP
396 HAYES STREET
SAN FRANCISCO, CA 94102
FOR: ENVIRONMENTAL DEFENSE FUND

WILLIAM ROSTOV
DEPUTY CITY ATTORNEY
CITY AND COUNTY OF SAN FRANCISCO
OFFICE OF CITY ATTORNEY DENNIS
1 DR. CARLTON B. GOODLETT PL., RM
SAN FRANCISCO, CA 94102-5408
FOR: CITY AND COUNTY OF SAN

JAMES BIRKELUND
PRESIDENT
SMALL BUSINESS UTILITY ADVOCATES
548 MARKET ST., STE. 11200
SAN FRANCISCO, CA 94104
FOR: SMALL BUSINESS UTILITY

(SBUA)

SETH D. HILTON
ATTORNEY
STOEL RIVES LLP
ONE MONTGOMERY STREET, SUITE 3230
SAN FRANCISCO, CA 94104
FOR: SHELL ENERGY SOLUTIONS F/K/A

ENERGY NORTH AMERICA (US), L.P.

SETH HILTON
ATTORNEY AT LAW
STOEL RIVES, LLP
1 MONTGOMERY STREET, SUITE 3230
SAN FRANCISCO, CA 94104
FOR: AIR PRODUCTS AND CHEMICALS,
INC.

SHERIDAN PAUKER
PARTNER
KEYES & FOX LLP
580 CALIFORNIA STREET, 12TH FLOOR
SAN FRANCISCO, CA 94104

FOR: VALLEY CLEAN ENERGY ALLIANCE

FOR: NEW LEAF ENERGY, INC

TIM LINDL
COUNSEL
KEYES & FOX LLP
580 CALIFORNIA STREET, 12TH FLOOR
SAN FRANCISCO, CA 94104
FOR: SAN DIEGO COMMUNITY POWER (â€œSDCPâ€œ)
PRODUCERS

BRIAN CRAGG
ATTORNEY
DOWNEY BRAND LLP
455 MARKET STREET, STE. 1500
SAN FRANCISCO, CA 94105
FOR: INDEPENDENT ENERGY
ASSOCIATION

NORA SHERIFF
ATTORNEY
BUCHALTER, A PROFESSIONAL CORPORATION
CORPORATION
55 SECOND STREET, SUITE 1700
SAN FRANCISCO, CA 94105
FOR: ENERGY PRODUCERS AND USERS
CONSUMERS
COALITION

NORA SHERIFF
ATTORNEY
BUCHALTER, A PROFESSIONAL
CORPORATION
55 SECOND STREET, STE 1700
SAN FRANCISCO, CA 94105
FOR: CALIFORNIA LARGE ENERGY
ASSOCIATION (CLECA)

WILLIAM D. KISSINGER
ATTORNEY
WEST
MORGAN, LEWIS & BOCKIUS LLP
ONE MARKET, SPEAR STREET TOWER
SAN FRANCISCO, CA 94105
FOR: EAGLE CREST ENERGY COMPANY
LLC

ERIN KESTER
DIR - GOV'T RELATIONS OFFSHORE -
RWE OFFSHORE WIND HOLDINGS, LLC
20 CALIFORNIA STREET, 5TH FL.
SAN FRANCISCO, CA 94111
FOR: RWE OFFSHORE WIND HOLDINGS,

JOHNNY CASANA
U.S. POLITICAL & REGULATORY AFFAIRS
PATTERN ENERGY
1088 SANSOME STREET
SAN FRANCISCO, CA 94111
FOR: PATTERN ENERGY GROUP, LP

KATIE JORRIE
DAVIS WRIGHT TREMAINE, LLP
50 CALIFORNIA STREET, 23RD F.
SAN FRANCISCO, CA 94111
FOR: CALPINE CORPORATION

LISA A. COTTLE
ATTORNEY
SHEPPARD MULLIN RICHTER & HAMPTON LLP
LLP
FOUR EMBARCADERO CENTER, 17TH FL.
SAN FRANCISCO, CA 94111
FOR: NEXTERA ENERGY RESOURCES, LLC

LISA A. COTTLE
ATTORNEY
SHEPPARD MULLIN RICHTER & HAMPTON
LLP
FOUR EMBARCADERO CENTER, 17TH FLOOR
SAN FRANCISCO, CA 94111
FOR: HECATE GRID LLC

SETH D. HILTON
ATTORNEY AT LAW
STOEL RIVES LLP
THREE EMBARCADERO CENTER, SUITE 1120
SAN FRANCISCO, CA 94111

VIDHYA PRABHAKARAN
ATTORNEY
DAVIS WRIGHT TREMAINE LLP
50 CALIFORNIA STREET, 23RD FLR
SAN FRANCISCO, CA 94111

FOR: AES NORTH AMERICA DEVELOPMENT, LLC
AUTHORITY

FOR: PENINSULA CLEAN ENERGY

VIDHYA PRABHAKARAN
ATTORNEY
DAVIS WRIGHT TREMAINE, LLP
ALLIANCE
50 CALIFORNIA STREET, 23RD FLR
SAN FRANCISCO, CA 94111
FOR: POWEREX CORP.
JUSTICE

DEBORAH BEHLES
OF COUNSEL
CALIF. ENVIRONMENTAL JUSTICE

2912 DIAMOND STREET, NO. 162
SAN FRANCISCO, CA 94131
FOR: CALIFORNIA ENVIRONMENTAL

ALLIANCE (CEJA)

MEGAN M. MYERS
ATTORNEY AT LAW
110 OXFORD STREET
SAN FRANCISCO, CA 94134
FOR: CENTER FOR ENERGY EFFICIENCY AND
RENEWABLE TECHNOLOGIES (CEERT)
TRANSMISSION

LENA PERKINS, PH.D
MANAGER PROGRAM FOR EMERGING TECH
CITY OF PALO ALTO UTILITIES
250 HAMILTON AVENUE
PALO ALTO, CA 94301
FOR: BAY AREA MUNICIPAL

GROUP

EVELYN KAHL
GENERAL COUNSEL & DIR - POLICY
CALIFORNIA COMMUNITY CHOICE ASSOCIATION
ONE CONCORD CENTER
2300 CLAYTON ROAD, SUITE 1150
CONCORD, CA 94520
FOR: CALIFORNIA COMMUNITY CHOICE
ASSOCIATION

DAMON FRANZ
MANAGING POLICY ADVISOR
TESLA, INC.
901 PAGE AVENUE
FREMONT, CA 94538
FOR: TESLA, INC.

JEAN MERRIGAN
EXE. DIR.
WOMEN'S ENERGY MATTERS
PO BOX 2615
MARTINEZ, CA 94553
FOR: WOMEN'S ENERGY MATTERS

JENNIFER CHAMBERLAIN
EXECUTIVE DIR - MARKET DEVELOPMENT
CPOWER
2475 HARVARD CIRCLE
WALNUT CREEK, CA 94597
FOR: CPOWER

PETER TON
ATTORNEY
CALIF.
TON LAW PC
2450 POTOMAC STREET
OAKLAND, CA 94602
REGENTS
FOR: BRIGHTLINE DEFENSE PROJECT

CYNTHIA CLARK
THE REGENTS OF THE UNIVERSITY OF

1100 BROADWAY, SUITE 1450
OAKLAND, CA 94607
FOR: UNIVERSITY OF CALIFORNIA

GREG WIKLER
EXE. DIR
CA EFFICIENCY + DEMAND MGMT. COUNCIL
1111 BROADWAY, STE. 300

MARK SPECHT
ENERGY ANALYST
UNION OF CONCERNED SCIENTISTS
500 12TH ST., SUITE 340

OAKLAND, CA 94607
FOR: CALIFORNIA EFFICIENCY + DEMAND
MANAGEMENT COUNCIL

OAKLAND, CA 94607
FOR: UNION OF CONCERNED SCIENTISTS

KELLY E. BOYD
SR. DIR - REGULATORY, WEST
EQUINOR WIND US LLC
1900 POWELL ST.
EMERYVILLE, CA 94608
FOR: EQUINOR WIND US LLC

DIANA GALLEGOS
MANAGING DIR.
GREENGENSTORAGE, LLC
4421 WEBSTER STREET
OAKLAND, CA 94609
FOR: GREENGEN STORAGE, LLC

DANIEL S. HASHIMI
ATTORNEY
PACIFIC GAS AND ELECTRIC COMPANY
300 LAKESIDE DRIVE
OAKLAND, CA 94612
FOR: PACIFIC GAS AND ELECTRIC COMPANY

JOHN NEWTON
PRINCIPAL REGULATORY MGR.
EAST BAY COMMUNITY ENERGY
1999 HARRISON ST, SUITE 2300
OAKLAND, CA 94612
FOR: AVA COMMUNITY ENERGY (FORMERLY
EAST BAY COMMUNITY ENERGY)

KATHERINE RAMSEY
SR. ATTORNEY
SIERRA CLUB
2101 WEBSTER STREET, SUITE 1300
OAKLAND, CA 94612
MARKETS
FOR: SIERRA CLUB

MARY NEAL
MRW & ASSOCIATES
1736 FRANKLIN ST. SUITE 700
OAKLAND, CA 94612
FOR: ALLIANCE FOR RETAIL ENERGY

STEPHANIE DOYLE
REGULATORY DIRECTOR
VOTE SOLAR
360 22ND ST, SUITE 700
OAKLAND, CA 94612
FOR: VOTE SOLAR

ADAM STEIN, PH.D
SR. NUCLEAR ANALYST
BREAKTHROUGH INSTITUTE
2054 UNIVERSITY AVENUE
BERKELEY, CA 94704
FOR: THE BREAKTHROUGH INSTITUTE

ALEX MORRIS
EXECUTIVE DIR
CALIFORNIA ENERGY STORAGE ALLIANCE
2150 ALLSTON WAY, SUITE 400
BERKELEY, CA 94704
FOR: CALIFORNIA ENERGY STORAGE ALLIANCE
(CESA)

GREGG MORRIS
DIRECTOR
THE GREEN POWER INSTITUTE
2039 SHATTUCK AVE., SUITE 420
BERKELEY, CA 94704
FOR: THE GREEN POWER INSTITUTE

LAURA NELSON
EXE. DIR
GREEN HYDROGEN COALITION
2150 ALLSTON WAY, STE. 400
BERKELEY, CA 94704
FOR: THE GREEN HYDROGEN COALITION (GHC)
CALIFORNIA

JULIA A. LEVIN
EXECUTIVE DIR
BIOENERGY ASSOCIATION OF CALIFORNIA
PO BOX 6184
ALBANY, CA 94706
FOR: BIOENERGY ASSOCIATION OF

NANCY RADER
EXECUTIVE DIR.
CALIFORNIA WIND ENERGY ASSOCIATION
1700 SHATTUCK AVE., SUITE 17
BERKELEY, CA 94709
FOR: CALIFORNIA WIND ENERGY ASSOCIATION

R. THOMAS BEACH
CONSULTANT
CROSSBORDER ENERGY
2560 NINTH STREET, SUITE 213A
BERKELEY, CA 94710
FOR: CROSSBORDER ENERGY

FRANK R. LINDH
ATTORNEY AT LAW
110 TAYLOR STREET
SAN RAFAEL, CA 94901
FOR: FRIENDS OF MINIDOKA

SABRINNA SOLDAVINI
SR. POLICY ANALYST
MARIN CLEAN ENERGY
1125 TAMALPAIS AVENUE
SAN RAFAEL, CA 94901
FOR: MARIN CLEAN ENERGY (MCE)

MICHAEL ALCANTAR
COUNSEL
ALCANTAR LAW GROUP
1 BLACKFIELD DRIVE, STE. 135
TIBURON, CA 94920
FOR: WATSON COGENERATION COMPANY

MICHAEL ALCANTAR
ALCANTAR LAW GROUP
1 BLACKFIELD DRIVE NO. 135
TIBURON, CA 94920
FOR: COGENERATION ASSOCIATION OF CALIFORNIA

JAN REID
COAST ECONOMICS CONSULTING
3185 GROSS ROAD
SANTA CRUZ, CA 95062
FOR: L. JAN REID

JEANNE M. SOLE'
DEPUTY DIR - POWER RESOURCES
CITY OF SAN JOSE
200 E. SANTA CLARA ST., 14TH FL.
SAN JOSE, CA 95113
FOR: CITY OF SAN JOSÃ%,

ADMINISTRATOR OF
JOSÃ%

SAN JOSÃ% CLEAN ENERGY F/K/A SAN
CLEAN ENERGY

C. SUSIE BERLIN
ATTORNEY AT LAW
LAW OFFICES OF SUSIE BERLIN
1346 THE ALAMEDA, SUITE 7, NO. 141
SAN JOSE, CA 95126
FOR: NORTHERN CALIFORNIA POWER AGENCY
(NCPA)

C. SUSIE BERLIN
ATTORNEY AT LAW
LAW OFFICES OF SUSIE BERLIN
1346 THE ALAMEDA, STE. 7, NO. 141
SAN JOSE, CA 95126
FOR: GOLDEN STATE POWER COOPERATIVE

GARSON KNAPP
LIBERTY POWER CORP.
131 - A STONY CIRCLE, STE. 500
SANTA ROSA, CA 95401
FOR: LIBERTY POWER HOLDINGS, LLC

NEAL M. REARDON
DIR - REGULATORY AFFAIRS
SONOMA CLEAN POWER AUTHORITY
50 SANTA ROSA AVE. 5TH FL
SANTA ROSA, CA 95404
FOR: SONOMA CLEAN POWER AUTHORITY

JOSEPH F. WIEDMAN
ATTORNEY
LAW OFFICE OF JOSEPH F. WIEDMAN
115 BROAD ST., STE. 157

RICHARD ENGEL
DIR - POWER RESOURCES
REDWOOD COAST ENERGY AUTHORITY
633 3RD STREET

CLOVERDALE, CA 95425
FOR: COALITION OF COMMUNITY SOLAR ACCESS

EUREKA, CA 95501
FOR: REDWOOD COAST ENERGY AUTHORITY

JIM ZOELLICK
ENGINEER - RESEARCH
SCHATZ ENERGY RESEARCH CENTER
HUMBOLDT STATE UNIVERSITY
1 HARPST STREET
ARCATA, CA 95521
FOR: SCHATZ ENERGY RESEARCH CENTER

MARISSA NAVA
CALIFORNIA ISO
250 OUTCROPPING WAY
FOLSOM, CA 95630
FOR: CALIFORNIA INDEPENDENT SYSTEM
OPERATOR CORPORATION (CAISO)

HAROLD DITTMER
PRESIDENT
WELLHEAD POWER SOLUTIONS, LLC
650 BERECUT DR., STE. C
SACRAMENTO, CA 95811
FOR: WELLHEAD POWER SOLUTIONS, LLC

DAVID PEFFER
ATTORNEY
BRAUN BLAISING SMITH WYNNE, P.C.
555 CAPITOL MALL, STE. 570
SACRAMENTO, CA 95814
FOR: CITY OF PALMDALE

DAVID PEFFER
ATTORNEY
BRAUN BLAISING SMITH WYNNE, P.C.
555 CAPITOL MALL, SUITE 570
SACRAMENTO, CA 95814
FOR: CALIFORNIA MUNICIPAL UTILITIES
ASSOCIATION

JOHN MCKINSEY
COUNSEL
MCKINSEY LAW OFFICE
1121 L STREET, SUITE 700
SACRAMENTO, CA 95814
FOR: MIDDLE RIVER POWER, LLC

JOSH STOOPS
ATTORNEY
BRAUN BLAISING SMITH WYNNE, P.C.
555 CAPITOL MALL, SUITE 570
SACRAMENTO, CA 95814
FOR: CALIFORNIA CHOICE ENERGY AUTHORITY
ALLIANCE

JULEE M. BALL
EX. DIR
CALIFORNIA BIOMASS ENERGY ALLIANCE
1015 K STREET
SACRAMENTO, CA 95814
FOR: CALIFORNIA BIOMASS ENERGY

JULIA PROCHNIK
EXE. DIR
LONG DURATION ENERGY STORAGE ASSOC
1520 15TH STREET, STE. 6
SACRAMENTO, CA 95814
FOR: LONG DURATION ENERGY STORAGE
ASSOCIATION OF CALIFORNIA (LDESAC)

PAMELA FLICK
CALIFORNIA PROGRAM DIR
DEFENDERS OF WILDLIFE
980 9TH ST, SUITE 1730
SACRAMENTO, CA 95814
FOR: DEFENDERS OF WILDLIFE

SARAH KOZAL
CALIFORNIA ISO
250 OUTCROPPING WAY
FOLSOM, CA 95814
FOR: ELECTROCHAEA CORPORATION

SCOTT BLAISING
ATTORNEY
BRAUN BLAISING SMITH WYNNE, PC
555 CAPITOL MALL, SUITE 570
SACRAMENTO, CA 95814
FOR: SILICON VALLEY CLEAN ENERGY

SCOTT BLAISING

WILL PETTITT, PH.D, FGS

ATTORNEY
BRAUN BLAISING SMITH WYNNE, PC
555 CAPITOL MALL, SUITE 570
SACRAMENTO, CA 95814
FOR: PIONEER COMMUNITY ENERGY

EXE. DIR
GEOTHERMAL RISING
1121 L STREET, STE. 700
SACRAMENTO, CA 95814
FOR: GEOTHERMAL RISING

JON NORMAN
PRESIDENT AND COO
HYDROSTOR, INC.
LLP
400 CAPITOL MALL, SUITE 3000
SACRAMENTO, CA 95814-4497
FOR: HYDROSTOR INC.

RONALD LIEBERT
ATTORNEY AT LAW
ELLISON SCHNEIDER HARRIS & DONLAN
2600 CAPITOL AVENUE, STE. 400
SACRAMENTO, CA 95816-5931
FOR: BHE RENEWABLES, LLC

ALEX JACKSON
AMERICAN CLEAN POWER ASSOCIATION - CA
2733 6TH AVENUE
SACRAMENTO, CA 95818
FOR: AMERICAN CLEAN POWER - CALIFORNIA
(FORMERLY AMERICAN WIND ENERGY
ASSOCIATION OF CALIFORNIA (A WEA
CALIFORNIA))

SHANNON EDDY
EXECUTIVE DIR
LARGE-SCALE SOLAR ASSOCIATION
2501 PORTOLA WAY
SACRAMENTO, CA 95818
FOR: LARGE-SCALE SOLAR ASSOCIATION

ANN TROWBRIDGE
ATTORNEY
OFFICER
DAY CARTER MURPHY, LLP
3620 AMERICAN RIVER DRIVE, STE. 205
SACRAMENTO, CA 95864
FOR: CALIFORNIA CLEAN DG COALITION
(CCDC)

BRIAN RING
ASSISTANT CHIEF ADMINISTRATIVE
BUTTE CHOICE ENERGY AUTHORITY
23 COUNTY CENTER DRIVE
OROVILLE, CA 95965
FOR: BUTTE CHOICE ENERGY

JANE EATON
SURPRISE VALLEY ELECTRIFICATION CORP
516 US HWY 395 E
COOPERATIVE
ALTURAS, CA 96101
FOR: SURPRISE VALLEY ELECTRIFICATION
CORPORATION

CORBY ERWIN
MEMBER / ENERGY SRCS MGR.
PLUMAS-SIERRA RURAL ELECTRIC
PO BOX 2000
PORTOLA, CA 96122
FOR: PLUMAS SIERRA RURAL ELECTRIC
COOPERATIVE

DANIEL MARSH
MGR - RATES & REGULATORY AFFAIRS
LIBERTY UTILITIES (CALPECO ELECTRIC) LLC
MARKETING
933 ELOISE AVENUE
SOUTH LAKE TAHOE, CA 96150
FOR: LIBERTY UTILITIES (CALPECO
AND
ELECTRIC) LLC

STEPHEN GREENLEAF
SR. DIR. - REGULATORY AND POLICY
BROOKFIELD RENEWABLE TRADING &
1568 OGLALA STREET
SOUTH LAKE TAHOE, CA 96150
FOR: BROOKFIELD RENEWABLE TRADING
MARKETING LP

LEAH SILVERTHORN
HUA NANI PARTNERS
PO BOX 1303
KAILUA, HI 96734
FOR: MICROSOFT CORPORTION

MOLLY CROLL
MGR - POLICY, REGULATORY
AVANGRID RENEWABLES, LLC
2701 NW VAUGHN ST., STE. 300
PORTLAND, OR 97210
FOR: AVANGRID RENEWABLES, LLC

JOSEPH DALLAS
SENIOR ATTORNEY
PACIFICORP
825 NE MULTNOMAH, SUITE 2000
PORTLAND, OR 97232
FOR: PACIFICORP

III. Information Only

AARON LU
RATES AND STRATEGY ANAYLST
SAN DIEGO COMMUNITY POWER
EMAIL ONLY
EMAIL ONLY, CA 00000

ALICE HARRON
HARRON LLC
EMAIL ONLY
EMAIL ONLY, CA 00000

ALINA BEMIS
CALIFORNIA PUBLIC UTILITIES COMMISSION
EMAIL ONLY
EMAIL ONLY, CA 00000

ANNA FERO
DAVIS WRIGHT TREMAINE LLP
EMAIL ONLY
EMAIL ONLY, CA 00000

ANUPAMA PANDEY
PACIFIC GAS AND ELECTRIC COMPANY
EMAIL ONLY
EMAIL ONLY, CA 00000

BARBARA BOSWELL
CITY OF PALMDALE
EMAIL ONLY
EMAIL ONLY, CA 00000
FOR: CITY OF PALMDALE

BARBARA R. BARKOVICH
CONSULTANT
BARKOVICH & YAP, INC.
EMAIL ONLY
EMAIL ONLY, CA 00000

BOB RAMIREZ
OPINION DYNAMICS
EMAIL ONLY
EMAIL ONLY, CA 00000

BRIAN KORPICS
DIR, UTILITY-SCALE POLICY & BUSINESS
NEW LEAF ENERGY
EMAIL ONLY
EMAIL ONLY, CA 00000

BRIAN THEAKER
VP - REGULATORY
MIDDLE RIVER POWER, LLC
EMAIL ONLY
EMAIL ONLY, CA 00000

CASE COORDINATION
PACIFIC GAS AND ELECTRIC COMPANY
EMAIL ONLY

CHELSEI SPARTI
BROOKFIELD RENEWABLE
EMAIL ONLY

EMAIL ONLY, CA 00000

CHRISTINA SYIANI
PACIFIC GAS AND ELECTRIC COMPANY
EMAIL ONLY
EMAIL ONLY, AA 00000

DAVID BOBZIEN
DIR
NEVADE GOVERNOR'S OFFICE OF ENERGY
EMAIL ONLY
EMAIL ONLY, NV 00000

DEMARIE WEBER
REGULATORY & COMPLIANCE MANAGER
SILICON VALLEY CLEAN ENERGY
EMAIL ONLY
EMAIL ONLY, CA 00000

ELIZABETH BECK
ENEL X NORTH AMERICA, INC.
EMAIL ONLY
EMAIL ONLY, CA 00000

EMILY FABICK
REGULATORY ANALYST
THE CLEAN ENERGY ALLIANCE
EMAIL ONLY
EMAIL ONLY, AA 00000

EMILY TURKEL
GOVERNMENT RELATIONS ANALYST
CALPINE CORPORATION
EMAIL ONLY
EMAIL ONLY, CA 00000

EUSEBIO ARBALLOW
EDF RENEWABLES
MGR.
EMAIL ONLY
EMAIL ONLY, CA 00000

HOLLY ANDERSON
GENON HOLDINGS
EMAIL ONLY
EMAIL ONLY, CA 00000
FOR: GENON HOLDINGS, INC

EMAIL ONLY, CA 00000

CHRISTINA SYRIANI
PACIFIC GAS AND ELECTRIC COMPANY
EMAIL ONLY
EMAIL ONLY, CA 00000

DAVID MATUSIAK
PACIFIC GAS AND ELECTRIC COMPANY
EMAIL ONLY
EMAIL ONLY, CA 00000

ELI FARRAH
THREE RIVERS ENERGY DEVELOPMENT LLC
EMAIL ONLY
EMAIL ONLY, CA 00000

EMILY DUKAS
PACIFIC GAS AND ELECTRIC COMPANY
EMAIL ONLY
EMAIL ONLY, AA 00000

EMILY SINGER
VICE PRESIDENT, REGULATORY AFFAIRS
BHE RENEWABLES, LLC
EMAIL ONLY
EMAIL ONLY, CA 00000

ERIN KESTER
DIR - GOVERNMENT RELATIONS
RWE RENEWABLES AMERICAS, LLC
OFFSHORE WIND " WEST COAST, U.S.
EMAIL ONLY
EMAIL ONLY, AA 00000

FAITH CARLSON
REGULATORY & LEGISLATIVE POLICY
REDWOOD COAST ENERGY AUTHORITY
EMAIL ONLY
EMAIL ONLY, CA 00000

IMONICA SCHWEBS
MORGAN LEWIS BOCKIUS LLP
EMAIL ONLY
EMAIL ONLY, CA 00000

ISTEVE DREW
BORREGO SOLAR SYSTEMS
EMAIL ONLY
EMAIL ONLY, CA 00000

JAMES HIMELIC
FIRST PRINCIPLES ADVISORY
EMAIL ONLY
EMAIL ONLY, CA 00000

JAMES ROSS
RCS, INC.
EMAIL ONLY
EMAIL ONLY, CA 00000
FOR: COGENERATION ASSOCIATION OF
CALIFORNIA (CAC)

JAMES SIEVERS
CPUC
EMAIL ONLY
EMAIL ONLY, CA 00000

JEFF DE TURI
SAN DIEGO GAS AND ELECTRIC
EMAIL ONLY
EMAIL ONLY, CA 00000

JOE GRECO
GRECO ENERGY CONSULTING
EMAIL ONLY
EMAIL ONLY, CA 00000

JOSH CHASSE
SAN DIEGO GAS AND ELECTRIC
EMAIL ONLY
EMAIL ONLY, CA 00000

JULIA ZUCKERMAN
SENIOR MANAGER, EXTERNAL AFFAIRS
CLEARWAY ENERGY GROUP
EMAIL ONLY
EMAIL ONLY, CA 00000

KATHY ANISOVETS
CASE MGR - REGULATORY
SAN DIEGO GAS & ELECTRIC COMPANY
EMAIL ONLY
EMAIL ONLY, CA 00000

KAVYA BALARAMAN
REPORTER
UTILITY DIVE
EMAIL ONLY
EMAIL ONLY, DC 00000

KELSIE GOMANIE
ADVOCATE
NATURAL RESOURCE DEFENSE COUNCIL
EMAIL ONLY
EMAIL ONLY, AA 00000

LEAH WATTS
SAN DIEGO GAS AND ELECTRIC
EMAIL ONLY
EMAIL ONLY, CA 00000

LIAM PITMAN
PACIFIC GAS AND ELECTRIC
EMAIL ONLY
EMAIL ONLY, CA 00000

MARC COSTA
ENERGY COALITION
EMAIL ONLY
EMAIL ONLY, CA 00000

MATT KAWATANI
PACIFIC GAS AND ELECTRIC COMPANY
EMAIL ONLY
EMAIL ONLY, CA 00000

MATTHEW VESPA
STAFF ATTORNEY
EARTHJUSTICE
50 CALIFORNIA ST., SUITE 500
SAN FRANCISCO, CA 00000
FOR: SIERRA CLUB

MCE REGULATORY
MARIN CLEAN ENERGY
EMAIL ONLY
EMAIL ONLY, CA 00000

MIA BERRIOS
PACIFIC GAS AND ELECTRIC COMPANY
EMAIL ONLY
EMAIL ONLY, CA 00000

NANCY SARACINO
WESTERN ENERGY & WATER, APC
EMAIL ONLY
EMAIL ONLY, AA 00000

NARISSA JIMENEZ-PETCHUMRUS
CPUC
EMAIL ONLY
EMAIL ONLY, CA 00000

NICK PAPPAS
NP ENERGY LLC
EMAIL ONLY
EMAIL ONLY, CA 00000

OREN WEINER
POWER RESOURCES MANAGER
SILICON VALLEY CLEAN ENERGY
EMAIL ONLY
EMAIL ONLY, CA 00000

PACIFICORP CALIFORNIA DOCKETS
EMAIL ONLY
EMAIL ONLY, CA 00000

PAULA WILLIAMS
GEXA ENERGY
EMAIL ONLY
EMAIL ONLY, CA 00000

POOJA KISHORE
PACIFICORP
EMAIL ONLY
EMAIL ONLY, OR 00000

RACHEL MCMAHON
CALIFORNIA ENERGY STORAGE ALLIANCE
EMAIL ONLY
EMAIL ONLY, CA 00000

RICK UMOFF
COUNSEL & SR. DIR - REGULATORY
SOLAR ENERGY INDUSTRIES ASSOCIATION
EMAIL ONLY
EMAIL ONLY, CA 00000

ROBIN ACHILLES
EXECUTIVE DIRECTOR
FRIENDS OF MINIDOKA
EMAIL ONLY
EMAIL ONLY, CA 00000

SALIL PRADHAN
EMAIL ONLY
EMAIL ONLY, CA 00000

SARAH WOCHOS
BORREGO SOLAR SYSTEMS, INC.
EMAIL ONLY
EMAIL ONLY, AA 00000

SCOTT MILLER
EXE. DIR
WESTERN POWER TRADING FORUM
ASSOCIATION
EMAIL ONLY
EMAIL ONLY, CA 00000

SCOTT MURTISHAW
DIR - POLICY
INDEPENDENT ENERGY PRODUCERS
EMAIL ONLY
EMAIL ONLY, CA 00000

SHAGUN TOUGAS
CERR, LLC
EMAIL ONLY
EMAIL ONLY, CA 00000

SHARON YANG
DIRECTOR OF LEGAL SERVICES
LIBERTY UTILITIES (WEST REGION)
EMAIL ONLY
EMAIL ONLY, AA 00000

SHAYNA LEVIA
PENINSULA CLEAN ENERGY
EMAIL ONLY
EMAIL ONLY, CA 00000

SILVIO FERRARI
AXIOM ADVISORS
EMAIL ONLY
EMAIL ONLY, CA 00000

SIOBHAN DOHERTY
ANALYST
PENINSULA CLEAN ENERGY
EMAIL ONLY
EMAIL ONLY, CA 00000

TYSON SIEGELE
PRINCIPAL CONSULTANT
CLEAN ENERGY STRATEGIES
EMAIL ONLY
EMAIL ONLY, AA 00000

UCS REGULATORY
UNION OF CONCERNED SCIENTISTS
EMAIL ONLY
EMAIL ONLY, AA 00000

WILLIAM EBERLE
VP, HEAD OF GOVERNMENT AFFAIRS
RWE RENEWABLES AMERICAS, LLC
ONSHORE, AMERICAS
EMAIL ONLY
EMAIL ONLY, AA 00000

MARIN CLEAN ENERGY
EMAIL ONLY
EMAIL ONLY, CA 00000

MRW & ASSOCIATES, LLC
EMAIL ONLY
EMAIL ONLY, CA 00000

OLIVINE, INC.
EMAIL ONLY
EMAIL ONLY, AA 00000

LIZ DELANEY
NEW LEAF ENERGY, INC.
55 TECHNOLOGY DRIVE, SUITE 102
LOWELL, MA 01851

CARRIE CULLEN HITT
SR. DIR - GRID & TRANSMISSION
VINEYARD OFFSHORE, LLC
200 CLARENDON STREET, 18TH FL.
BOSTON, MA 02116

RACHEL WILSON
SYNAPSE ENERGY ECONOMIS, INC.
485 MASSACHUSETTS AVE., 2ND FLOOR
CAMBRIDGE, MA 02129
FOR: THE UTILITY REFORM NETWORK

ROBERT FAGAN
SYNAPSE-ENERGY
485 MASSACHUSETTS AVENUE, SUITE 3
CAMBRIDGE, MA 02139
FOR: THE UTILITY REFORM NETWORK

IJESSE FARBSTAIN
CUSTOMIZED ENERGY SOLUTIONS
1528 WALNUT STREET, 22ND FL
PHILADELPHIA, PA 19102

SAMANTHA FOLSOM
CUSTOMIZED ENERGY SOLUTIONS
1528 WALNUT STREET, 22ND FLOOR
PHILADELPHIA, PA 19102

TESS MADARASZ
CUSTOMIZED ENERGY SOLUTIONS
1528 WALNUT ST, 22ND FLOOR
PHILADELPHIA, PA 19102

BARBARA TYRAN
DIR - EXTERNAL RELATIONS

JEANNA M. HARNDEN
ORRICK

NATIONAL HYDROPOWER ASSOCIATIONS, INC.
N.W.
200 MASSACHUSETTS AVE., STE. 320
WASHINGTON, DC 20001

COLUMBIA CENTER, 1152 15TH STREET,
WASHINGTON, DC 20001-1706

CATHLEEN COLBERT
SR. DIR - REGULATORY, WESTERN
VISTA CORPORATION
325 7TH STREET NW, SUITE 520
WASHINGTON, DC 20004

EMILIE OLSON
PRINCIPAL
ADVANCED ENERGY UNITED, INC.
1010 VERMONT AVE., NW, STE. 1050
WASHINGTON, DC 20005

EMILIE OLSON
PRINCIPAL
ADVANCED ENERGY ECONOMY
1000 VERMONT AVE., N.W., 3RD FL.
WASHINGTON, DC 20005

NOAH GARCIA
PRINCIPAL
ADVANCED ENERGY UNITED, INC.
1010 VERMONT AVE. NW, SUITE 1050
WASHINGTON, DC 20005

STEPHANIE DOYLE
SOLAR ENERGY INDUSTRIES ASSOCIATION
1425 K ST. N.W., SUITE 1000
WASHINGTON, DC 20005

BONNIE S. BLAIR
ATTORNEY AT LAW
THOMPSON COBURN LLP
1909 K STREET, N.W., SUITE 600
WASHINGTON, DC 20006
FOR: CITIES OF ANAHEIM, AZUSA,

BANNING,

COLTON, PASADENA, AND RIVERSIDE,
CALIFORNIA

REBECCA L. SHELTON
ATTORNEY
THOMPSON COBURN LLP
ACCESS
1909 K STREET, N.W., STE. 600
WASHINGTON, DC 20006
FOR: CITIES OF ANAHEIM, AZUSA, BANNING,
COLTON, PASADENA, AND RIVERSIDE,
CALIFORNIA

CHARLIE COGGESHALL
SR. ANALYST - WEST REGIONAL DIR
COALITION FOR COMMUNITY SOLAR
1380 MONROE ST., NW 721
WASHINGTON, DC 20010

CHRIS ZENTZ
ATTORNEY
STEPTOE & JOHNSON LLP
1330 CONNECTICUT AVE NW
WASHINGTON, DC 20036
FOR: SWAN LAKE NORTH HYDRO, LLC

FRED MORSE
PRESIDENT
MORSE ASSOCIATES, INC.
6904 RIDGEWOOD AVENUE
CHEVY CHASE, MD 20815

DINA FEDOSEEVA
MGR - WHOLESALE OPERS.
CONSTELLATION NEWENERGY, INC.
1310 POINT STREET, 11TH FL
BALTIMORE, MD 21231

BHAWRAMAETT BROEHM
ANALYST
WÄ,,RTSILÄ,, NORTH AMERICA, INC.
900 BESTAGE ROAD, STE. 300
ANNAPOLIS, MD 21401

BLAKE ELDER
EQ RESEARCH LLC
1155 KILDAIRE FARM ROAD, SUITE 203
CARY, NC 27511

PERRY SERVEDIO
GDS ASSOCIATES, INC.
1850 PARKWAY PLACE, SUITE 800
MARIETTA, GA 30067

ROB BERNTSEN
SVP / GENERAL COUNSEL
BHE RENEWABLES, LLC
4124 NW URBANDALE DRIVE
URBANDALE, IA 50322
FOR: BHE RENEWABLES, LLC

KRISTEN ELIASSEN
GALLATIN POWER PARTNERS
270 W KAGY BLVD., STE. E
BOZEMAN, MT 59715

NUO TANG
MIDDLE RIVER POWER, LLC
200 W MADISON ST STE 3810
CHICAGO, IL 60606

EILEEN HOWE
VP - DATA ANALYTICS
HECATE GRID LLC
621 W. RANDOLPH STREET
CHICAGO, IL 60661

HOLLY CHRISTIE
GENERAL COUNSEL
HECATE ENERGY LLC
621 W. RANDOLPH STREET
CHICAGO, IL 60661

JOEL YU
DIR - REGULATORY
ENCHANTED ROCK, LLC
1113 VINE STREET, STE. 101
HOUSTON, TX 77002
FOR: ENCHANGED ROCK, LLC

SAM HARPER
CONSULTANT
HARPER ADVISORY LLC
1401 LAKE PLAZA DR SUITE 200-107
SPRING, TX 77389

JORDAN PINJUV
PARTNER
WILKINSON BARKER KNAUER LLP
2138 W 32ND AVENUE, SUITE 300
DENVER, CO 80211

CAITLIN LIOTIRIS
PRINCIPAL
AFFAIRS
ENERGY STRATEGIES
111 E BROADWAY, STE. 1200
SALT LAKE CITY, UT 84111

NOAH LONG
DIR. - REGULATORY & LEGISLATIVE
EDF
200 WEST DE VARGAS ST.
SANTE FE, NM 87501

MONA TIERNEY-LLOYD
ENEL X NORTH AMERICA, INC.
2071 ALTAIR LANE
RENO, NV 89521

ANTHONY J. WALSH
DEPUTY ATTORNEY GENERAL
OFFICE OF THE ATTORNEY GENERAL
100 N. CARSON STREET
CARSON CITY, NV 89701

MARLON O. SANTA CRUZ
L.A. DEPT OF WATER AND POWER
POWER
111 NORTH HOPE STREET, ROOM 1150
LOS ANGELES, CA 90012

MICHELLE TOVAR-MORA
LOS ANGELES DEPARTMENT OF WATER &
POWER
111 NORTH HOPE STREET, ROOM 1150
LOS ANGELES, CA 90012

RICK SOUHAID
LOS ANGELES DEPARTMENT OF WATER & POWER
111 NORTH HOPE STREET, ROOM 1150
LOS ANGELES, CA 90012

CORINNE SIERZANT
CASE MGR - REGULATORY
SOUTHERN CALIFORNIA GAS COMPANY
555 W. 5TH STREET, GT14D6
LOS ANGELES, CA 90013

EDMUND DALE
CALIF PUBLIC UTILITIES COMMISSION
ELECTRIC PLANNING AND MARKET DESIGN BRAN
320 West 4th Street Suite 500
Los Angeles, CA 90013

PAUL DEANG
CUSTOMER PROGRAM
SOUTHERN CALIFORNIA GAS COMPANY
555 W. 5TH STREET GT14D6
LOS ANGELES, CA 90013

RADU CIUPAGEA
CALIF PUBLIC UTILITIES COMMISSION
ELECTRICITY PLANNING & POLICY BRANCH
320 West 4th Street Suite 500
Los Angeles, CA 90013

SARAH GOLDMUNTZ
CALIF PUBLIC UTILITIES COMMISSION
CEQA AND FERC BRANCH
320 West 4th Street Suite 500
Los Angeles, CA 90013

BEN GUSTAFSON
REGULATORY ANALYST II
CLEAN POWER ALLIANCE OF SOUTHERN CA
CALIF
801 S. GRAND AVE. SUITE 400
LOS ANGELES, CA 90017

FRANCIS CHOI
ASSISTANT GENERAL COUNSEL
CLEAN POWER ALLIANCE OF SOUTHERN
801 S. GRAND AVE., SUITE 400
LOS ANGELES, CA 90017

JOHN MCNAMARA
DIRECTOR, STRUCTURED CONTRACTS
CLEAN POWER ALLIANCE
801 S. GRAND AVE., STE. 400
LOS ANGELES, CA 90017

JOSEPH CLAY
RESOURCE PLANNER, POWER SUPPLY
CLEAN POWER ALLIANCE
801 S. GRAND AVE., STE. 400
LOS ANGELES, CA 90017

LINDSAY DESCAGNIA
VICE PRESIDENT, POWER SUPPLY
CLEAN POWER ALLIANCE
801 S. GRAND AVE., STE. 400
LOS ANGELES, CA 90017

MATTHEW LANGER
CHIEF OPERATING OFFICER
CLEAN POWER ALLIANCE
801 S GRAND AVE, SUITE 400
LOS ANGELES, CA 90017

NORMAN A. PEDERSEN
ATTORNEY AT LAW
HANNA AND MORTON LLP
444 SOUTH FLOWER ST., SUITE 2530
LOS ANGELES, CA 90071-2916

STEVE LOWE
CHIEF EXECUTIVE OFFICER
EAGLE CREST ENERGY COMPANY
3000 OCEAN PARK BLVD., SUITE 1020
SANTA MONICA, CA 90405

FRED G. YANNEY, ESQ.
ATTORNEY
YANNEY LAW OFFICE
17409 MARQUARDT AVE. STE. C-4
CERRITOS, CA 90703

LORRAINE PASKETT
VP - EXTERNAL AFFAIRS CALIF.
THE AES CORPORATION
690 N STUDEBAKER ROAD
LONG BEACH, CA 90803

LLC

MARK MILLER
AES SOUTHLAND DEVELOPMENT
690 NORTH STUDEBAKER ROAD
LONG BEACH, CA 90803
200
FOR: AES NORTH AMERICA DEVELOPMENT, LLC

POWER

DANIEL W. DOUGLASS
ATTORNEY
DOUGLASS, LIDDELL & KLATT
5737 KANAN ROAD, STE. 610
AGOURA HILLS, CA 91301-1601

WATER

CASE ADMINISTRATION
SOUTHERN CALIFORNIA EDISON COMPANY
8631 RUSH STREET
ROSEMEAD, CA 91770

JENIFER HEDRICK
SR. ADVISOR
SOUTHERN CALIFORNIA EDISON COMPANY
8631 RUSH STREET â€" GO 4
ROSEMEAD, CA 91770

PAUL KLAPKA
SR. ADVISOR
SOUTHERN CALIFORNIA EDISON COMPANY
8631 RUSH STREET â€" GO 4
ROSEMEAD, CA 91770

JOSEPH MITCHELL
M-BAR TECHNOLOGIES AND CONSULTING LLC
19412 KIMBALL VALLEY RD
RAMONA, CA 92065

TIMOTHY LYONS
ATTORNEY
BEST BEST & KRIEGER LLP
655 WEST BROADWAY, 15TH FLOOR
SAN DIEGO, CA 92101

KEITH OLIVER

FOR: AES NORTH AMERICA DEVELOPMENT,

ERIC R. KLINKNER
DEPUTY GENERAL MGR.
CITY OF PASADENA
150 SOUTH LOS ROBLES AVE., SUITE

PASADENA, CA 91101
FOR: CITY OF PASADENA - WATER &

RICHARD TORRES
ASSIST. DIR - UTILITIES
CITY OF AZUSA
729 N. AZUSA AVENUE
AZUSA, CA 91702
FOR: CITY OF AZUSA, AZUSA LIGHT &

DHAVAL DAGLI
SOUTHERN CALIFORNIA EDISON COMPANY
8631 RUSH ST.
ROSEMEAD, CA 91770

KATHY WONG
SR. ADVISOR
SOUTHERN CALIFORNIA EDISON COMPANY
8631 RUSH STREET
ROSEMEAD, CA 91770

PAUL SUNG
ATTORNEY
SOUTHERN CALIFORNIA EDISON COMPANY
2244 WALNUT GROVE AVE.
ROSEMEAD, CA 91770

MEGHAN O'BRIEN
STOEL RIVES LLP
501 WEST BROADWAY, SUITE 2000
SAN DIEGO, CA 92101

TY TOSDAL
ATTORNEY
TOSDAL APC
845 15TH STREET, STE. 103
SAN DIEGO, CA 92101

HILLARY HEBERT

MERRIMACK ENERGY GROUP, INC.
3957 30TH ST. NO.522
SAN DIEGO, CA 92104

HMH ENERGY
3714 OLEANDER DR
SAN DIEGO, CA 92106

STEPHEN GUNTHER
SR REGULATORY ANALYST
SAN DIEGO COMMUNITY POWER
FOUNDATION
815 E STREET, SUITE 12716
SAN DIEGO, CA 92112

ANDREA WHITE
STAFF ATTORNEY
THE PROTECT OUR COMMUNITIES
4452 PARK BLVD, STE. 309
SAN DIEGO, CA 92116

CHRISTA LIM
MGR - REGULATORY
SHELL ENERGY SOLUTIONS
4445 EASTGATE MALL, STE. 100
SAN DIEGO, CA 92121
FOR: SHELL ENERGY SOLUTIONS DBA SHELL
ENERGY NORTH AMERICA (US), L.P.

ZACKARY HUGHES
CASE ADMIN - REGULATORY
SAN DIEGO GAS & ELECTRIC COMPANY
8330 CENTURY PARK COURT, CP32F
SAN DIEGO, CA 92123

CENTRAL FILES
SAN DIEGO GAS & ELECTRIC COMPANY
8330 CENTURY PARK CT, CP31-E
SAN DIEGO, CA 92123-1530

SHEWIT WOLDEGIORGIS
MGR - REGULATORY
SAN DIEGO GAS & ELECTRIC COMPANY
8330 CENTURY PARK CT., CP32F
SAN DIEGO, CA 92123-1530

TYLER KIRCHHOFF
REGULATORY CASE MGR
SAN DIEGO GAS & ELECTRIC
8330 CENTURY PARK CT., CP32F
SAN DIEGO, CA 92123-1530

VIRINDER SINGH
VP, REGULATORY & LEGIS. AFFAIRS
EDF RENEWABLES, INC.
15445 INNOVATION DRIVE
SAN DIEGO, CA 92128
FOR: EDF RENEWABLES, INC.

BRIAN MCCALL
LATHAM & WATKINS LLP
12670 HIGH BLUFF DRIVE
SAN DIEGO, CA 92130

JENNIFER K. ROY
ATTORNEY
LATHAM & WATKINS LLP
12670 HIGH BLUFF DRIVE
SAN DIEGO, CA 92130

TOM MILLER
DIR - ELECTRIC UTILITY
CITY OF BANNING
176 E. LINCOLN
BANNING, CA 92220
FOR: CITY OF BANNING

DAVID FREEDMAN
DESERT COMMUNITY ENERGY
74-199 EL PASEO, SUITE 100
PALM DESERT, CA 92260

JULIE ROBERTS
BEAR VALLEY ELECTRIC SERVICE
42020 GARSTIN DRIVE, PO BOX 1547
BIG BEAR LAKE, CA 92315

SEAN MATLOCK
MGR - ENERGY RDESOURCES
BEAR VALLEY ELECTRIC SERVICE
42020 GARSTIN DRIVE, PO BOX 1547
BIG BEAR LAKE, CA 92315

SCOTT HARDING
ASSIST DIR - UTILITY OP
CITY OF COLTON
650 N. LA CADENA BLVD
COLTON, CA 92324
FOR: CITY OF COLTON

CINDI COHEN
CITY OF RIVERSIDE
3435 14TH STREET
RIVERSIDE, CA 92501
FOR: CITY OF RIVERSIDE - PUBLIC
UTILITIES

ROY XU
CITY OF RIVERSIDE
3435 14TH STREET
RIVERSIDE, CA 92501
FOR: CITY OF RIVERSIDE - PUBLIC
UTILITIES

IAN KEARNEY
DIR - REGULATORY
GOLDEN STATE CLEAN ENERGY, LLC
3857 BIRCH ST. SUITE 441
NEWPORT BEACH, CA 92660

CARRIE THOMPSON
CITY OF ANAHEIM
201 S. ANAHEIM BLVD., STE. 802
ANAHEIM, CA 92805

NICOLAS T. BURKI
CITY OF ANAHEIM
201 SOUTH ANAHEIM BLVD., SUITE 802
ANAHEIM, CA 92805

WILLIAM ZOBEL
EXECUTIVE DIRECTOR
CALIFORNIA HYDROGEN BUSINESS COUNCIL
18847 VIA SERENO
YORBA LINDA, CA 92866
FOR: CALIFORNIA HYDROGEN BUSINESS
COUNCIL (CHBC)

CATHY DEFALCO
GENERAL MGR.
CALIFORNIA CHOICE ENERGY AUTHORITY
44933 FERN AVENUE
LANCASTER, CA 93534

AARON BURDICK
ENERGY & ENVIRONMENTAL ECONOMICS
44 MONTGOMERY STREET STE 1500
SAN FRANCISCO, CA 94044

EMILY LESLIE
ENERGY REFLECTIONS
1028 MONTE VERDE DR
PACIFICA, CA 94044

DOUG KARPA
SR ANALYST - REGULATORY
AFFAIRS
PENINSULA CLEAN ENERGY
2075 WOODSIDE ROAD
REDWOOD CITY, CA 94061

JOSEPH F. WIEDMAN
DIR - REGULATORY & LEGISLATIVE
PENINSULA CLEAN ENERGY AUTHORITY
2075 WOODSIDE ROAD
REDWOOD CITY, CA 94061

REGULATORY COMPLIANCE DEPT
PENINSULA CLEAN ENERGY
2075 WOODSIDE ROAD
REDWOOD CITY, CA 94061

SARA MAATTA
PENINSULA CLEAN ENERGY
2075 WOODSIDE RD
REDWOOD CITY, CA 94061

ANDREW J. GRAF
ASSOCIATE ATTORNEY
ADAMS BROADWELL JOSEPH & CARDOZO
601 GATEWAY BOULEVARD, SUITE 1000

MARC D. JOSEPH
ATTORNEY
ADAMS BROADWELL JOSEPH & CARDOZO
601 GATEWAY BLVD., SUITE 1000

SOUTH SAN FRANCISCO, CA 94080

MAREN WENZEL
SR. MGR - POLICY & REGULATORY
SILICON VALLEY CLEAN ENERGY
333 W. EL CAMINO REAL, STE. 330
SUNNYVALE, CA 94087

SVCE REGULATORY
SILICON VALLEY CLEAN ENERGY
333 W EL CAMINO REAL SUITE 330
COMMISSION
SUNNYVALE, CA 94087

AMAANI HAMID
MARKET DEVELOPMENT MANAGER
LEAPFROG POWER, INC.
25 TAYLOR STREET
SAN FRANCISCO, CA 94102

BARBARA LAU
UTILITY SPECIALIST, POWER
SF PUBLIC UTILITIES COMMISSION
525 GOLDEN GATE AVENUE, 9TH FLOOR
SAN FRANCISCO, CA 94102

EDITH MORENO
REGULATORY AFFAIRS
SOUTHERN CALIFORNIA GAS COMPANY
601 VAN NESS AVENUE SUITE 2090
SAN FRANCISCO, CA 94102

FIRAS ABU-SNENEH
SF PUBLIC UTILITIES COMMISSION
525 GOLDEN GATE AVE
SAN FRANCISCO, CA 94102

JUSTIN CHAU
SF PUBLIC UTILITIES COMMISSION
525 GOLDEN GATE AVE, 7TH FLR
SAN FRANCISCO, CA 94102

MICHAEL HYAMS
DIRECTOR
CLEANPOWERSF
525 GOLDEN GATE AVE., 7TH FL
SAN FRANCISCO, CA 94102

SOUTH SAN FRANCISCO, CA 94080

MONICA PADILLA
SILICON VALLEY CLEAN ENERGY (SVCE)
333 W. EL CAMINO REAL, SUITE 330
SUNNYVALE, CA 94087

ALYSSA KRAG-ARNOLD
SPECIALIST - REGULATORY
SAN FRANCISCO PUBLIC UTILITIES
525 GOLDEN GATE AVENUE, 7TH FL.
SAN FRANCISCO, CA 94102

BARBARA HALE
ASSISTANT GENERAL MANAGER, POWER
SAN FRANCISCO PUC
525 GOLDEN GATE AVE, 13TH FLOOR
SAN FRANCISCO, CA 94102

CHERYL TAYLOR
CLEANPOWERSF OPERATIONS MANAGER
SF PUBLIC UTILITIES COMMISSION
525 GOLDEN GATE AVENUE, 7TH FLR
SAN FRANCISCO, CA 94102

ELLISON FOLK
ATTORNEY
SHUTE, MIHALY & WEINBERGER LLP
396 HAYES STREET
SAN FRANCISCO, CA 94102

JASLEEN PANNU
SFPUC " CLEANPOWERSF
544 GOLDEN GATE AVENUE
SAN FRANCISCO, CA 94102

KIARA HERMANN
UTILITY ANALYST
CLEANPOWER SF
525 GOLDEN GATE AVE., 7TH FL.
SAN FRANCISCO, CA 94102

ORRAN BALAGOPALAN
SHUTE MIHALY & WEINBERGER LLP
396 HAYES STREET
SAN FRANCISCO, CA 94102

ALEX MANHEIMER
CALIF PUBLIC UTILITIES COMMISSION
ELECTRIC PLANNING AND MARKET DESIGN BRAN
AREA
505 VAN NESS AVENUE
SAN FRANCISCO, CA 94102-3214

ALIREZA ESHRAGHI
CALIF PUBLIC UTILITIES COMMISSION
COMMUNICATIONS DIVISION
AREA
505 VAN NESS AVENUE
SAN FRANCISCO, CA 94102-3214

AMANDA SINGH
CALIF PUBLIC UTILITIES COMMISSION
EXECUTIVE DIVISION
AREA
505 VAN NESS AVENUE
SAN FRANCISCO, CA 94102-3214

AMIN YOUNES
CALIF PUBLIC UTILITIES COMMISSION
ENERGY INFRASTRUCTURE BRANCH
AREA
505 VAN NESS AVENUE
SAN FRANCISCO, CA 94102-3214

ANAND DURVASULA
CALIF PUBLIC UTILITIES COMMISSION
LEGAL DIVISION
ROOM 5130
505 VAN NESS AVENUE
SAN FRANCISCO, CA 94102-3214

BRANDON T. GERSTLE
CALIF PUBLIC UTILITIES COMMISSION
ENERGY EFFICIENCY BRANCH
ROOM 5-29
505 VAN NESS AVENUE
SAN FRANCISCO, CA 94102-3214

CHERYL LEE
CALIF PUBLIC UTILITIES COMMISSION
CLIMATE INITIATIVES, RENEWABLES, AND ADM
BRANCH
AREA 4-A
505 VAN NESS AVENUE
SAN FRANCISCO, CA 94102-3214

CHRISTIAN LAMBERT
CALIF PUBLIC UTILITIES COMMISSION
ELECTRICITY PLANNING & POLICY
AREA
505 VAN NESS AVENUE
SAN FRANCISCO, CA 94102-3214

DAVID FERMINO
CALIF PUBLIC UTILITIES COMMISSION
LEGAL DIVISION
BRAN
AREA
505 VAN NESS AVENUE
SAN FRANCISCO, CA 94102-3214

DAVID MILLER
CALIF PUBLIC UTILITIES COMMISSION
ELECTRIC PLANNING AND MARKET DESIGN
AREA
505 VAN NESS AVENUE
SAN FRANCISCO, CA 94102-3214

EMILY CLAYTON
CALIF PUBLIC UTILITIES COMMISSION
ENERGY EFFICIENCY BRANCH
BRAN
AREA
505 VAN NESS AVENUE
SAN FRANCISCO, CA 94102-3214

ERIC DUPRE
CALIF PUBLIC UTILITIES COMMISSION
ELECTRIC PLANNING AND MARKET DESIGN
AREA 4-A
505 VAN NESS AVENUE
SAN FRANCISCO, CA 94102-3214

HELENA OH
CALIF PUBLIC UTILITIES COMMISSION
ELECTRICITY PLANNING & POLICY BRANCH
AREA

JULIE A. FITCH
CALIF PUBLIC UTILITIES COMMISSION
ADMINISTRATIVE LAW JUDGE DIVISION
AREA

505 VAN NESS AVENUE
SAN FRANCISCO, CA 94102-3214

JULIE HALLIGAN
CALIF PUBLIC UTILITIES COMMISSION
ELECTRICITY PLANNING & POLICY BRANCH
BRANCH
ROOM 5041
505 VAN NESS AVENUE
SAN FRANCISCO, CA 94102-3214

KARIN M. HIETA
CALIF PUBLIC UTILITIES COMMISSION
ELECTRICITY PLANNING & POLICY BRANCH
ROOM 5010
505 VAN NESS AVENUE
SAN FRANCISCO, CA 94102-3214

KYLE NAVIS
CALIF PUBLIC UTILITIES COMMISSION
ELECTRICITY PLANNING & POLICY BRANCH
BRANCH
AREA
505 VAN NESS AVENUE
SAN FRANCISCO, CA 94102-3214

LEUWAM TESFAI
CALIF PUBLIC UTILITIES COMMISSION
EXECUTIVE DIVISION
BRANCH
ROOM 5137
505 VAN NESS AVENUE
SAN FRANCISCO, CA 94102-3214

MERIDETH STERKEL
CALIF PUBLIC UTILITIES COMMISSION
ELECTRIC PLANNING AND MARKET DESIGN BRANCH
ROOM 4008
505 VAN NESS AVENUE
SAN FRANCISCO, CA 94102-3214

NATHAN BARCIC
CALIF PUBLIC UTILITIES COMMISSION
ELECTRIC PLANNING AND MARKET DESIGN BRANCH
BRANCH
AREA
505 VAN NESS AVENUE
SAN FRANCISCO, CA 94102-3214

NICK DAHLBERG

505 VAN NESS AVENUE
SAN FRANCISCO, CA 94102-3214

KAJ PETERSON
CALIF PUBLIC UTILITIES COMMISSION
ELECTRICITY PLANNING & POLICY
AREA
505 VAN NESS AVENUE
SAN FRANCISCO, CA 94102-3214

KAROLINA MASLANKA
CALIF PUBLIC UTILITIES COMMISSION
PRESIDENT ALICE REYNOLDS
AREA
505 VAN NESS AVENUE
SAN FRANCISCO, CA 94102-3214

LAUREN REISER
CALIF PUBLIC UTILITIES COMMISSION
ELECTRIC PLANNING AND MARKET DESIGN
AREA
505 VAN NESS AVENUE
SAN FRANCISCO, CA 94102-3214

MEA HALPERIN
CALIF PUBLIC UTILITIES COMMISSION
ELECTRICITY PLANNING & POLICY
AREA
505 VAN NESS AVENUE
SAN FRANCISCO, CA 94102-3214

MICHELAINA JOHNSON
CALIF PUBLIC UTILITIES COMMISSION
ENERGY INFRASTRUCTURE BRANCH
AREA
505 VAN NESS AVENUE
SAN FRANCISCO, CA 94102-3214

NEIL RAFFAN
CALIF PUBLIC UTILITIES COMMISSION
ELECTRIC PLANNING AND MARKET DESIGN
AREA
505 VAN NESS AVENUE
SAN FRANCISCO, CA 94102-3214

PATRICK L. YOUNG

CALIF PUBLIC UTILITIES COMMISSION
PRESIDENT ALICE REYNOLDS
BRAN
AREA
505 VAN NESS AVENUE
SAN FRANCISCO, CA 94102-3214

CALIF PUBLIC UTILITIES COMMISSION
ELECTRIC PLANNING AND MARKET DESIGN
AREA 4-A
505 VAN NESS AVENUE
SAN FRANCISCO, CA 94102-3214

PAUL DOUGLAS
CALIF PUBLIC UTILITIES COMMISSION
ENERGY EFFICIENCY BRANCH
BRANCH
AREA 4-A
505 VAN NESS AVENUE
SAN FRANCISCO, CA 94102-3214

PAUL WORHACH
CALIF PUBLIC UTILITIES COMMISSION
ELECTRICITY PLANNING & POLICY
AREA
505 VAN NESS AVENUE
SAN FRANCISCO, CA 94102-3214

RYAN SARAIE
CALIF PUBLIC UTILITIES COMMISSION
ELECTRICITY PLANNING & POLICY BRANCH
AREA
505 VAN NESS AVENUE
SAN FRANCISCO, CA 94102-3214

SANDY GOLDBERG
CALIF PUBLIC UTILITIES COMMISSION
COMMISSIONER DOUGLAS
ROOM 5202
505 VAN NESS AVENUE
SAN FRANCISCO, CA 94102-3214

SOPHIE BABKA
CALIF PUBLIC UTILITIES COMMISSION
ELECTRIC PLANNING AND MARKET DESIGN BRAN
PROGRAM
AREA
505 VAN NESS AVENUE
SAN FRANCISCO, CA 94102-3214

STEPHEN CASTELLO
CALIF PUBLIC UTILITIES COMMISSION
ELECTRICITY PRICING AND CUSTOMER
AREA
505 VAN NESS AVENUE
SAN FRANCISCO, CA 94102-3214

SUZANNE CASAZZA
CALIF PUBLIC UTILITIES COMMISSION
COMMISSIONER JOHN REYNOLDS
AREA
505 VAN NESS AVENUE
SAN FRANCISCO, CA 94102-3214

THERESA BUCKLEY
CALIF PUBLIC UTILITIES COMMISSION
LEGAL DIVISION
ROOM 5139
505 VAN NESS AVENUE
SAN FRANCISCO, CA 94102-3214

THOMAS GUTIERREZ
CALIF PUBLIC UTILITIES COMMISSION
ADMINISTRATIVE LAW JUDGE DIVISION
AREA
505 VAN NESS AVENUE
SAN FRANCISCO, CA 94102-3214

WENLI WEI
CALIF PUBLIC UTILITIES COMMISSION
CEQA AND FERC BRANCH
AREA
505 VAN NESS AVENUE
SAN FRANCISCO, CA 94102-3214

XIAN "CINDY" LI
CALIF PUBLIC UTILITIES COMMISSION
ELECTRICITY PRICING AND CUSTOMER PROGRAM
ROOM 4104
505 VAN NESS AVENUE
SAN FRANCISCO, CA 94102-3214

EDDIE H. AHN
EXE. DIR.
BRIGHTLINE DEFENSE PROJECT
1028A HOWARD STREET
SAN FRANCISCO, CA 94103

JEFF RILES
DIR - ENERGY MARKETS
MICROSOFT CORPORATION
1355 MARKET STREET, SUITE 300
SAN FRANCISCO, CA 94103

SARAH XU
SR. POLICY ASSOC.
BRIGHTLINE DEFENSE PROJECT
1028A HOWARD STREET
SAN FRANCISCO, CA 94103

ALEX JACKSON
SENIOR ATTORNEY
NATURAL RESOURCES DEFENSE COUNCIL
111 SUTTER STREET, 20TH FLOOR
SAN FRANCISCO, CA 94104

ANDREW BALL
ATTORNEY
KEYES & FOX LLP
580 CALIFORNIA STREET, 12TH FLOOR
SAN FRANCISCO, CA 94104

ANN SPRINGGATE
KEYES & FOX LLP
580 CALIFORNIA STREET, 12TH FLOOR
SAN FRANCISCO, CA 94104

JULIA DE LAMARE
ADVOCATE - BLDG DECARBONIZATION
NATURAL RESOURCES DEFENSE COUNCIL
111 SUTTER ST., 21ST FL.
SAN FRANCISCO, CA 94104

LAUREN C. FREEMAN
SIDLEY AUSTIN LLP
555 CALIFORNIA STREET, STE. 2000
SAN FRANCISCO, CA 94104
FOR: VINEYARD OFFSHORE, LLC

OLUWAFEMI SAWYERR
ENERGY AND ENVIRONMENTAL ECONOMICS
44 MONTGOMERY STREET, SUITE 1500
SAN FRANCISCO, CA 94104

ALEXANDER C. DAVIS
ATTORNEY AT LAW
BUCHALTER, A PROFESSIONAL CORPORATION
CORPORATION
425 MARKET STREET, 29TH FLOOR
SAN FRANCISCO, CA 94105

CHRISTOPHER G. PARKER
ATTORNEY
BUCHALTER, A PROFESSIONAL
CORPORATION
425 MARKET STREET, SUITE 2900
SAN FRANCISCO, CA 94105

MICHAEL CADE
ANALYST
BUCHALTER, A PROFESSIONAL CORPORATION
55 SECOND STREET, SUITE 1700
SAN FRANCISCO, CA 94105

MICHAEL COLVIN
DIR - REGULATORY
ENVIRONMENTAL DEFENSE FUND
123 MISSION ST, 28TH FL.
SAN FRANCISCO, CA 94105

SAMIR A. HAFEZ, ESQ.
ATTORNEY
BUCHALTER, A PROFESSIONAL CORPORATION
425 MARKET STREET, 29TH FLOOR
SAN FRANCISCO, CA 94105-2491

MONICA MOLINA
ORRICK
THE ORRICK BUILDING
405 HOWARD STREET
SAN FRANCISCO, CA 94105-2669

PATRICK FERGUSON
ORRICK, HERRINGTON & SUTCLIFFE, LLP
405 HOWARD STREET
SAN FRANCISCO, CA 94105-2669

TAHIYA SULTAN
ORRICK, HERRINGTON & SUTCLIFFE, LLP
405 HOWARD STREET
SAN FRANCISCO, CA 94105-2669

SARAH QURESHI
SENIOR DIRECTOR, REGULATORY AFFAIRS
NEXTERA ENERGY RESOURCES, LLC
ONE CALIFORNIA ST., SUITE 1600
SAN FRANCISCO, CA 94108

ALONA SIAS
DIR
HORIZON WEST TRANSMISSION, LLC
ONE CALIFORNIA STREET, STE. 1600
SAN FRANCISCO, CA 94111

BUCK ENDENMANN
K & L GATES LLP
FOUR EMBARCADERO, SUITE 1200
SAN FRANCISCO, CA 94111

DAVID SIDDIQUI
ORACLE / OPOWER
475 SANSOME ST 11TH FLOOR
SAN FRANCISCO, CA 94111

ICHASITY HENDREN
DAVIS WRIGHT TREMAINE LLP
50 CALIFORNIA STREET, 23RD FLOOR
SAN FRANCISCO, CA 94111

JOSEPH GRIFFIN
EARTHJUSTICE
50 CALIFORNIA STREET, SUITE 500
SN FRANCISCO, CA 94111

LILLY MCKENNA
ATTORNEY
STOEL RIVES LLP
THREE EMBARCADERO CENTER, STUITE 1120
SAN FRANCISCO, CA 94111

NINA ROBERTSON
STAFF ATTORNEY
EARTHJUSTICE
50 CALIFORNIA STREET, STE. 500
SAN FRANCISCO, CA 94111
FOR: SIERRA CLUB

NIRVESH SIKAND
GOODIN, MACBRIDE, SQUERI AND DAY,LLP
505 SANSOME STREET, SUITE 900
LLP
SAN FRANCISCO, CA 94111

THOMAS W. SOLOMON
ATTORNEY AT LAW
SHEPPARD MULLIN RICHTER & HAMPTON
FOUR EMBARCADERO CENTER, 17TH FLOOR
SAN FRANCISCO, CA 94111

DAVIS WRIGHT TREMAINE LLP
50 CALIFORNIA STREET, 23RD FLR
SAN FRANCISCO, CA 94111

IGOR TREGUB
STRATEGIC DIR / POLICY ADVISOR
REIMAGINE POWER
77 SALA TERRACE
SAN FRANCISCO, CA 94112

SARA STECK MYERS
ATTORNEY AT LAW
122 - 28TH AVENUE
SAN FRANCISCO, CA 94121
FOR: ENEL NORTH AMERICA, INC.

SARA STECK MYERS
ATTORNEY AT LAW
122 28TH AVENUE
SAN FRANCISCO, CA 94121
FOR: ON BEHALF OF CPOWER

JIN NOH
PRINCIPAL
DECODE ENERGY, LLC
622 10TH AVENUE
SAN MATEO, CA 94402

AGGREGATE FILING
AFP TRACKS
950 TOWER LANE
FOSTER, CA 94404

RACHEL BIRD

PUSHKAR WAGLE

RACHEL BIRD STRATEGIES, INC.
1223 PARU STREET
ALAMEDA, CA 94501

MANAGING CONSULTANT
FLYNN RESOURCE CONSULTANTS INC.
5440 EDGEVIEW DRIVE
DISCOVERY BAY, CA 94505

BETH VAUGHAN
EXE. DIR.
CALIFORNIA COMMUNITY CHOICE ASSOCIATION
2300 CLAYTON ROAD, STE. 1150
CONCORD, CA 94520

GREG LAMBERG
PETERSON POWER SYSTEMS, INC.
2828 TEAGARDEN STREET
SAN LEANDRO, CA 94577

RENAE STEICHEN
DIR - REGULATORY
REV RENEWABLES, LLC
5000 HOPYARD ROAD, STE. 480
PLEASANTON, CA 94588

RENAE STEICHEN
DIR - REGULATORY AFFAIRS
LS POWER DEVELOPMENT, LLC
5000 HOPYARD RD, SUITE 480
PLEASANTON, CA 94588
FOR: LS POWER DEVELOPMENT, LLC

KATE KELLY
DEFENDERS OF WILDLIFE
PO BOX 4311
VALLEJO, CA 94590

BENJAMIN BODELL
ATTORNEY
BEST BEST AND KRIEGER LLP
2001 N MAIN ST., STE. 390
WALNUT CREEK, CA 94596

KELLY LOTZ
PARALEGAL
BEST BEST & KRIEGER LLP
2001 NORTH MAIN STREET, SUITE 390
WALNUT CREEK, CA 94596

MATTHEW BARMACK
DIR - MKT & REGULATORY
CALPINE CORPORATION
3003 OAK ROAD, STE. 400
WALNUT CREEK, CA 94597

ADENIKE ADEYEYE
MGR / SR. ANALYST
CA.
UNION OF CONCERNED SCIENTISTS
500 12TH STREET, STE. 340
OAKLAND, CA 94607

CINDY TAN
THE REGENTS OF THE UNIVERSITY OF

1111 FRANKLIN STREET, 7TH FL
OAKLAND, CA 94607

CLARK MCISAAC
DIRECTOR OF POLICY & STRATEGY
CALIF EFFICIENCY DEMAND MGMNT COUNCIL
1111 BROADWAY, SUITE 300
OAKLAND, CA 94607

LUKE TOUGAS
CONSULTANT
CLEAN ENERGY REGULATORY RESEARCH
1111 BROADWAY, STE. 300
OAKLAND, CA 94607

MARGARET MILLER
DIR - GOVERNMENT AND REGULATORY
ENGIE NORTH AMERICA INC.
500 12TH ST SUITE 300
OAKLAND, CA 94607

MATTHEW KOZUCH
THE REGENTS OF THE UNIVERSITY OF CA
1111 FRANKLIN STREET, 7TH FLOOR
OAKLAND, CA 94607

NICHOLAS SHER
MANAGING DIR
MANAGER
GREENGENSTORAGE, LLC
4421 WEBSTER STREET
OAKLAND, CA 94609
FOR: GREENGEN STORAGE, LLC

BEN SERRURIER
GOVERNMENT AFFAIRS AND POLICY

FERVO ENERGY
1999 HARRISON ST., SUITE 1800
OAKLAND, CA 94612

BRIAN KOOIMAN
ANALYST
OHM CONNECT, INC.
610 16TH STREET, SUITE M20
OAKLAND, CA 94612

DWIGHT OCKERT
REGULATORY
PACIFIC GAS AND ELECTRIC COMPANY
300 LAKESIDE DRIVE
OAKLAND, CA 94612

ED SMELOFF
SR DIR - GRID INTEGRATION
VOTE SOLAR
360 22ND STREET, SUITE 730
OAKLAND, CA 94612

ELYSIA VANNOY
MGR - REGULATORY
OHMCONNECT, INC.
2201 BROADWAY, SUITE 702
OAKLAND, CA 94612

GREG RYBKA
PACIFIC GAS AND ELECTRIC COMPANY
300 LAKESIDE DRIVE
OAKLAND, CA 94612

IGOR GRINBERG
CASE MGR - REGULATORY
PACIFIC GAS AND ELECTRIC COMPANY
300 LAKESIDE DRIVE
OAKLAND, CA 94612

LEAH BAHRAMIPOUR
LEGAL ASSIST.
SIERRA CLUB
2101 WEBSTER ST, SUITE 1300
OAKLAND, CA 94612

MAGGIE ALEXANDER
PACIFIC GAS AND ELECTRIC COMPANY
300 LAKESIDE DRIVE
OAKLAND, CA 94612

NIHAL SHRINATH
ASSOCIATE ATTORNEY
PROCUREMENT
SIERRA CLUB
2101 WEBSTER STREET, SUITE 1300
OAKLAND, CA 94612

RHETT KIKUYAMA
PORTFOLIO MGT - POLICY &

PACIFIC GAS AND ELECTRIC COMPANY
300 LAKESIDE DRIVE
OAKLAND, CA 94612

SEAN P. BEATTY
PARTNER
BRB LAW LLP
PO BOX 70527
OAKLAND, CA 94612

STEVE CAMPBELL
REGULATORY DIRECTOR, WEST
VOTE SOLAR
360 22ND ST SUITE 730
OAKLAND, CA 94612

TODD EDMISTER
SR DIR-REGULATORY & DEPUTY GEN. COUNSEL
AVA COMMUNITY ENERGY
1999 HARRISON STREET, STE. 2300
OAKLAND, CA 94612

TYSON R. SMITH, ESQ.
PACIFIC GAS AND ELECTRIC COMPANY
300 LAKESIDE DRIVE
OAKLAND, CA 94612

FOR: (FORMERLY) EAST BAY COMMUNITY
EMERGY

ALEX HERSCH
COMMERCIAL ENERGY OF MONTANA
7767 OAKPORT ST. SUITE 525
OAKLAND, CA 94621
FOR: COMMERCIAL ENERGY OF MONTANA, INC.
DBA COMMERCIAL ENERGY OF CALIFORNIA

IZOE HARROLD
GREEN POWER INSTITUTE
2039 SHATTUCK AVE., STE. 402
BERKELEY, CA 94704

SOPHIE MEYER
POLICY ADVISOR
FORM ENERGY, INC.
ENVIRONMENT
2810 SEVENTH ST
BERKELEY, CA 94710

SHANA LAZEROW
ATTORNEY / LEGAL DIR.
COMMUNITIES FOR A BETTER ENVIRONMENT
340 MARINA WAY
RICHMOND, CA 94801
COUNSEL
FOR: CALIFORNIA ENVIRONMENTAL JUSTICE
ALLIANCE

MIKE CALLAHAN
SENIOR POLICY COUNSEL
MARIN CLEAN ENERGY
1125 TAMALPAIS AVE.
SAN RAFAEL, CA 94901

PHILLIP MULLER
PRESIDENT
SCD ENERGY SOLUTIONS
436 NOVA ALBION WAY
SAN RAFAEL, CA 94903

CARA KOEPF
SR. SPECIALIST II - REGULATORY
SAN JOSE CLEAN ENERGY
200 EAST SANTA CLARA STREET, 14TH FL
SAN JOSE, CA 95113

MICHELLE VIGEN RALSTON
COMMON SPARK CONSULTING
1639 WOOLSEY ST.
BERKELEY, CA 94703

DARIUSH SHIRMOHAMMADI
TECHNICAL DIR
CALIFORNIA WIND ENERGY ASSOCIATION
1700 SHATTUCK AVE., SUITE 17
BERKELEY, CA 94709

CONNIE CHO
ATTORNEY
COMMUNITIES FOR A BETTER
340 MARINA WAY
RICHMOND, CA 94801

FRANK R. LINDH
ATTORNEY AT LAW
110 TAYLOR STREET
SAN RAFAEL, CA 94901
FOR: NATURAL RESOURCES DEFENSE
(NRDC)

NATHANIEL MALCOLM
POLICY COUNSEL
MARIN CLEAN ENERGY
1125 TAMALPAIS AVE.
SAN RAFAEL, CA 94901

KARI CAMERON
INDUSTRY SPECIALIST PARALEGAL
ALCANTAR LAW GROUP
1 BLACKFIELD DRIVE, STE. 135
TIBURON, CA 94920

LUISA F. ELKINS
SR DEPUTY CITY ATTORNEY
CITY OF SAN JOSE
200 EAST SANTA CLARA ST., 16TH FL
SAN JOSE, CA 95113

ADMINISTRATOR OF

JOSÉ

FOR: CITY OF SAN JOSÉ,

SAN JOSÉ CLEAN ENERGY F/K/A SAN

CLEAN ENERGY

TAYLOR KNECHT
SAN JOSE CLEAN ENERGY
200 EAST SANTA CLARA STREET, 14TH FLOOR
SAN JOSE, CA 95113

CAROLE HAKSTIAN
SONOMA CLEAN POWER AUTHORITY
50 SANTA ROSA AVE, 4TH FLOOR
SANTA ROSA, CA 95404

JAMES H. CALDWELL, JR
1650 E. NAPA STREET
SONOMA, CA 95476

RICK UMOFF
DIR - GOV'T AFFAIR, WEST COAST
VINEYARD OFFSHORE, LLC
517 3RD STREET, STE. 3
EUREKA, CA 95501

LIZ ANTHONY GILL, PHD
CALIFORNIA ENERGY COMMISSION
1516 9TH ST
SACRAMENTO, CA 95617

ALICE KILDUFF
CALIFORNIA ISO
250 OUTCROPPING WAY
FOLSOM, CA 95630

BEN DAWSON
MARKET MONITOR
CALIFORNIA ISO
250 OUTCROPPING WAY
FOLSOM, CA 95630

BRIAN ROTHSTEIN
CUSTOMIZED ENERGY SOLUTIONS (CES)
101 PARKSHORE DR. STE 100
FOLSOM, CA 95630

CALVERT HALL
SR. POLICY DEVELOPER
WEST
CALIFORNIA ISO
250 OUTCROPPING WAY
FOLSOM, CA 95630

CHRIS DEVON
DIRECTOR, MARKET INTELLIGENCE
CUSTOMIZED ENERGY SOLUTIONS
101 PARKSHORE DR
FOLSOM, CA 95630

CRISTY SANADA
LEAD ANALYST
CORP
CALIFORNIA ISO
250 OUTCROPPING WAY
FOLSOM, CA 95630

DELPHINE HOU
CA. INDEPENDENT SYSTEMS OPERATOR
250 OUTCROPPING WAY
FOLSOM, CA 95630

DEVIN HAGAN
ORP
CALIFORNIA INDEPENDENT SYSTEM OPERATOR C
OPERATOR C
250 CROPPING WAY
FOLSOM, CA 95630

ERIK LAGERQUIST
CORPORATION
CALIFORNIA INDEPENDENT SYSTEM
250 OUTCROPPING WAY
FOLSOM, CA 95630

JASMIE GUAN
CALIFORNIA ISO
250 OUTCROPPING WAY
FOLSOM, CA 95630

KEVIN HEAD
CALIFORNIA ISO
250 OUTCROPPING WAY
FOLSOM, CA 95630

PAT PRENDERGAST, PHD
MARKET MONITOR
CALIFORNIA ISO
250 OUTCROPPING WAY
FOLSOM, CA 95630

ROBIN SMUTNY-JONES
VP - BUS. DEVELOPMENT / REGULATORY
ZGLOBAL, INC.
605 SUTTER ST., STE. 150
FOLSOM, CA 95630

SEAN MAXSON
CALIFORNIA ISO
250 OUTCROPPING WAY
FOLSOM, CA 95630

STEPHEN KEEHN
PACIFIC ENERGY ADVISORS, INC
1839 IRON POINT RD., SUITE 120
FOLSOM, CA 95630

SCOTT TOMASHEFSKY
MGR - REGULATORY
NORTHERN CALIFORNIA POWER AGENCY
651 COMMERCE DRIVE
ROSEVILLE, CA 95678-6420

ELLEN WOLFE
RESERO CONSULTING
9289 SHADOW BROOK PLACE
GRANITE BAY, CA 95746

MARY LYNCH
CONSTELLATION NEWENERGY, INC
5074 NAWAL DRIVE
EL DORADO HILLS, CA 95762

DAVID PEFFER
ATTORNEY
LAW OFFICE OF DAVID PEFFER
3424 COOK STREET
ROCKLIN, CA 95765

CAROLYN KEHREIN
PRINCIPAL CONSULTANT
ENERGY MANAGEMENT SERVICES
DISTRICT
2602 CELEBRATION WAY
WOODLAND, CA 95776

OLOF BYSTROM
MGR - RESOURCE STRATEGY
SACRAMENTO MUNICIPAL UTILITY
6201 S STREET, MS A311
SACRAMENTO, CA 95812

ANGIE HARTMANN
PRINCIPAL
SMITH, WATTS & HARTMANN
925 L STREET, SUITE 220
SACRAMENTO, CA 95814

AUDRA T. C. HARTMANN
PUBLIC POLICY ADVOCATES, LLC
1015 K STREET, SUITE 200
SACRAMENTO, CA 95814

CARLEIGH OSEN
POLICY ANALYST
CEERT
AND ADM
1100 11TH STREET, STE. 311
SACRAMENTO, CA 95814

CHERYL COX
CALIF PUBLIC UTILITIES COMMISSION
CLIMATE INITIATIVES, RENEWABLES,
300 Capitol Mall
Sacramento, CA 95814

CHRISTIAN KNIERIM

COLBY BERMEL

CALIF PUBLIC UTILITIES COMMISSION
CLIMATE INITIATIVES, RENEWABLES, AND ADM
300 Capitol Mall
Sacramento, CA 95814

POLITICO
925 L STREET STE 150
SACRAMENTO, CA 95814

DAWN R. FORGEUR
PRACTICE ASSISTANT
BEST BEST & KRIEGER LLP
500 CAPITOL MALL, STE. 1700
SACRAMENTO, CA 95814

DILIN NAIDOO
CALIF PUBLIC UTILITIES COMMISSION
DISTRIBUTION PLANNING BRANCH
300 Capitol Mall
Sacramento, CA 95814

DRUCILLA DUNTON
CALIF PUBLIC UTILITIES COMMISSION
DISTRIBUTION PLANNING BRANCH
BRAN
300 Capitol Mall
Sacramento, CA 95814

JARED FERGUSON
CALIF PUBLIC UTILITIES COMMISSION
ELECTRIC PLANNING AND MARKET DESIGN
300 Capitol Mall
Sacramento, CA 95814

JEDEDIAH J. GIBSON
ATTORNEY
DOWNEY BRAND LLP
621 CAPITOL MALL, 18TH FLOOR
SACRAMENTO, CA 95814
FOR: BEAR VALLEY ELECTRIC SERVICE

JUSTIN WYNNE
ATTORNEY
BRAUN BLAISING & WYNNE P.C.
555 CAPITOL MALL, STE. 570
SACRAMENTO, CA 95814

KATE UNGER
SR. ADVISOR
CALIFORNIA SOLAR & STORAGE ASSOCIATION
1107 9TH STREET, STE. 820
SACRAMENTO, CA 95814

MICH HEIN
CEO
ELECTROCHAEA CORPORATION
500 CAPITOL MALL, STE. 1900
SACRAMENTO, CA 95814

REGULATORY CLERK
BRAUN BLAISING & WYNNE, PC (BB&W)
555 CAPITOL MALL, STE 570
SACRAMENTO, CA 95814

SAMANTHA HOLDSTOCK
PARALEGAL
STOEL RIVES LLP
500 CAPITOL MALL, STE. 1600
SACRAMENTO, CA 95814

SEAN SIMON
CA ENERGY COMMISSION
715 P STREET
SACRAMENTO, CA 95814

TRI LUU
HYDROSTOR INC.
400 CAPITOL MALL, SUITE 3000
SACRAMENTO, CA 95814-4497

LYNN MARSHALL
CALIFORNIA ENERGY COMMISSION
1516 NINTH STREET, MS-22
SACRAMENTO, CA 95814-5512

MARK KOOTSTRA
CALIFORNIA ENERGY COMMISSION
1516 NINTH STREET, MS 51
SACRAMENTO, CA 95814-5512

ANDREW B. BROWN

CHASE K. MAXWELL

ATTORNEY
LLP
ELLISON SCHNEIDER HARRIS & DONLAN LLP
2600 CAPITOL AVENUE, SUITE 400
SACRAMENTO, CA 95816

ELLISON SCHNEIDER HARRIS & DONLAN,
2600 CAPITOL AVENUE, SUITE 400
SACRAMENTO, CA 95816

MANAL YAMOUT MCDERMID (ELSI)
CALIBER STRATEGIES
PO BOX 160724
SACRAMENTO, CA 95816

SHAYLA FUNK
CALIBER STRATEGIES
PO BOX 160724
SACRAMENTO, CA 95816

JEFFERY D. HARRIS
ATTORNEY AT LAW
ELLISON, SCHNEIDER HARRIS & DONLAN LLP
LLP
2600 CAPITOL AVENUE, SUITE 400
SACRAMENTO, CA 95816-5905

ANDREW B. BROWN
ATTORNEY AT LAW
ELLISON SCHNEIDER HARRIS & DONLAN
2600 CAPITOL AVENUE, SUITE 400
SACRAMENTO, CA 95816-5931
FOR: ON BEHALF OF CONSTELLATION
NEWENERGY, INC.

BRIAN S. BIERING
ATTORNEY
ELLISON SCHNEIDER HARRIS & DONAN LLP
LLP
2600 CAPITOL AVE., STE. 400
SACRAMENTO, CA 95816-5931

JESSICA MELMS
ATTORNEY
ELLISON SCHNEIDER HARRIS & DONLAN
2600 CAPITOL AVENUE, SUITE 400
SACRAMENTO, CA 95816-5931

LYNN HAUG
ATTORNEY
ELLISON SCHNEIDER HARRIS & DONLAN LLP
DISTRICT
2600 CAPITOL AVENUE, SUITE 400
SACRAMENTO, CA 95816-5931

DENNIS PETERS
GOV'T AFFAIRS REP.
SACRAMENTO MUNICIPAL UTILITY
6201 S STREET, MS B404
SACRAMENTO, CA 95817

JOSH STOOPS
GOV'T AFFAIRS REP. - REGULATORY
SACRAMENTO MUNICIPAL UTILITY DISTRICT
DISTRICT
6201 S STREET, MS B404
SACRAMENTO, CA 95817

MARISSA O'CONNOR
SR. ATTORNEY
SACRAMENTO MUNICIPAL UTILITY
6301 S STREET, MS B406
SACRAMENTO, CA 95817

KIM DELFINO
FOUNDER
EARTH ADVOCACY
3053 FREEPORT BLVD. NO.160
SACRAMENTO, CA 95818

KALLIE WELLS
SENIOR PARTNER
GRIDWELL CONSULTING
825 45TH STREET
SACRAMENTO, CA 95819

ED BURGESS
SR POLICY DIR
VEHICLE-GRID INTEGRATION COUNCIL

JESSICA NELSON
GENERAL MANAGER
GOLDEN STATE POWER COOPERATIVE

10265 ROCKINGHAM DRIVE, STE. 100-4061
SACRAMENTO, CA 95827

PO BOX 1815
GRAEGLE, CA 96103-1815

ELISIA HOFFMAN
HUA NANI PARTNERS
PO BOX 1303
KAILUA, HI 96734

JADE LU
HUA NANI PARTNERS
PO BOX 1303
KAILUA, HI 96734

JENNIFER FRY
STOEL RIVES LLP
760 SW NINTH AVENUE, SUITE 3000
PORTLAND, OR 97205

SCOTT OLSON
AVANGRID RENEWABLES
2701 NW VAUGHN
PORTLAND, OR 97210

JESSICA ZAHNOW
PACIFICORP
825 NE MULTNOMAH, SUITE 2000
PORTLAND, OR 97232

SUE MARA
CONSULTANT
MARA CONSULTING
27177 185TH AVE. SE, STE. 111-207
COVINGTON, WA 98042

JORDAN WEISZHAAR
PROGRAM MGR
MICROSOFT CORPORATION
ONE MICROSOFT WAY
REDMOND, WA 98052

WALDO KUIPERS
SR CORPORATE COUNSEL
MICROSOFT CORPORATION
ONE MICROSOFT WAY
REDMOND, WA 98052

IAN D. WHITE
SHELL ENERGY SOLUTIONS
601 WEST FIRST AVENUE, SUITE 1700
SPOKANE, WA 99201

MIKE BENN, J.D., B.ASC.
POWEREX CORP.
1300 - 666 BURRARD STREET
VANCOUVER, BC V6C 2X8
CANADA
